
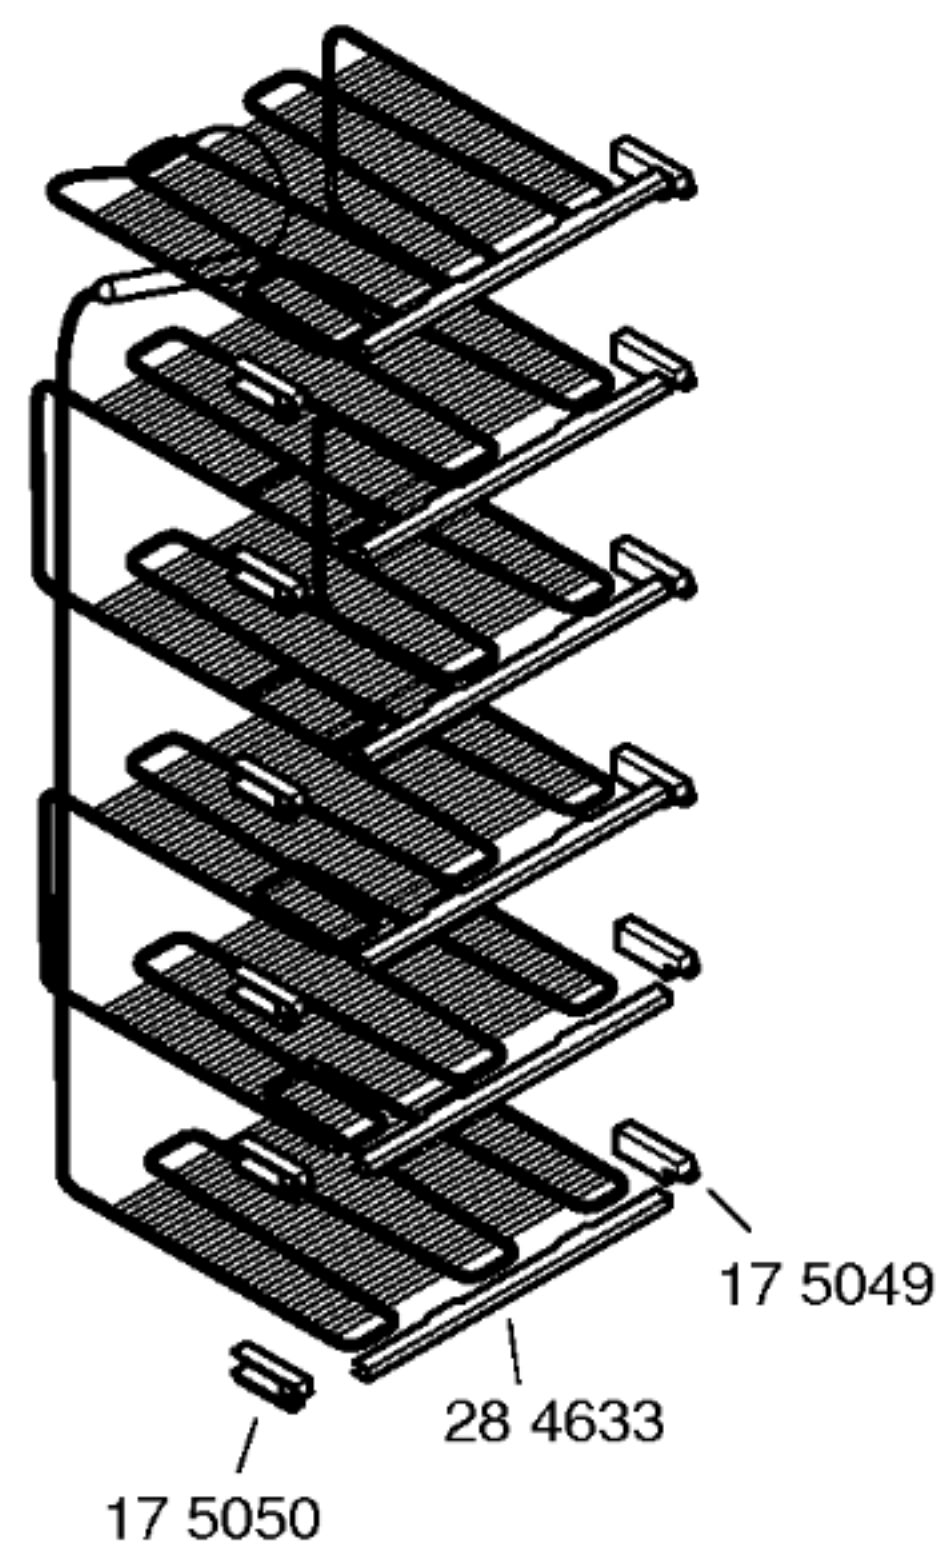
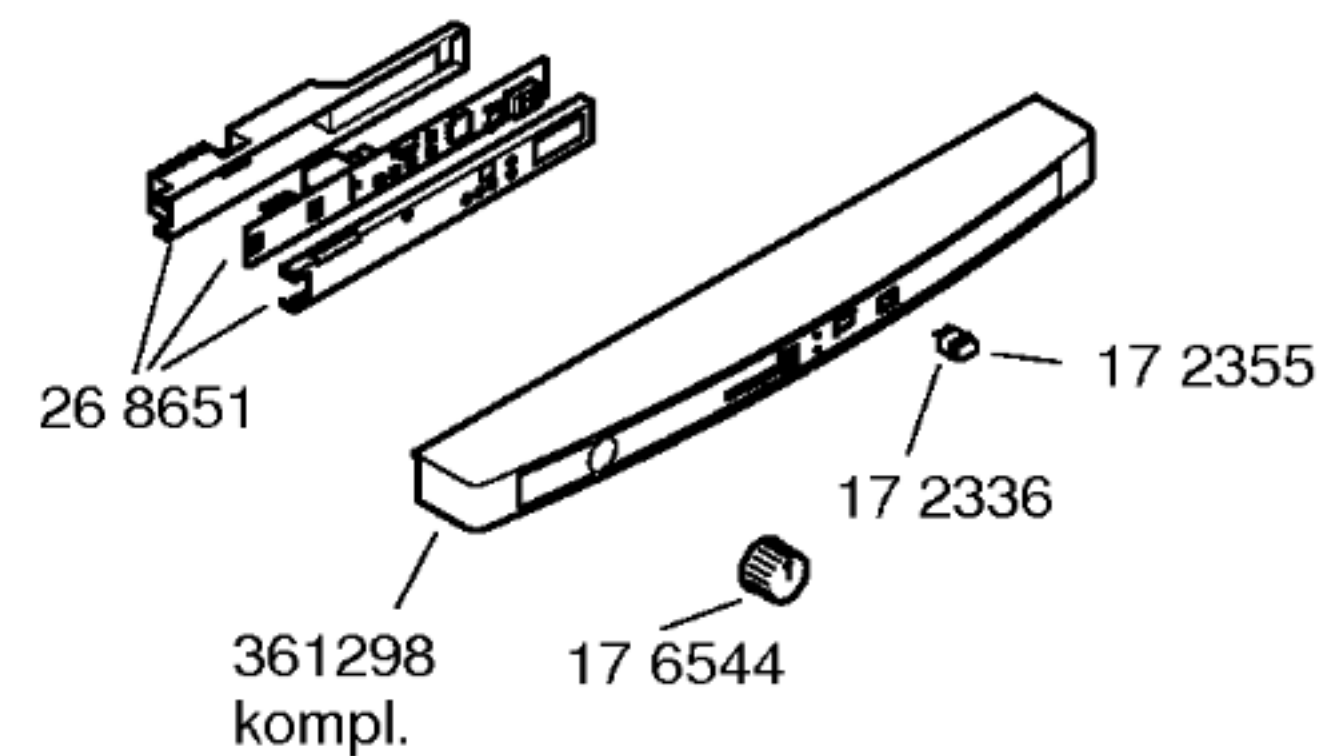



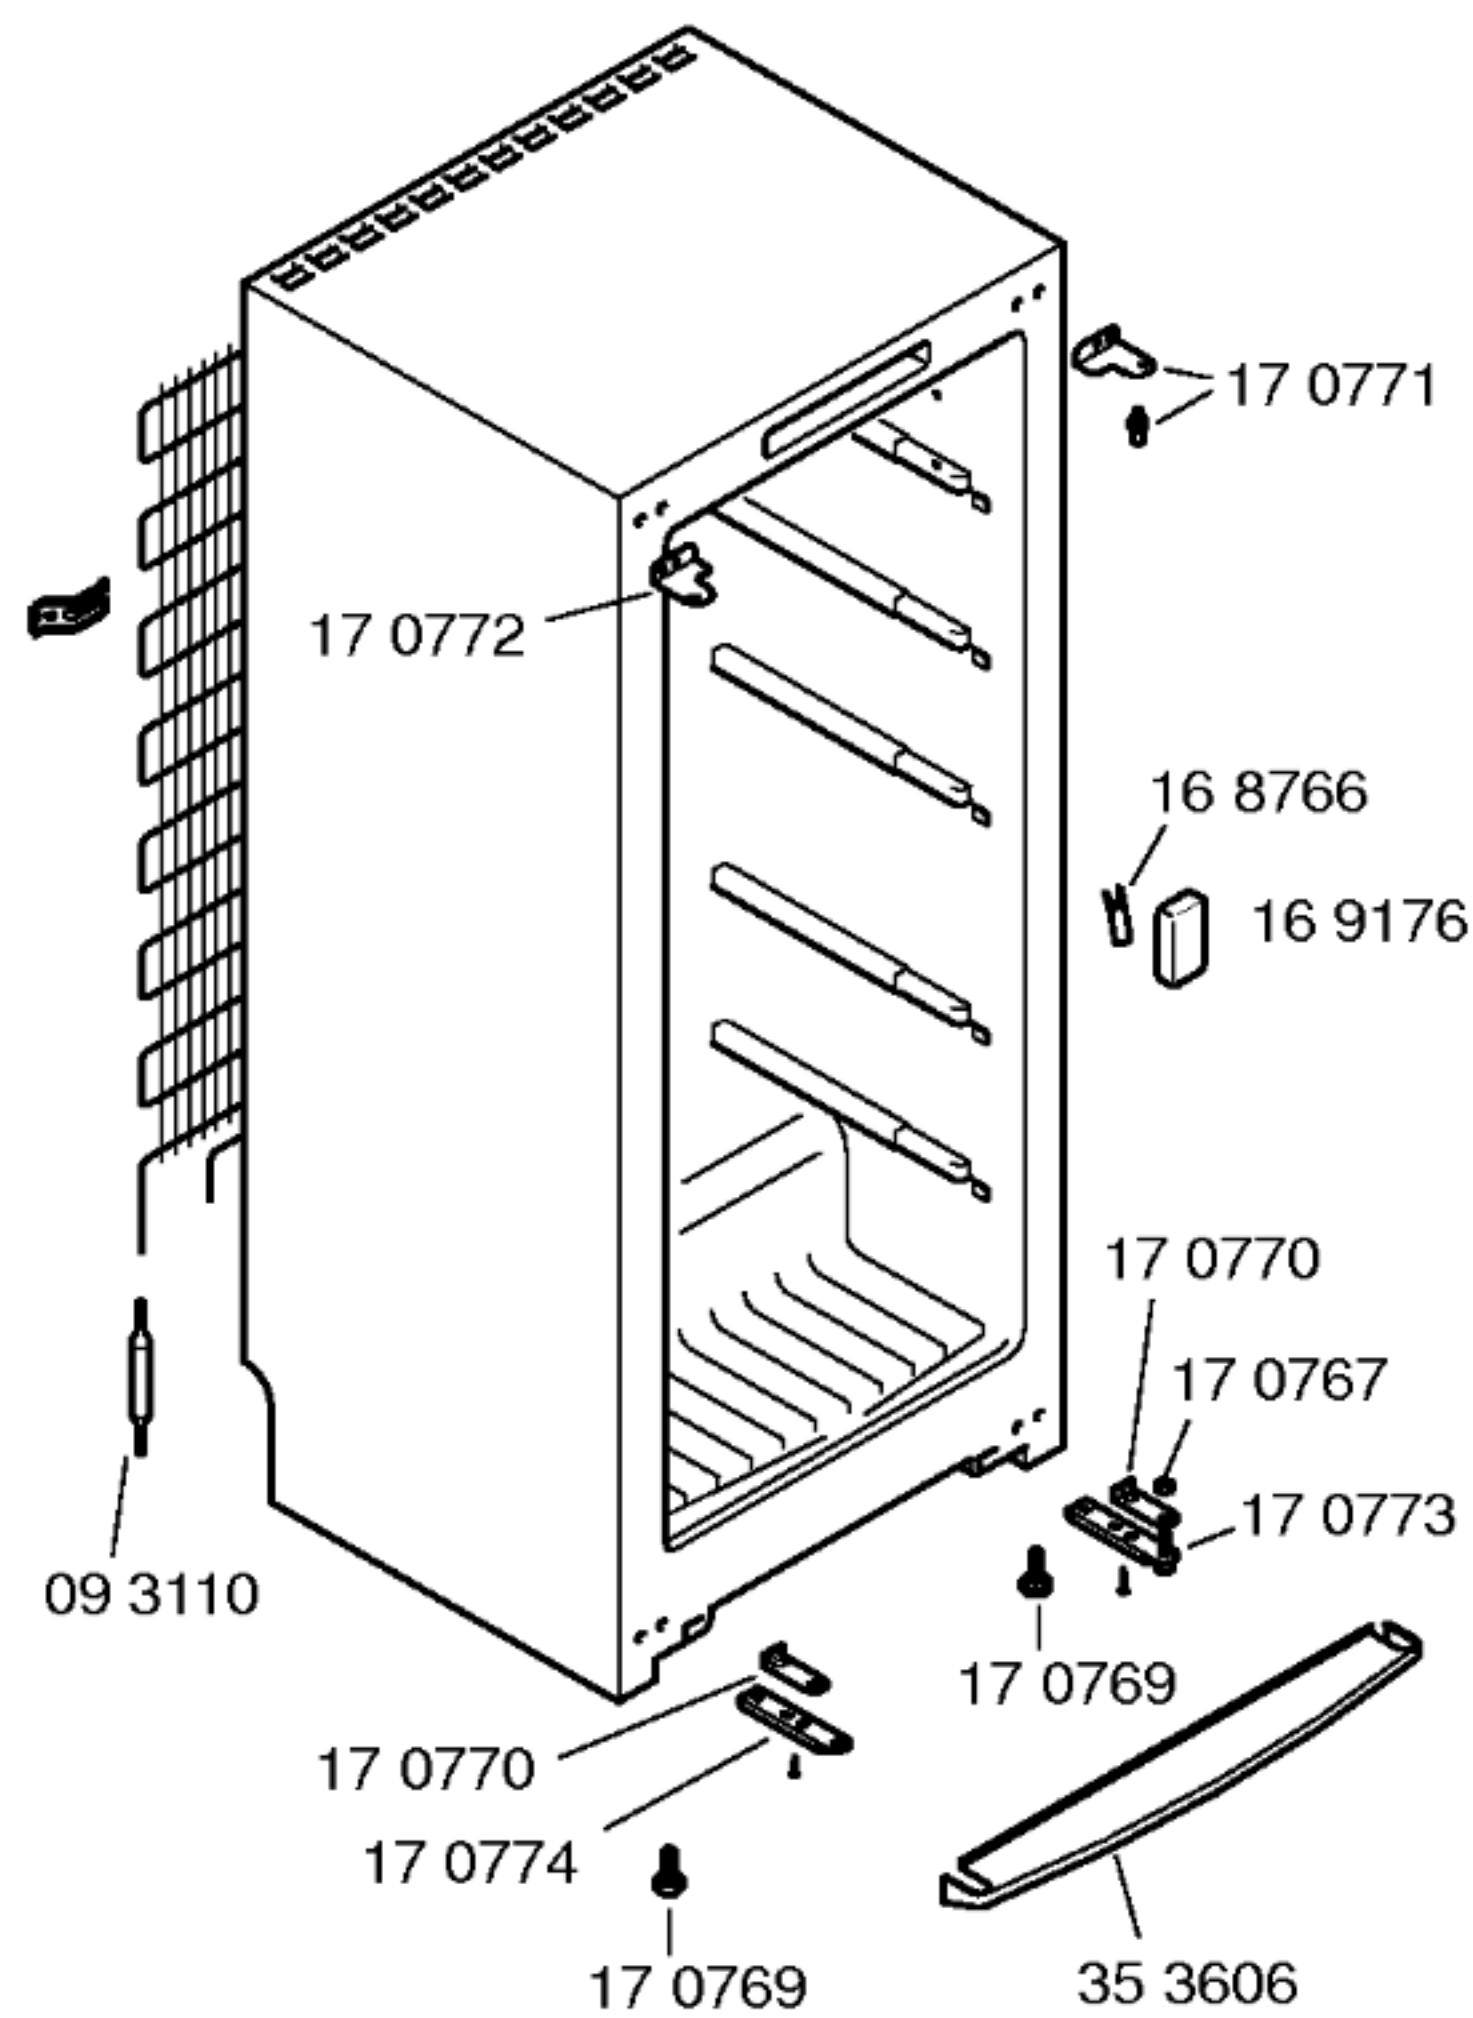


Mat. – Nr. – Konstante
3740


Gebrauchsanweisung
52 8124
(D,GB,F,I,NL,E,P)

Montageanleitung
52 2772
(D,GB,F,I,NL,DK,N,SF,
SE,TR)

Beistellsatz
26 5629

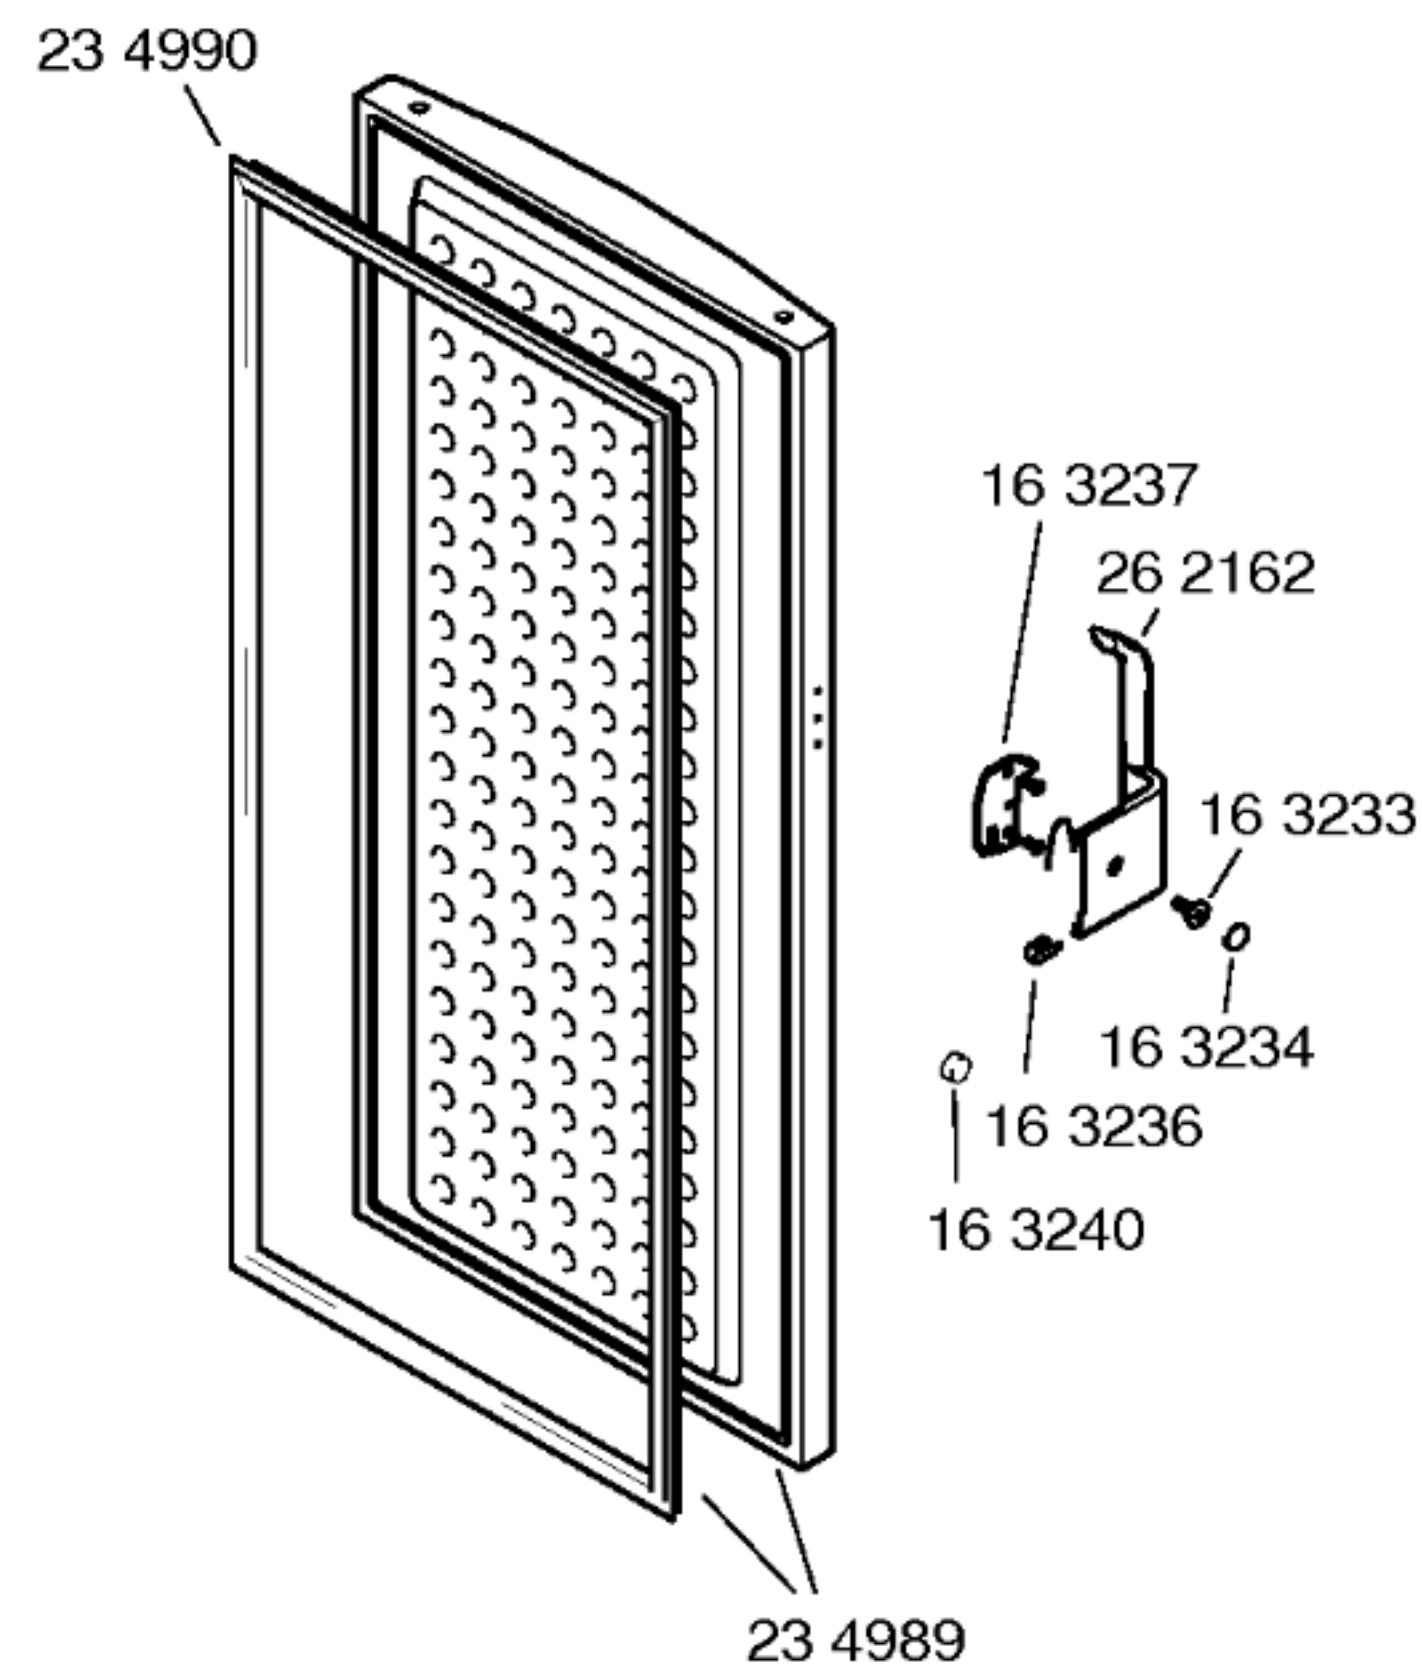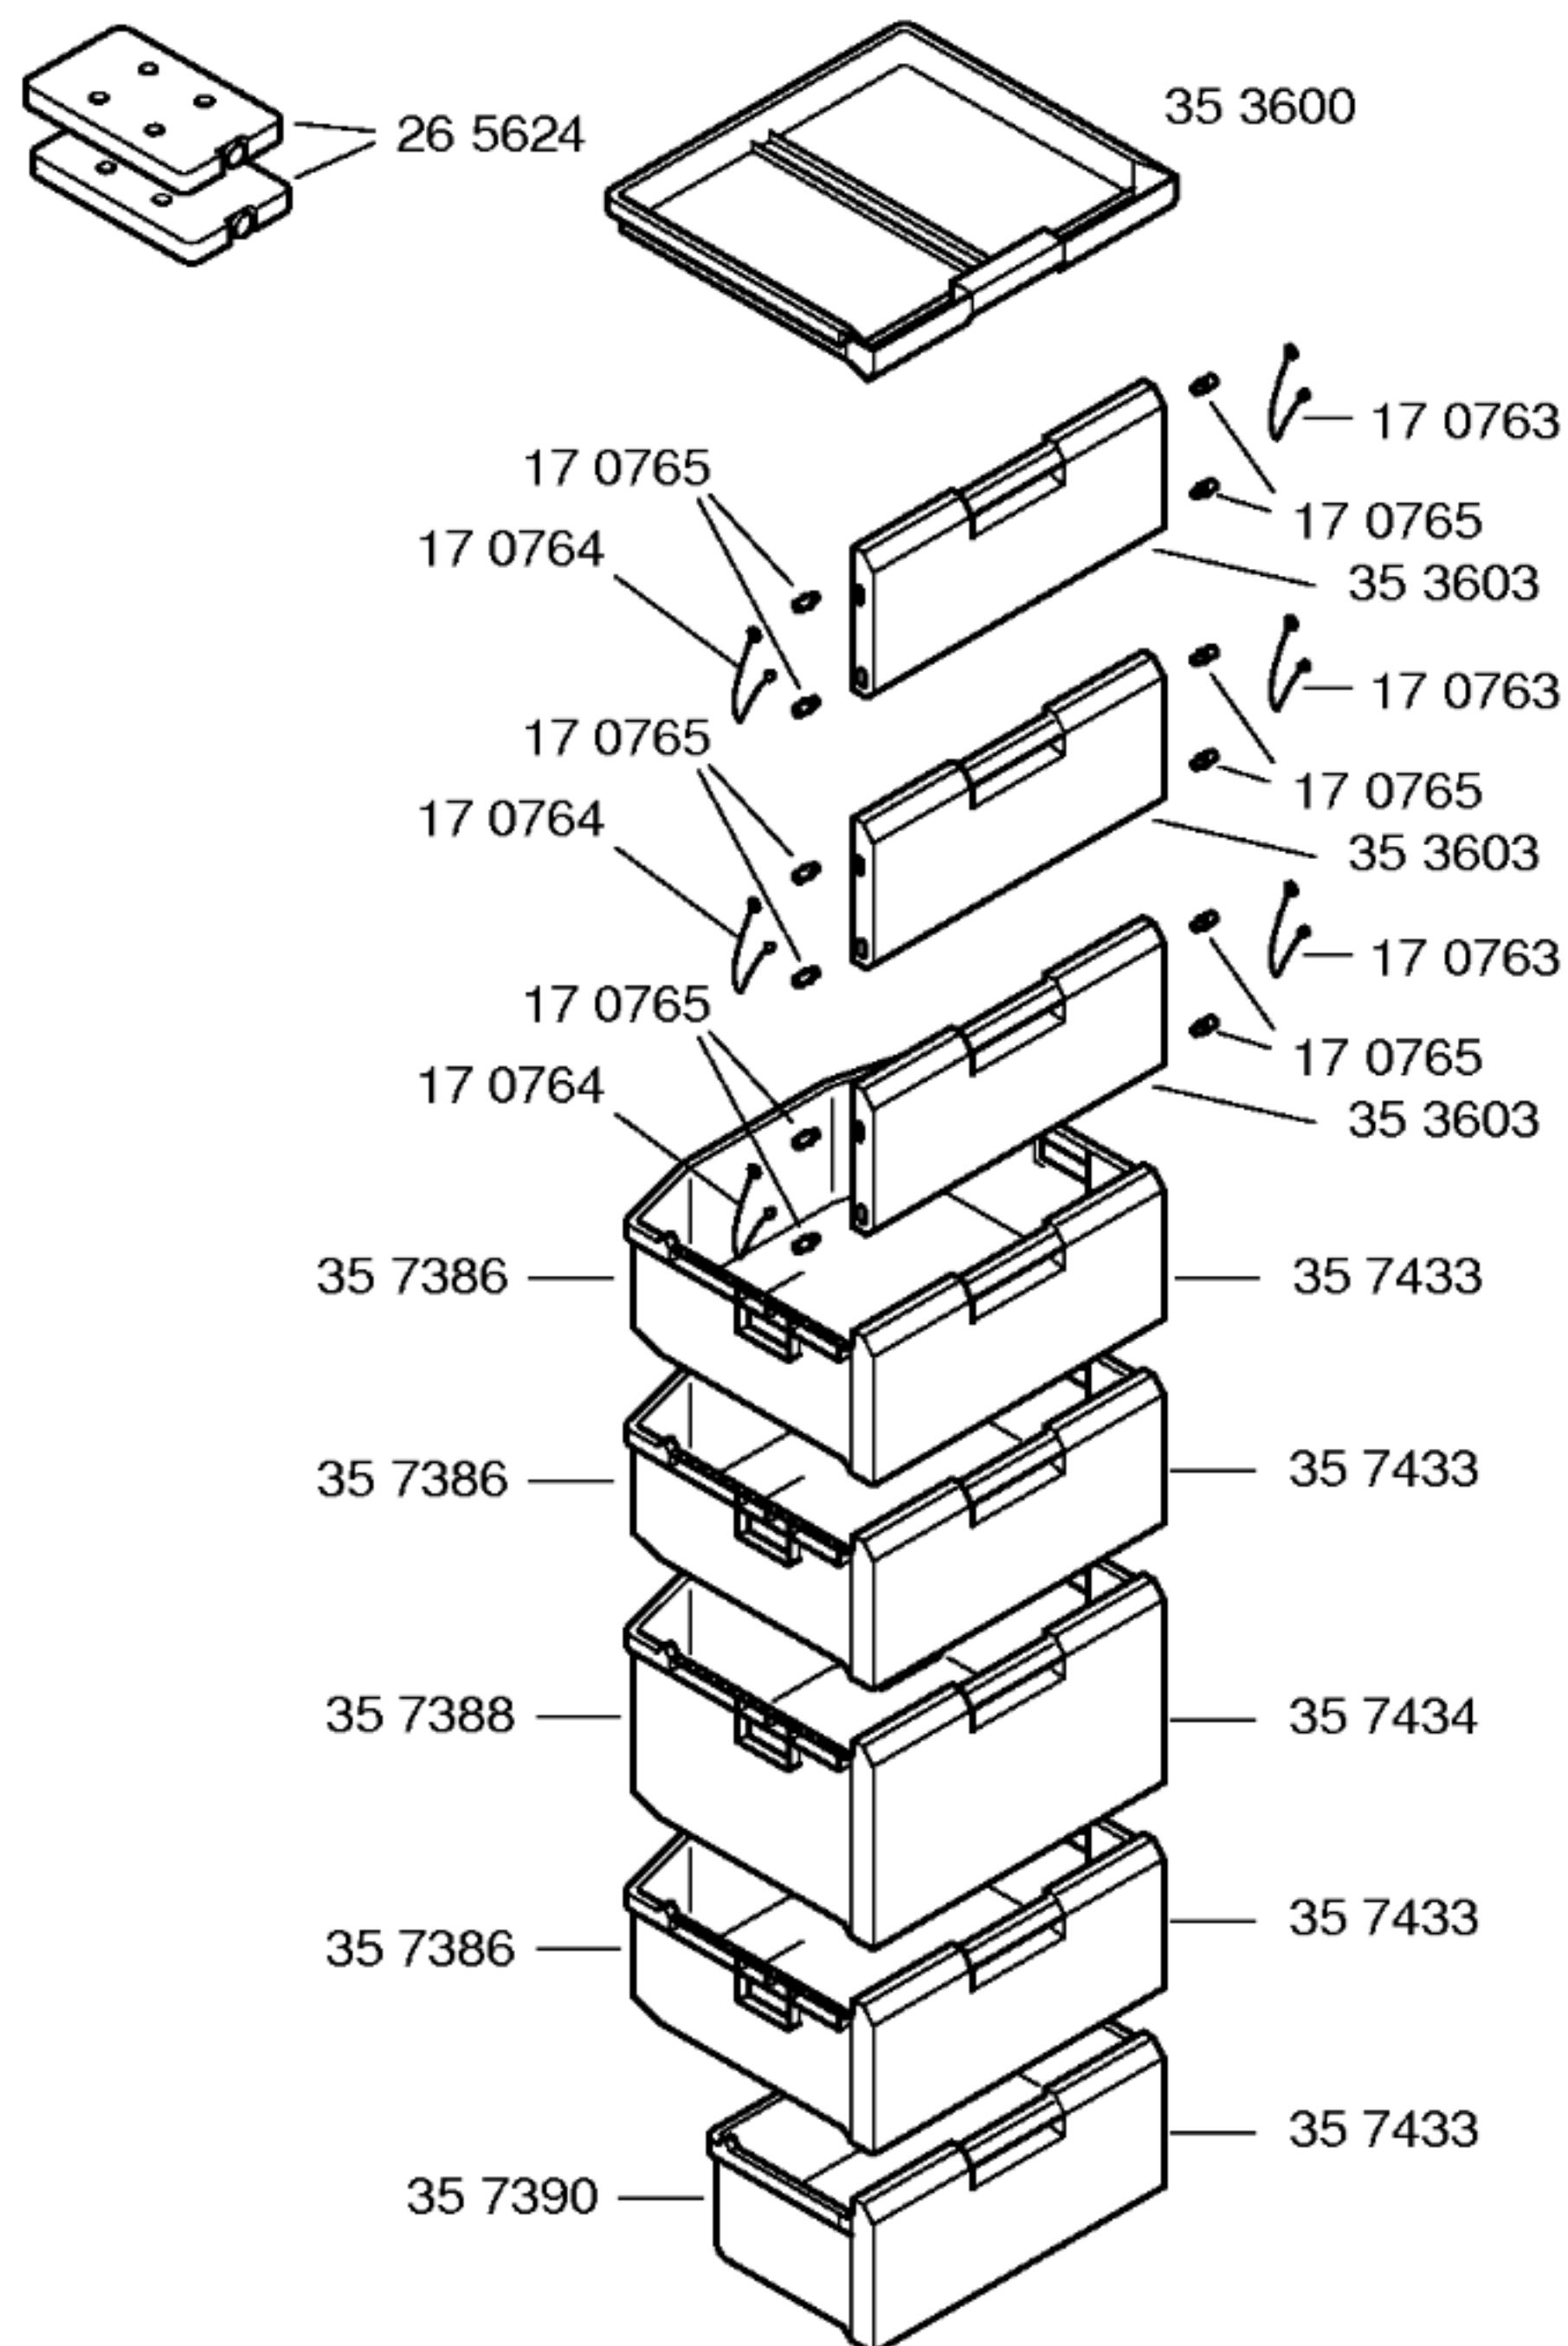

Mat. – Nr. – Konstante
3740

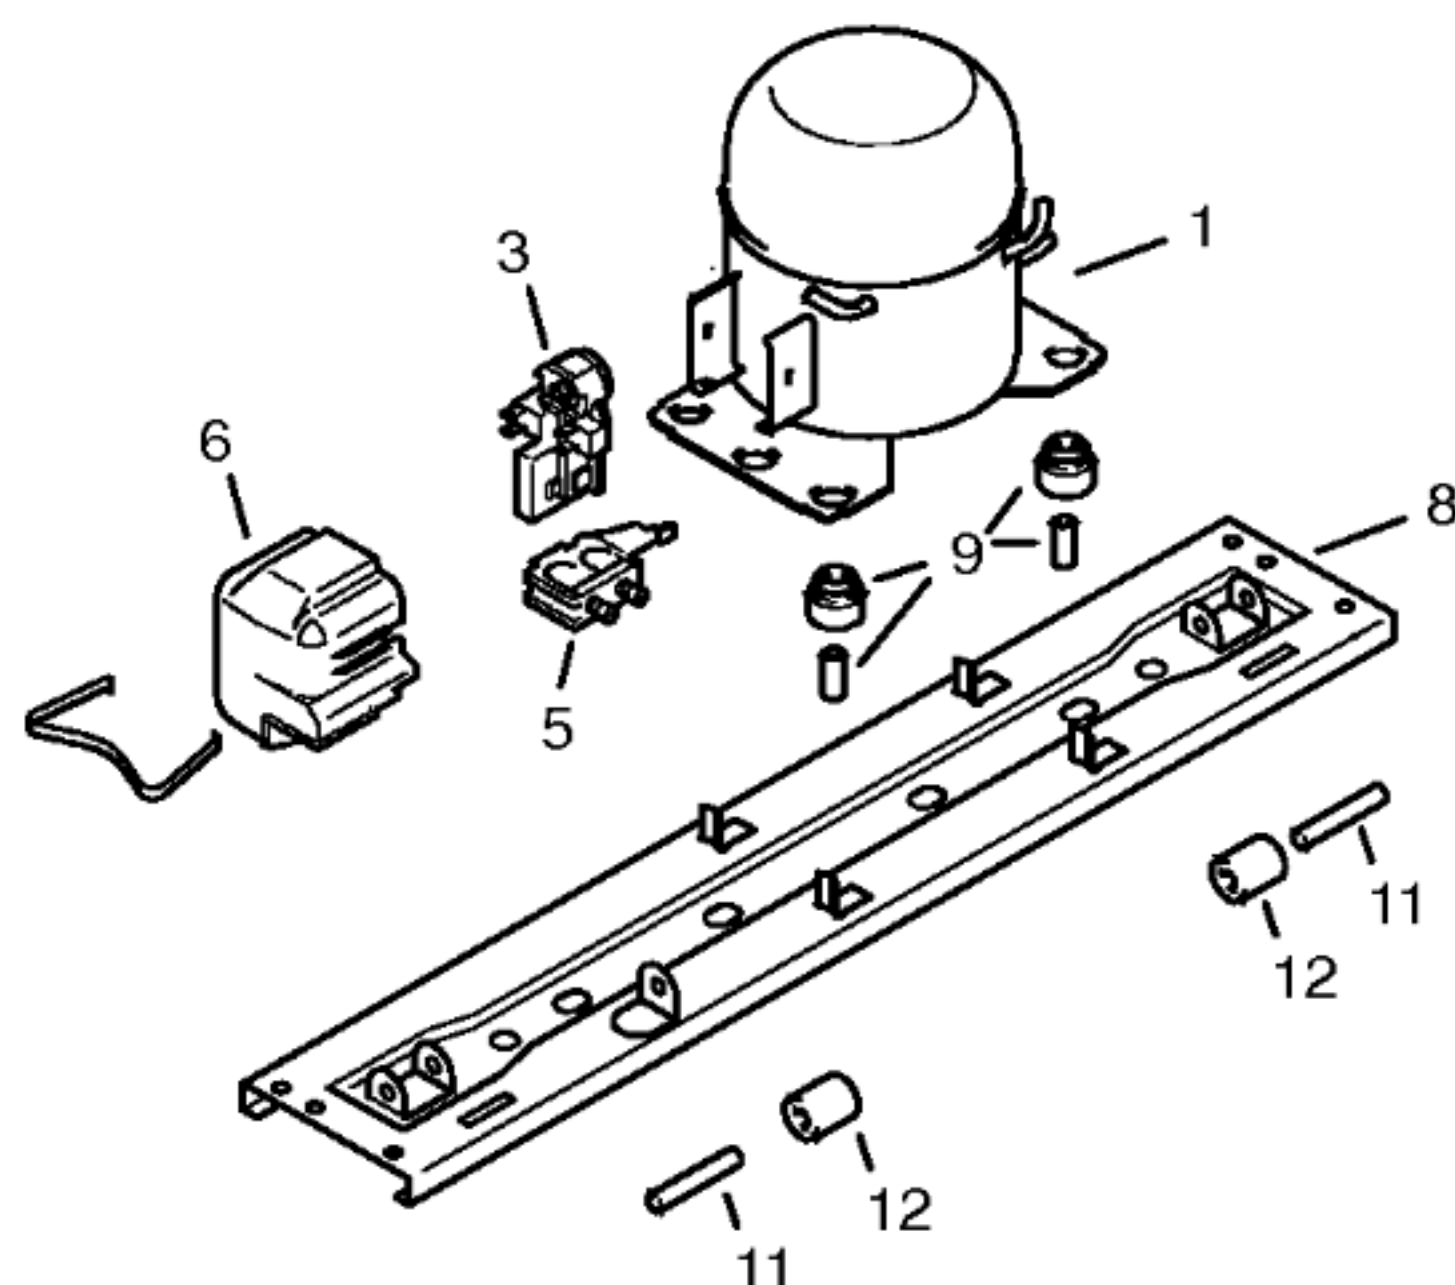

	V01	V02	V03
Pos.	Danfoss	Matsushita	
	NLY13KK2	DC125E	
1	14 1751	14 2131	
2			
3	15 1055	17 2967	
4			
5	15 0760	16 2549	
6	15 1072	16 6782	
7		08 8535	
8	21 4604		
9	05 0166	05 0166	
10			
11	01 9017	01 9017	
12	01 9016	01 9016	

TECHNISCHE DATEN / TECHNICAL DATA / DONNEES TECHNIQUES

Verdichter/Compressor/Compresseur		Danfoss	Matsushita		
Typ/Type		NLY 13 KK2	DC125E		
Förderleistung/Delivery/Débit	l/h	2394	2246		
Anlaufstrom/Starting current/Cour de démarrage	A		9,2		
Widerstand/Resistance/Résistance Ha/main/prin	Ω		12,1		
Hi/aux	Ω		13,8		
Temp.–Regler/Thermostat					
Typ/Type					
Regelstellung/Position					
Schaltwerte/Switching values	"warm"				
Valeurs de commutation	"kalt"				
	"alarm"				
Füllmenge/Fill.quantity/Charge	R600a		120		
Anschlußwert/Conn.load/Puiss. connectée	W				
Heizung/Heater/Chauffage					
Widerstand/Resistance/Résistance	Ω				
Leistung/Power/Puissance	W				
Ventilator/Blower/Ventilateur					
Widerstand/Resistance/Résistance	Ω				
NTC–Fühler / Sensor		°C	kΩ	°C	kΩ
		+10	9,95 ± 0,18	–18	43,31 ± 1,10
		+5	12,70 ± 0,18	–22	54,66 ± 1,59
		0	16,33 ± 0,16	–26	69,42 ± 2,29
Magnetventil/Magnetic valve/Electrovanne					
Widerstand/Resistance/Résistance	Ω				
Spannung/Voltage/Tension	V				