
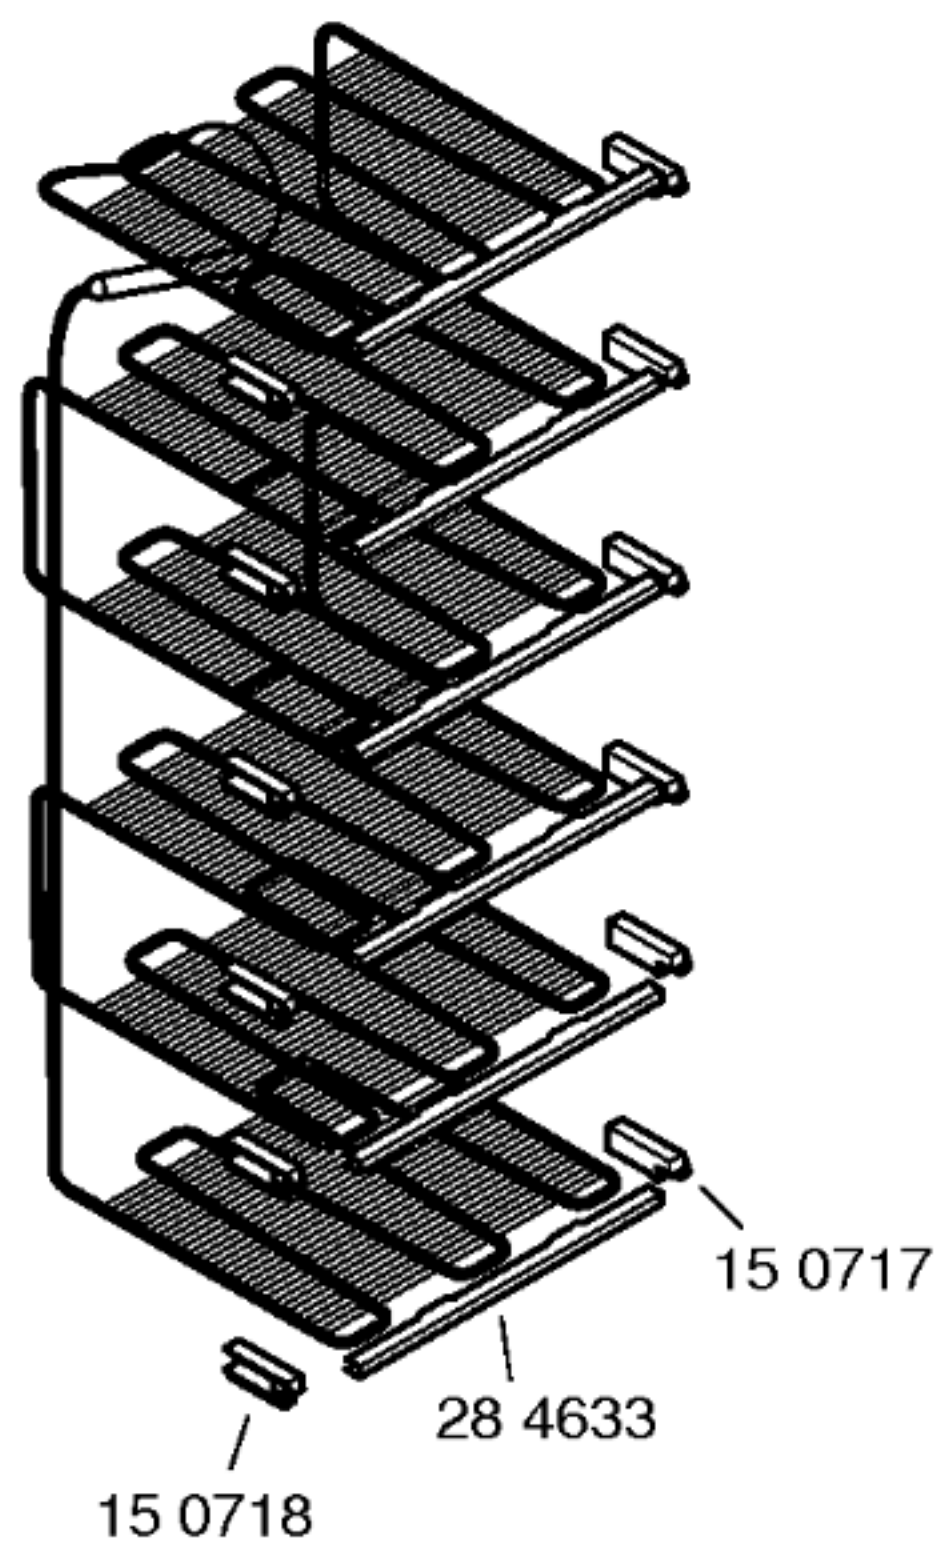
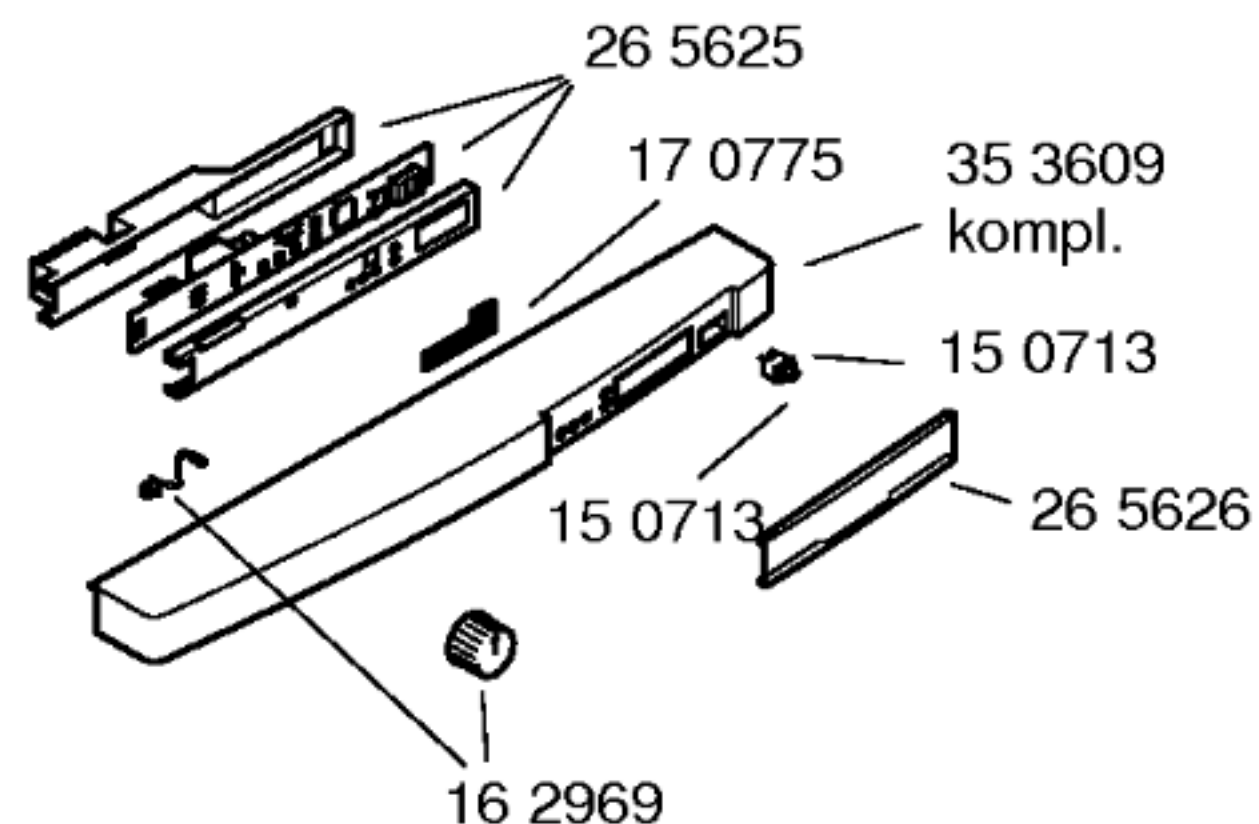


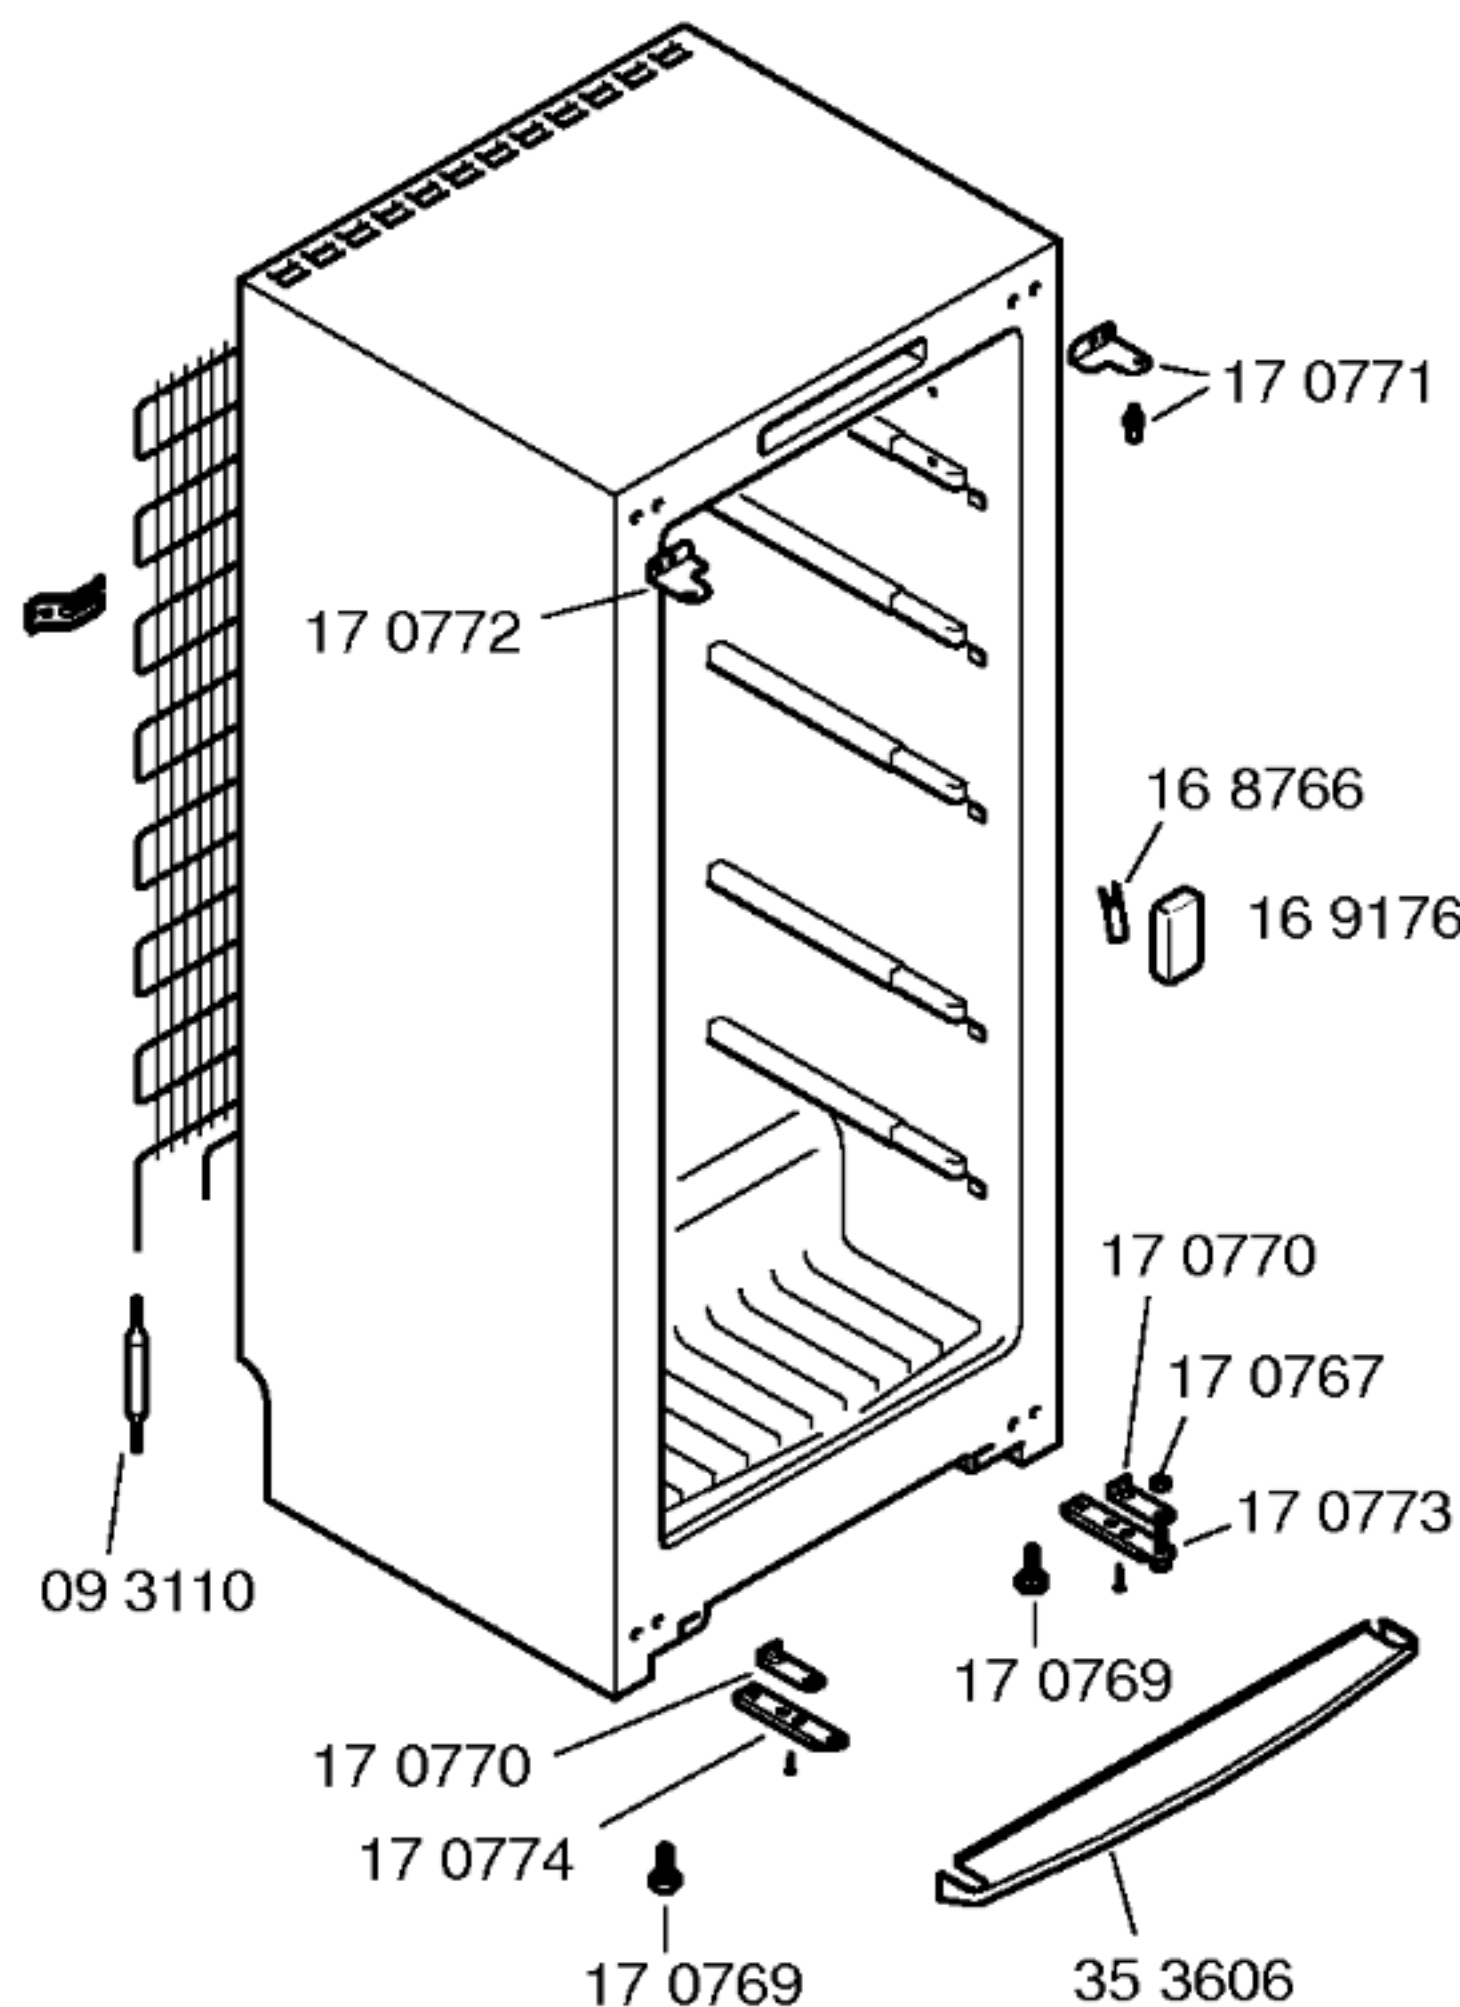

07 4445
V01,V04,V07
09 6325
V02,V05
09 6572
V03,V06,V08


Mat. – Nr. – Konstante
3740


Gebrauchsanweisung
52 2769
(D,GB,F,I,NL)

Montageanleitung
52 2772
(D,GB,F,I,NL,DK,N,SF,
SE,TR)

Beistellsatz
26 5629

Side by Side
Beistellsatz zu KSR/KSK
48 1044

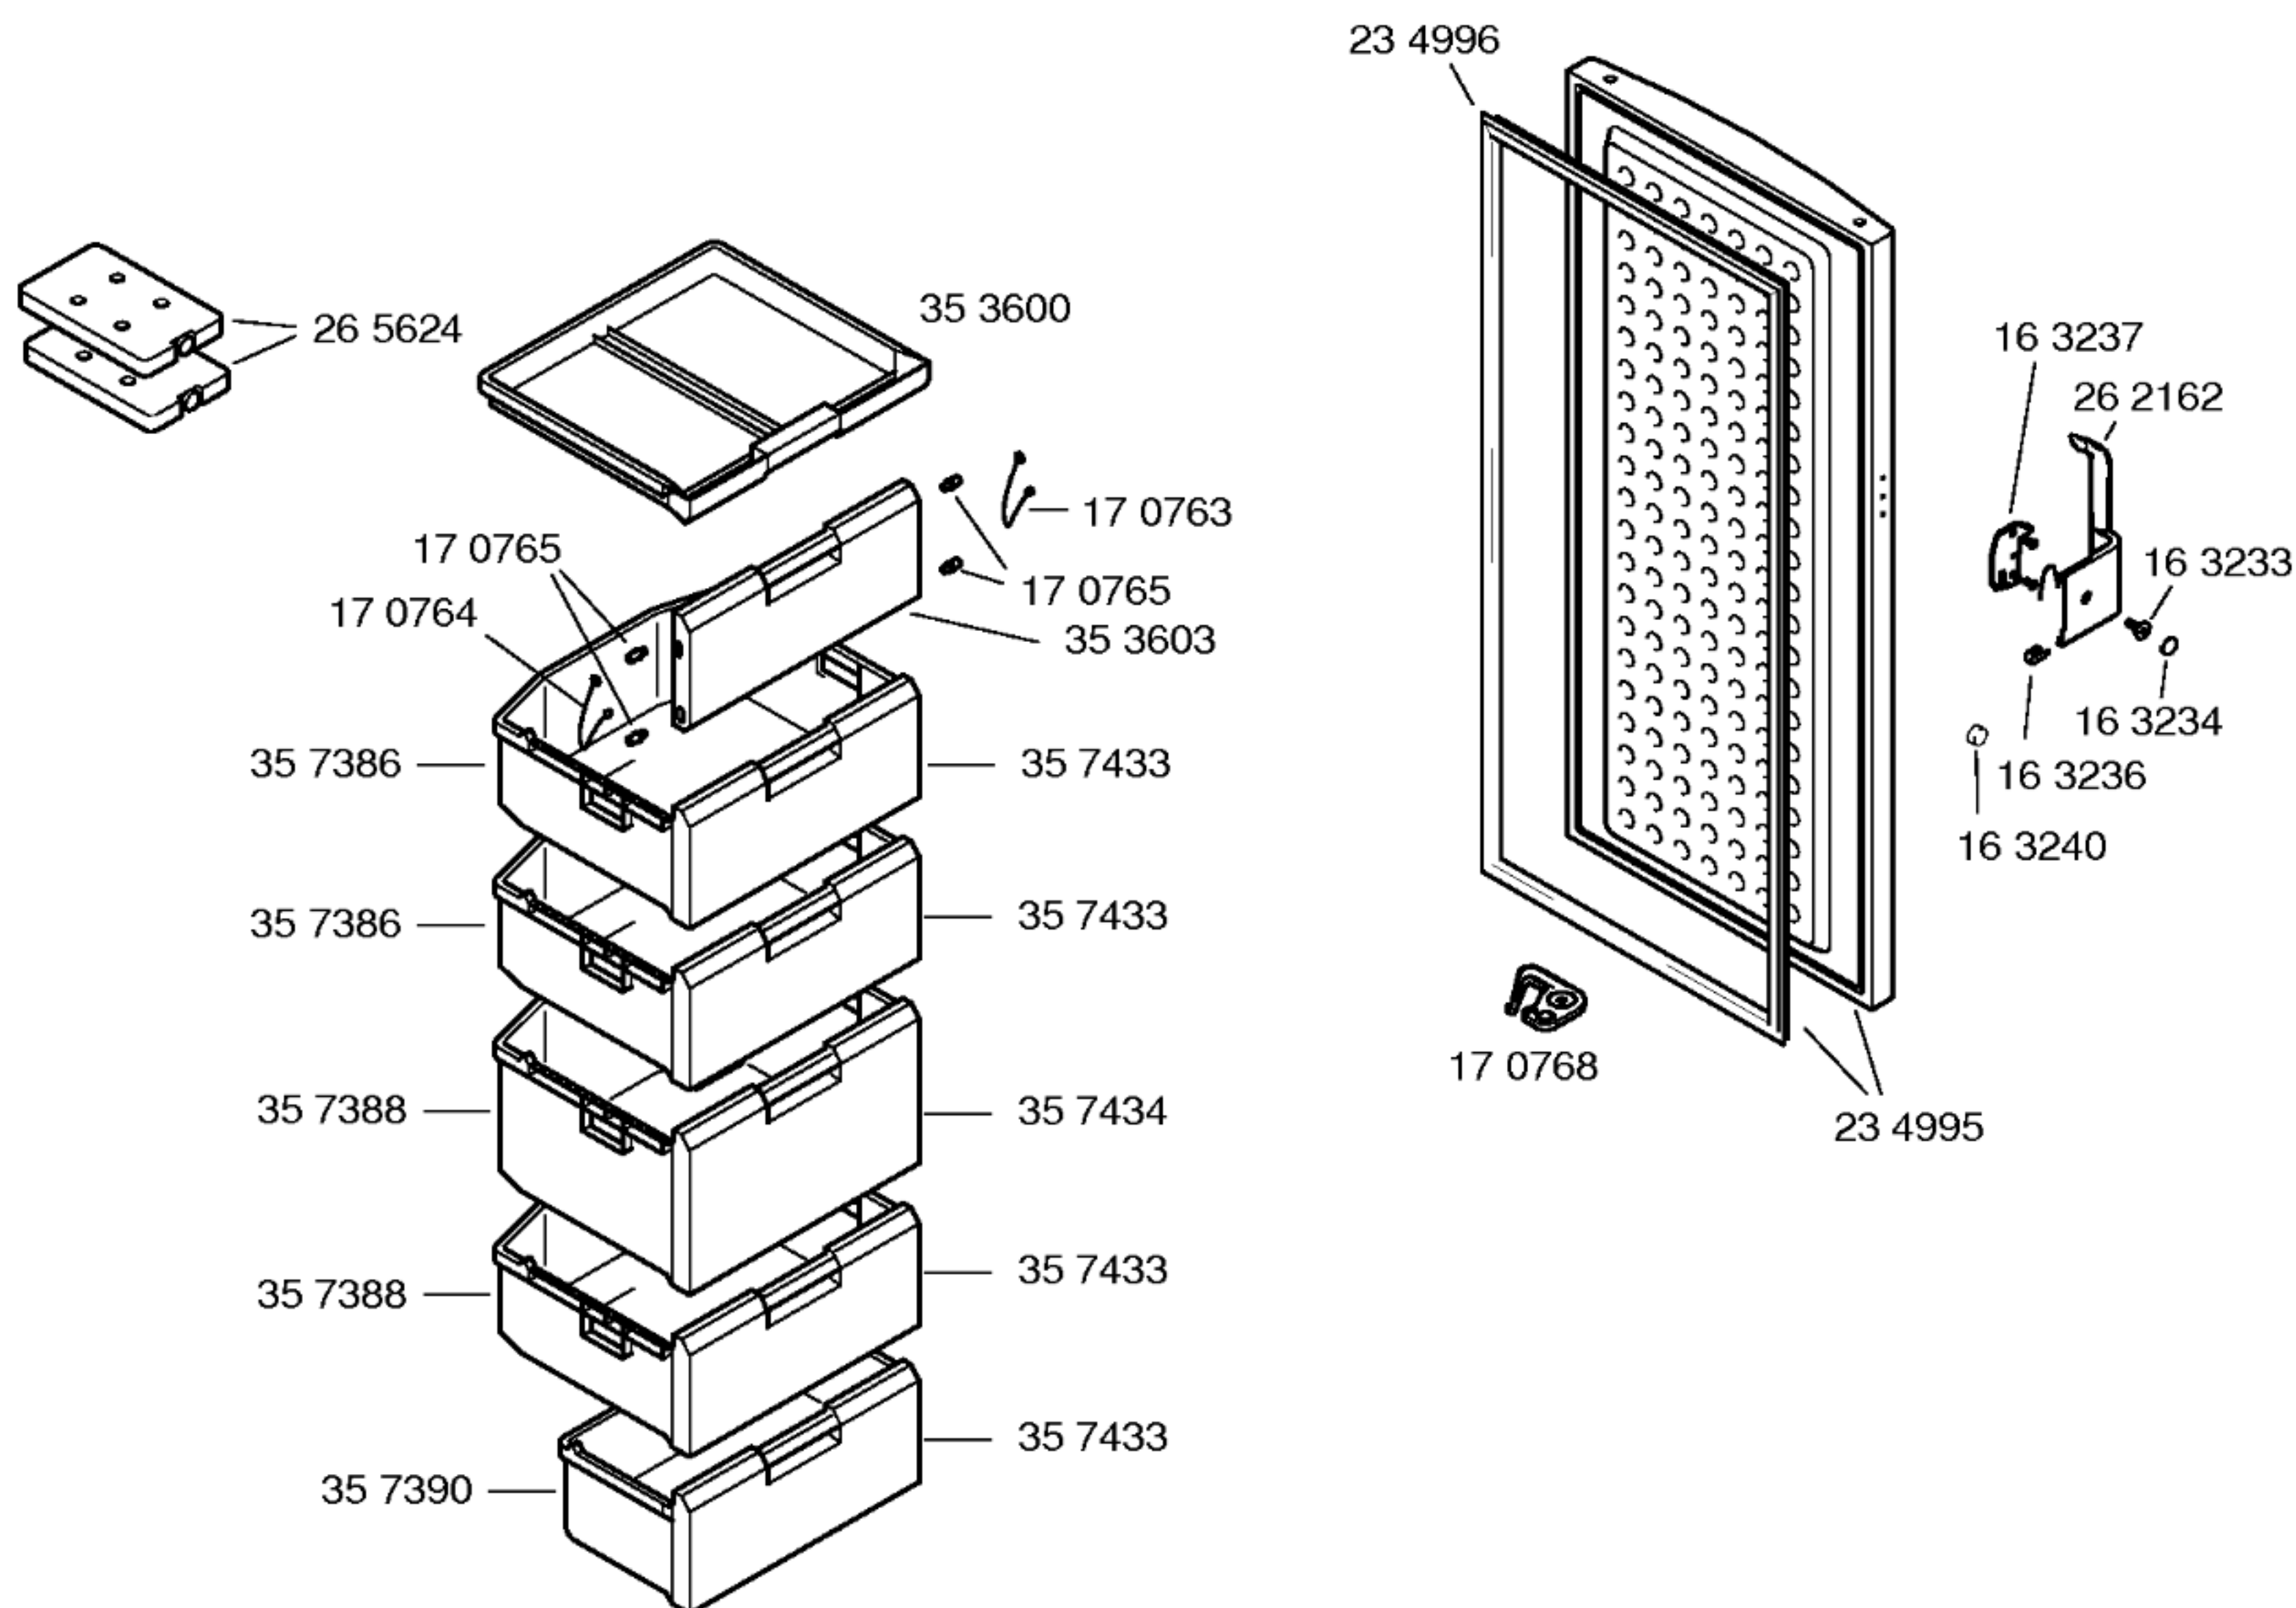

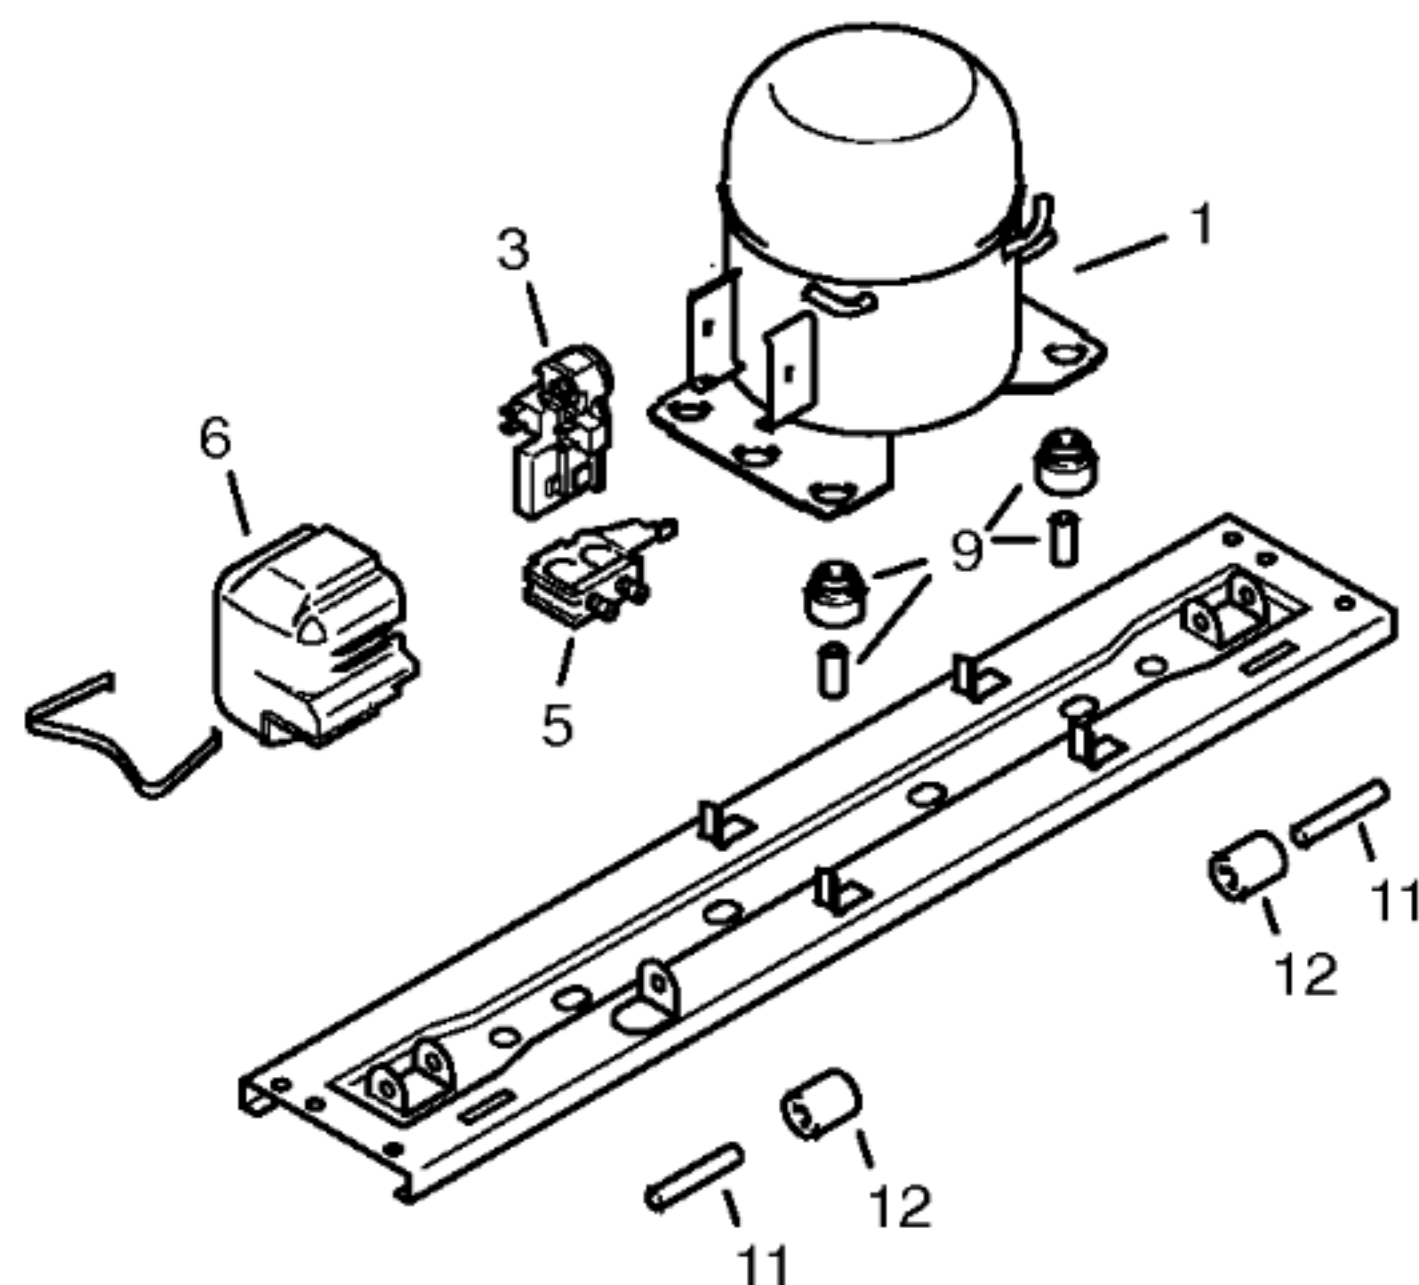

	V01-V03	V04-V06	V07,V08
Pos.	Aspera	Matsushita	Danfoss
	NBT1116Y	DC 125 E	NLE13K
1	14 1844	14 1965	14 1751
2			
3	17 0932	17 2967	15 1055
4			
5	16 8903	16 2549	15 0760
6	16 8902	16 6782	15 1072
7			
8	21 4604	21 4604	21 4604
9	05 0166	05 0166	05 0166
10			
11	01 9017	01 9017	01 9017
12	01 9016	01 1916	01 1916

TECHNISCHE DATEN / TECHNICAL DATA / DONNEES TECHNIQUES				
Verdichter/Compressor/Compresseur		Aspera	Matsushita	Danfoss
Typ/Type		NBT 1116 Y	DC 125 E	NLE13K
Förderleistung/Delivery/Débit		l/h	2214	2246
Anlaufstrom/Starting current/Cour de démarrage		A	9,2	10,9
Widerstand/Resistance/Résistance		Ω	13,2	12,1
Hi/aux		Ω	17,6	13,8
Temp.-Regler/Thermostat				
Typ/Type				
Regelstellung/Position				
Schaltwerte/Switching values		"warm"		
Valeurs de commutation		"kalt"		
		"alarm"		
Füllmenge/Fill.quantity/Charge		R600a	*	
Anschlußwert/Conn.load/Puiss. connectée		W	124	120
				148
Heizung/Heater/Chauffage				
Widerstand/Resistance/Résistance		Ω		
Leistung/Power/Puissance		W		
Ventilator/Blower/Ventilateur				
Widerstand/Resistance/Résistance		Ω		
NTC-Fühler / Sensor		°C	kΩ	°C
		+10	9,95 ±0,18	-18
		+5	12,70 ±0,18	-22
		0	16,33 ±0,16	-26
				43,31 ±1,10
				54,66 ±1,59
				69,42 ±2,29
Magnetventil/Magnetic valve/Electrovanne				
Widerstand/Resistance/Résistance		Ω		
Spannung/Voltage/Tension		V		