
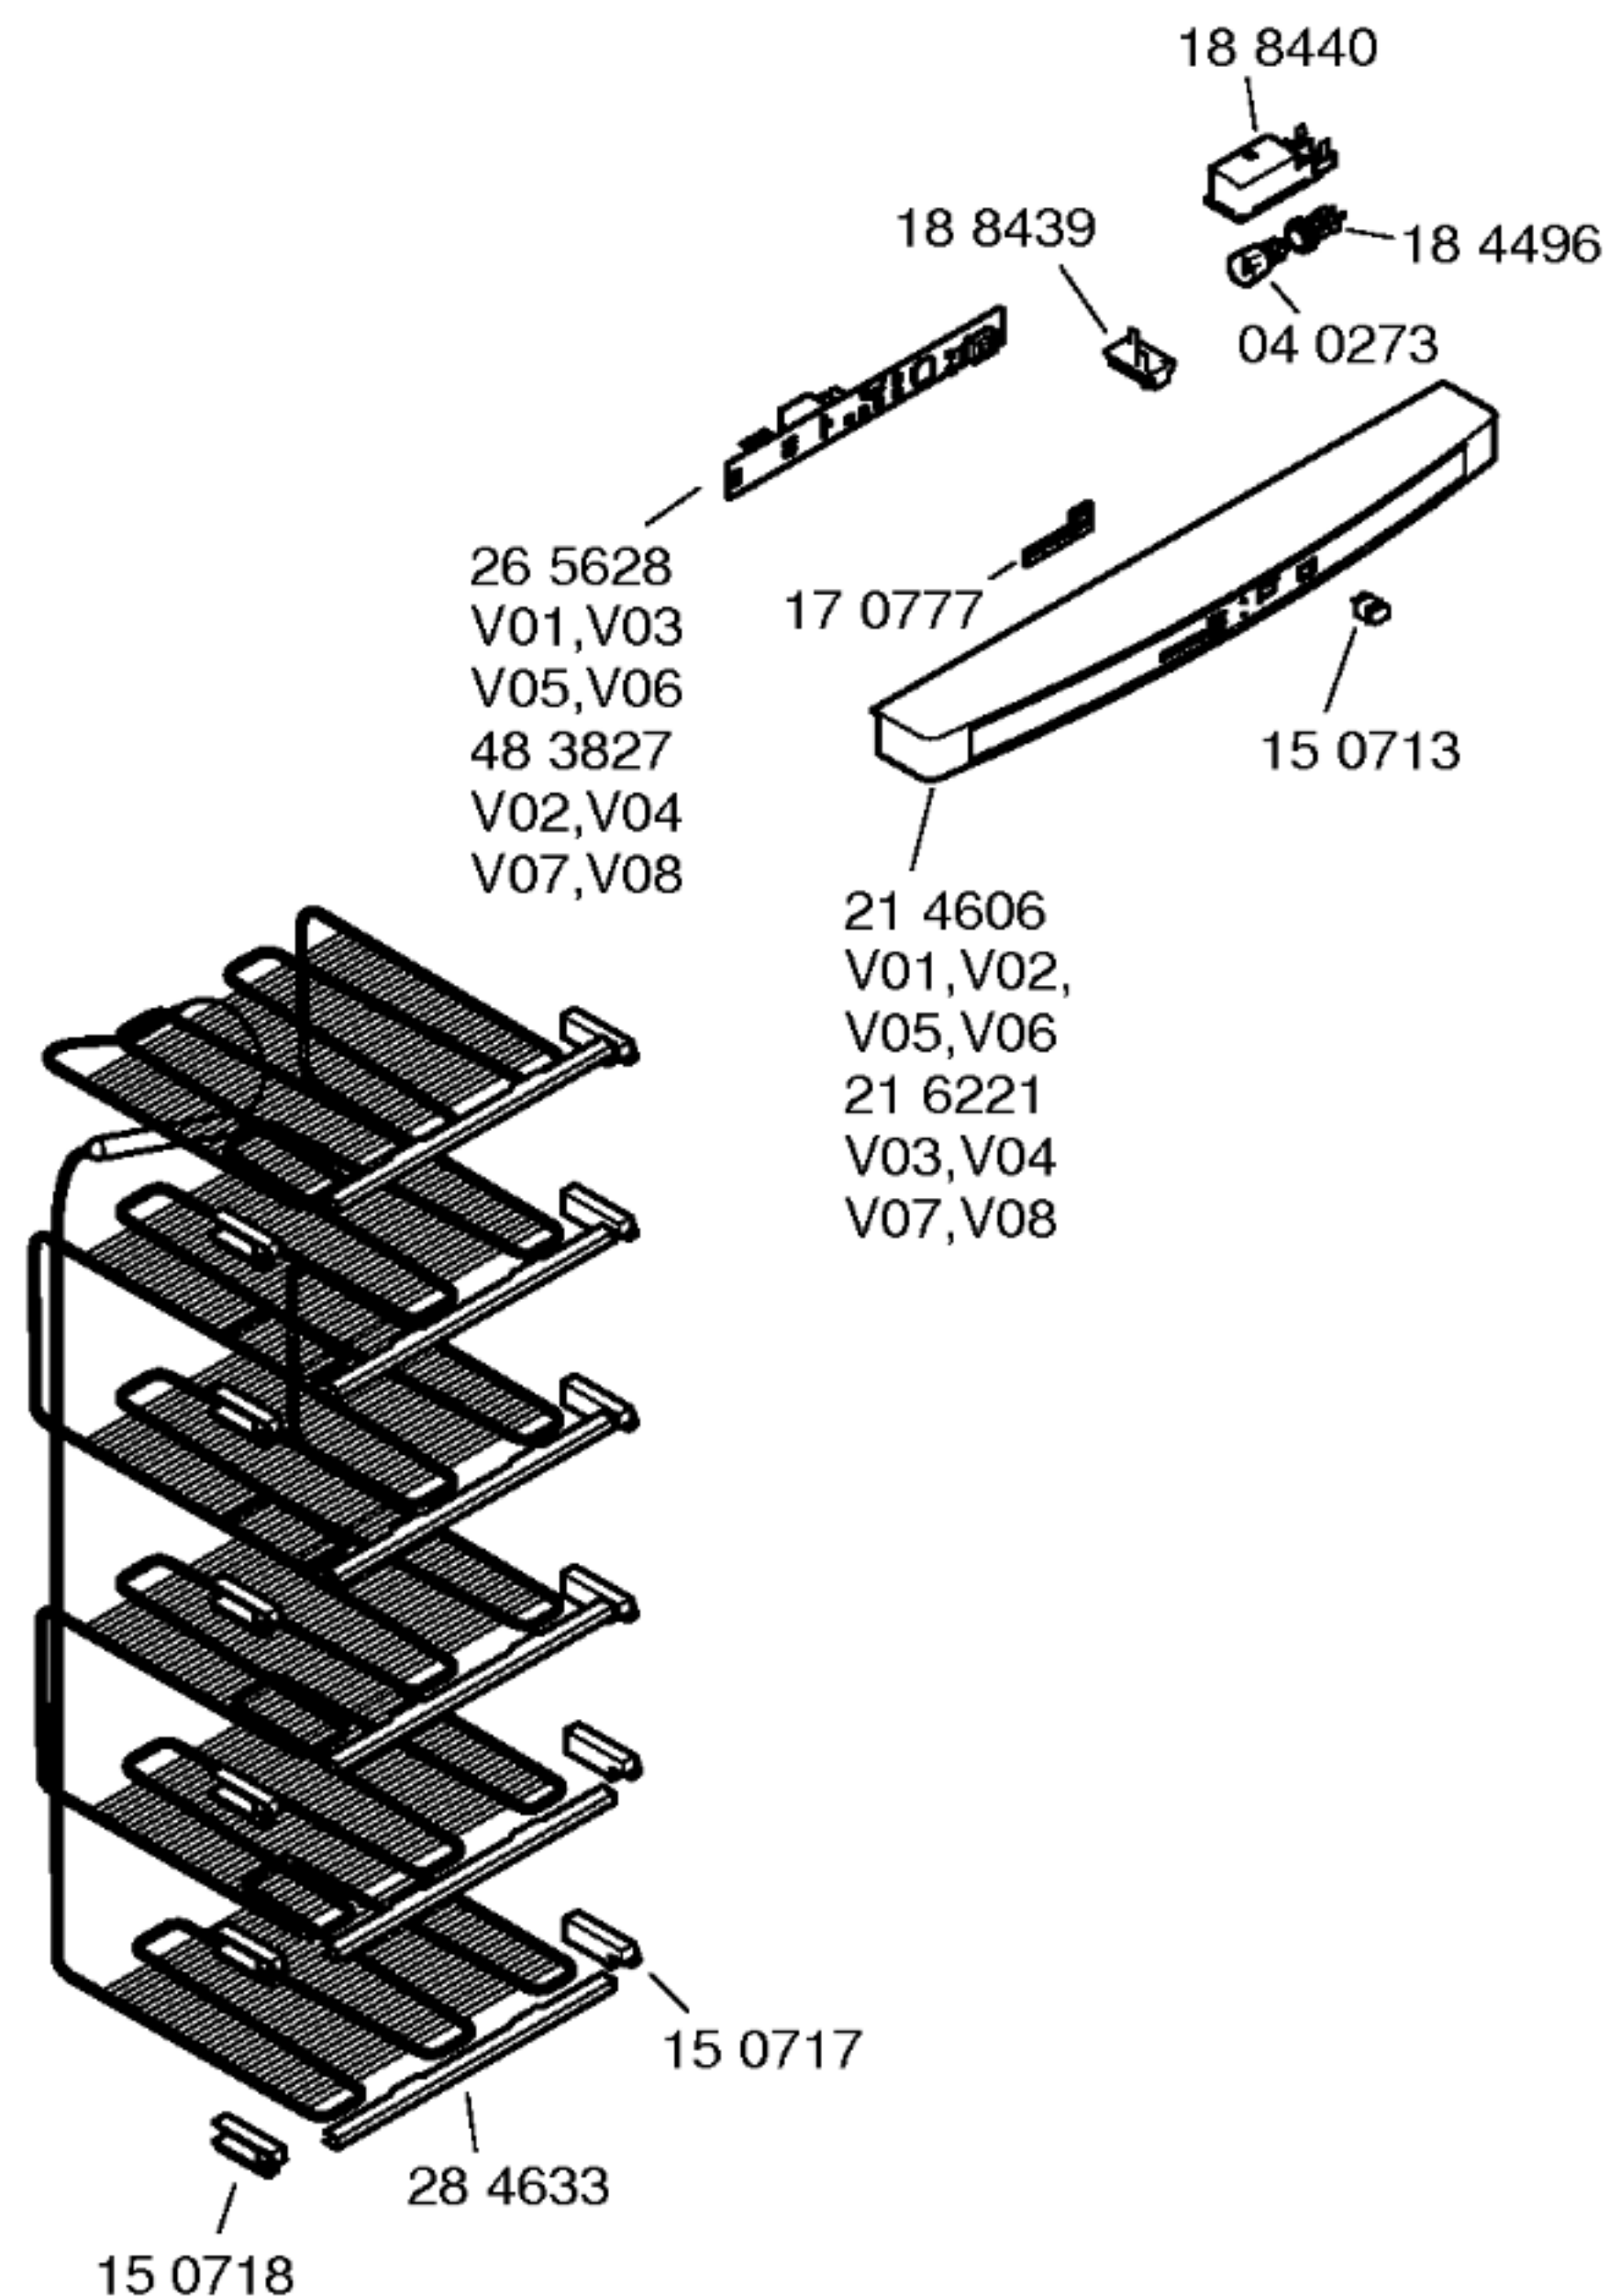


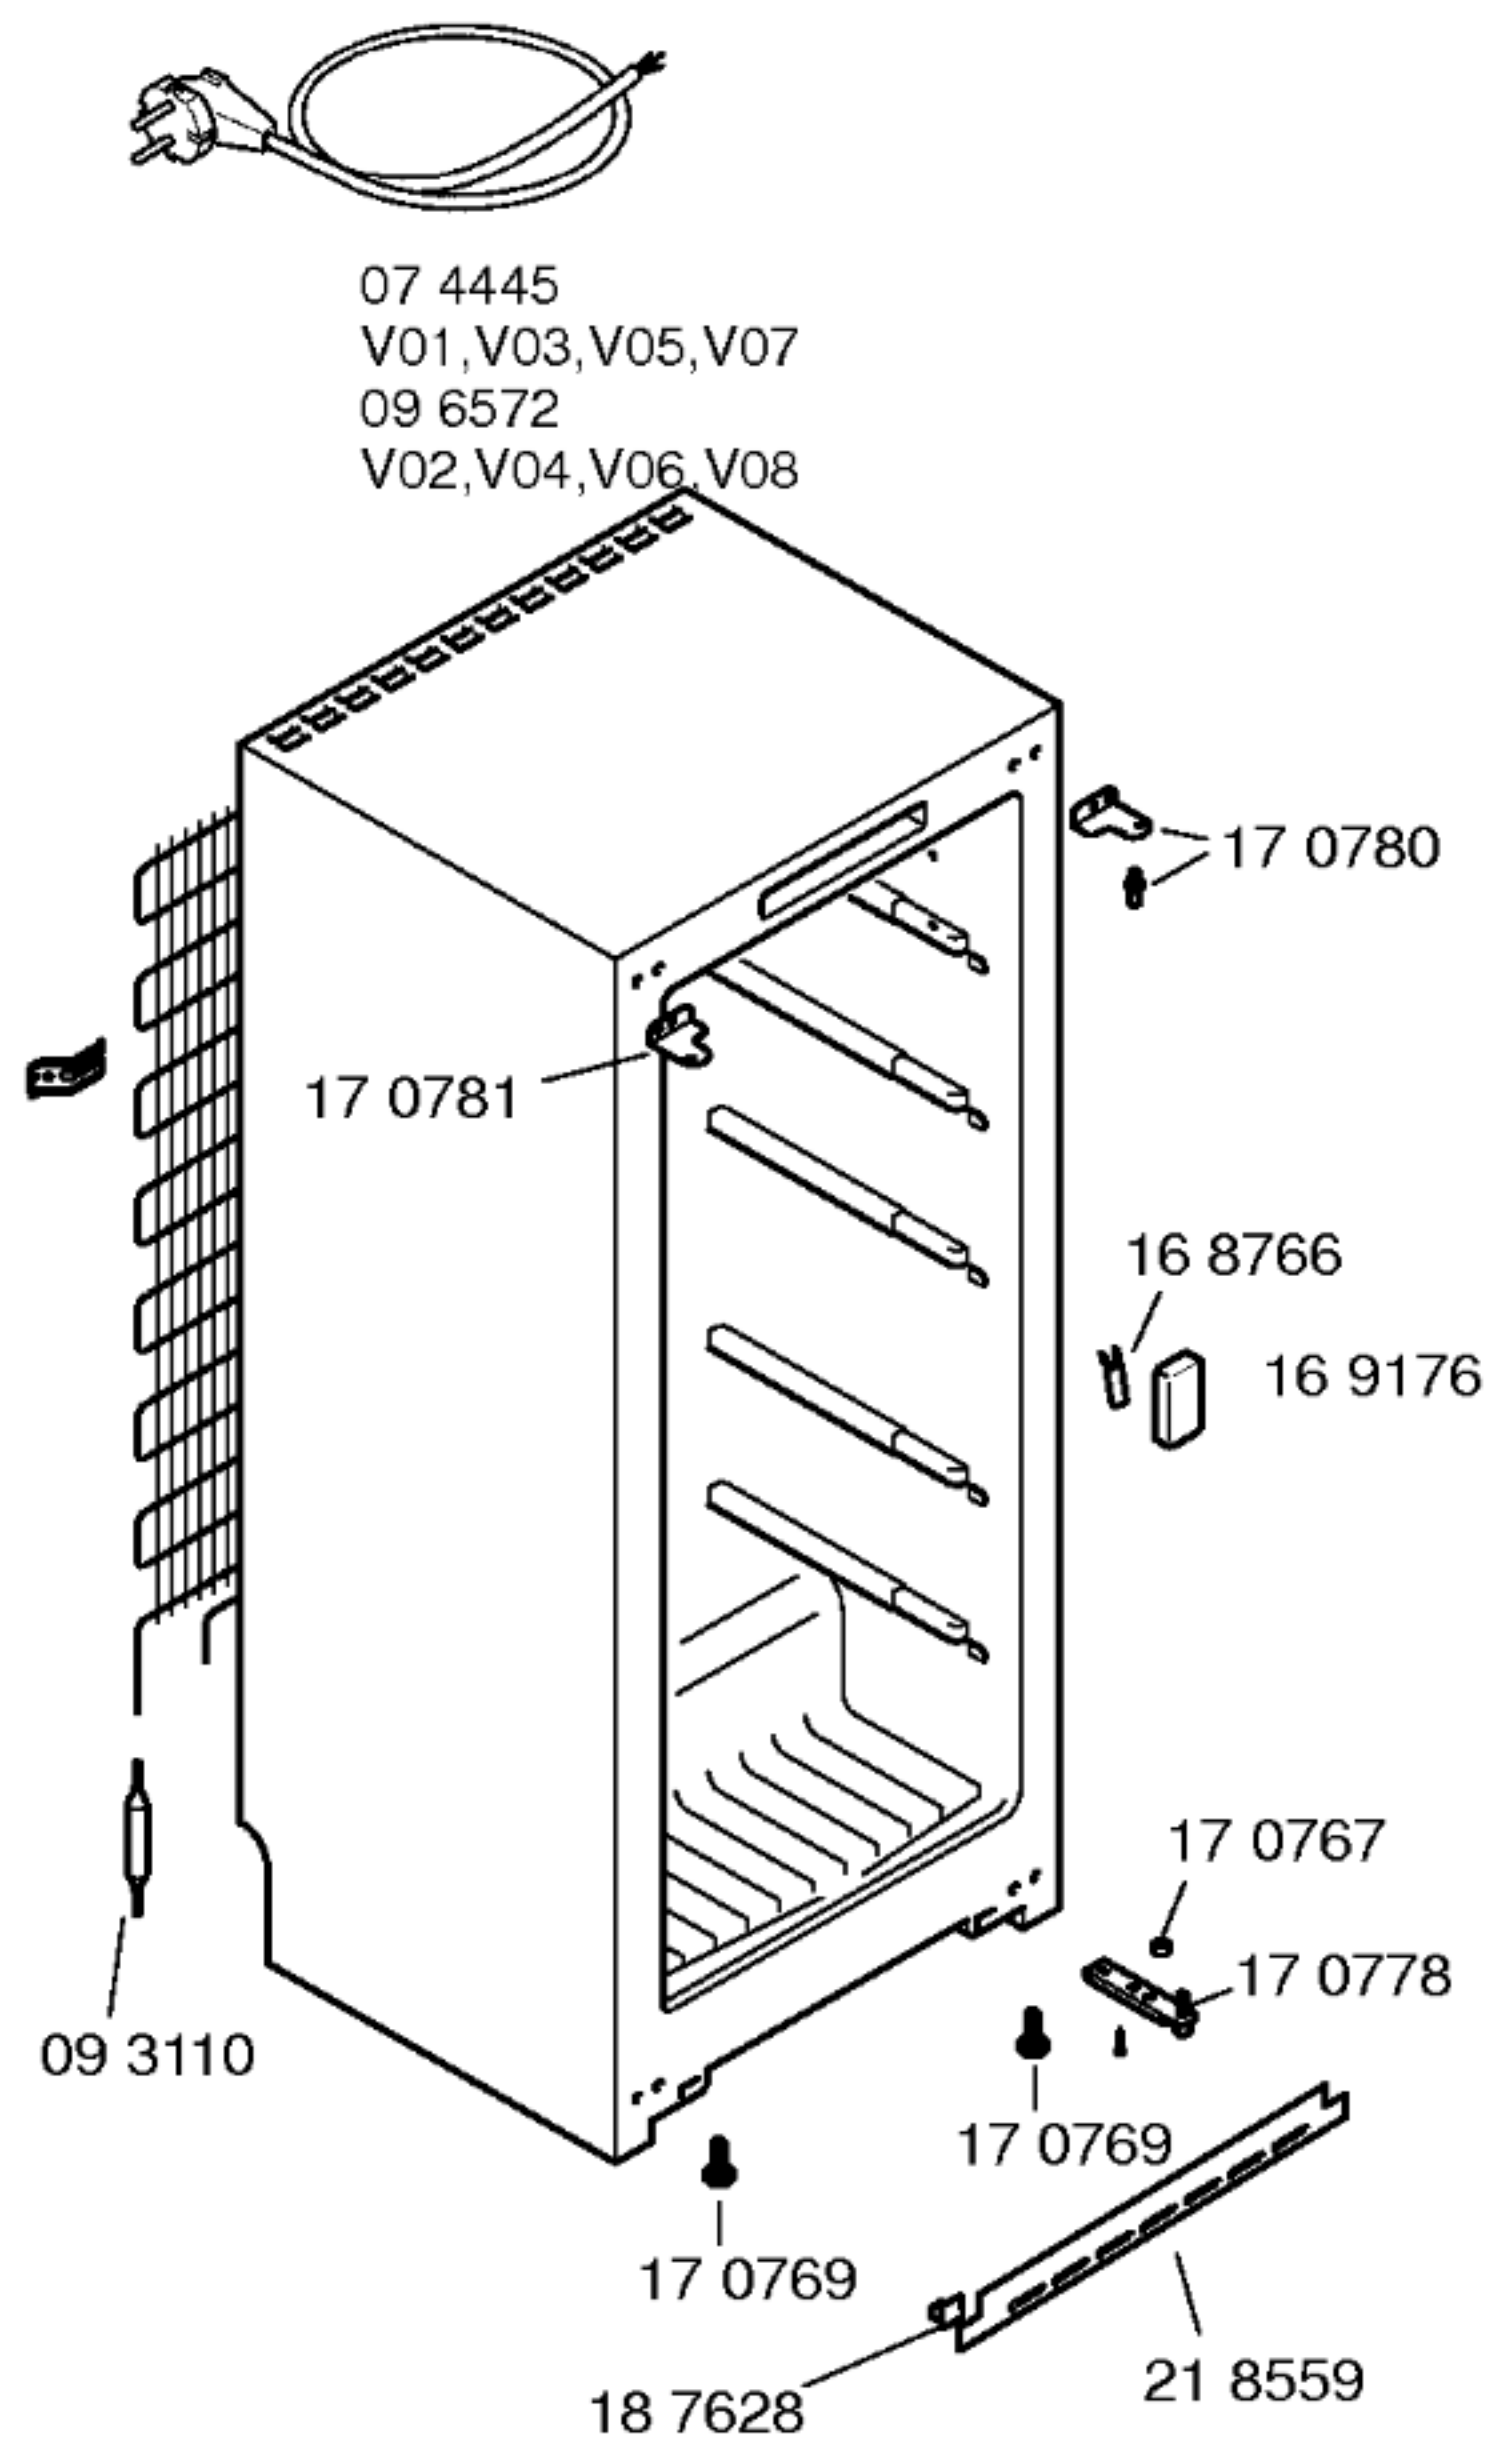

Gebrauchsanweisung
52 2791




V01, V02, V05, V06
(DE, EN, FR, IT, NL)
58 4698
V03, V04, V07, V08
(DE, EN, FR, IT, NL, ES
PT)


58 4699
V03, V04, V07, V08
(DA, NO, FI, SE)

Montageanleitung
52 2772
(D, GB, F, I, NL, DK, N, SF,
SE, TR)

Beistellsatz
26 5629

Side by Side
Beistellsatz zu KSR/KSK
48 1044

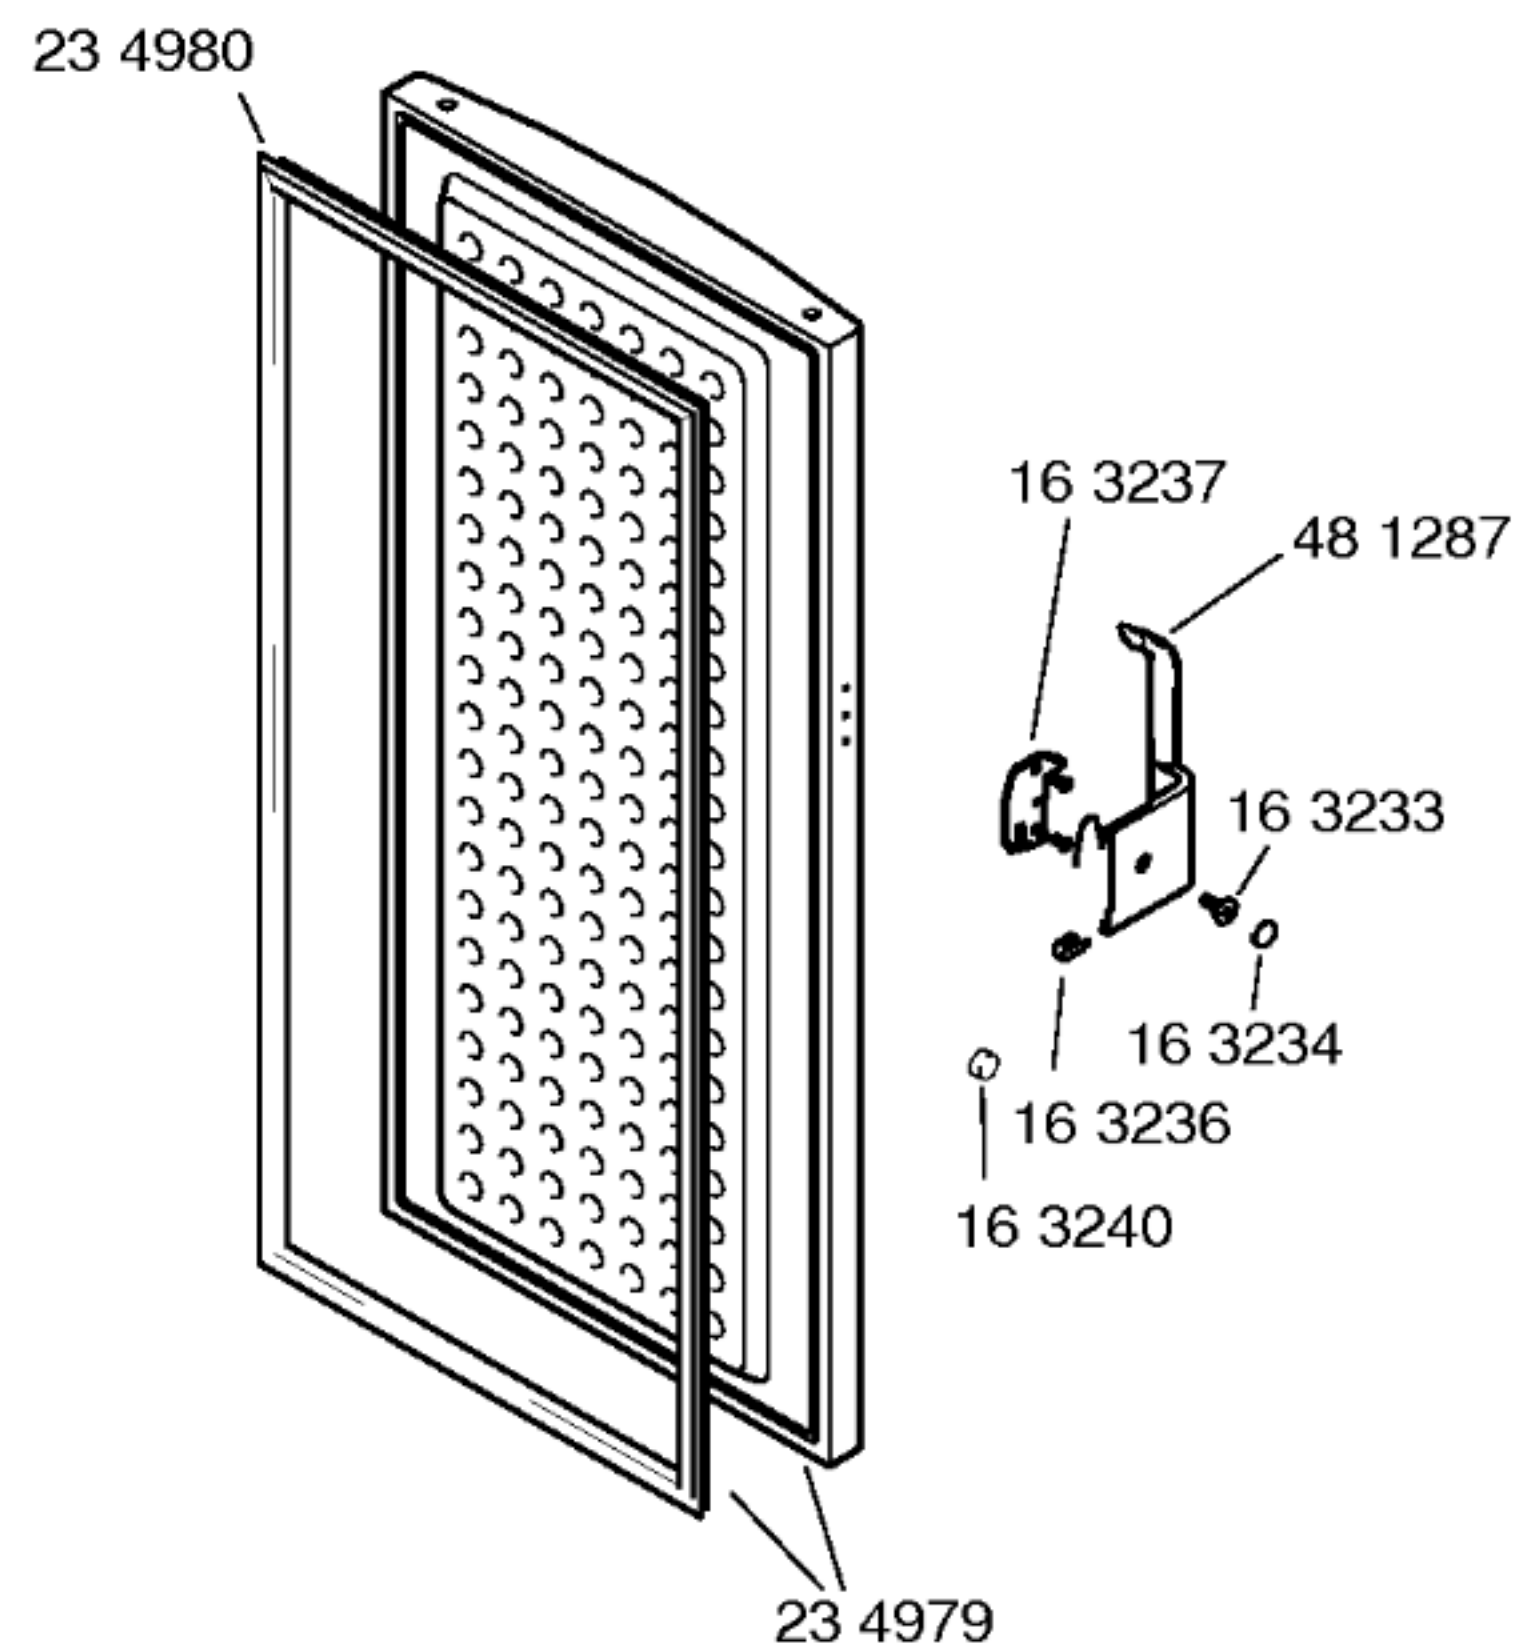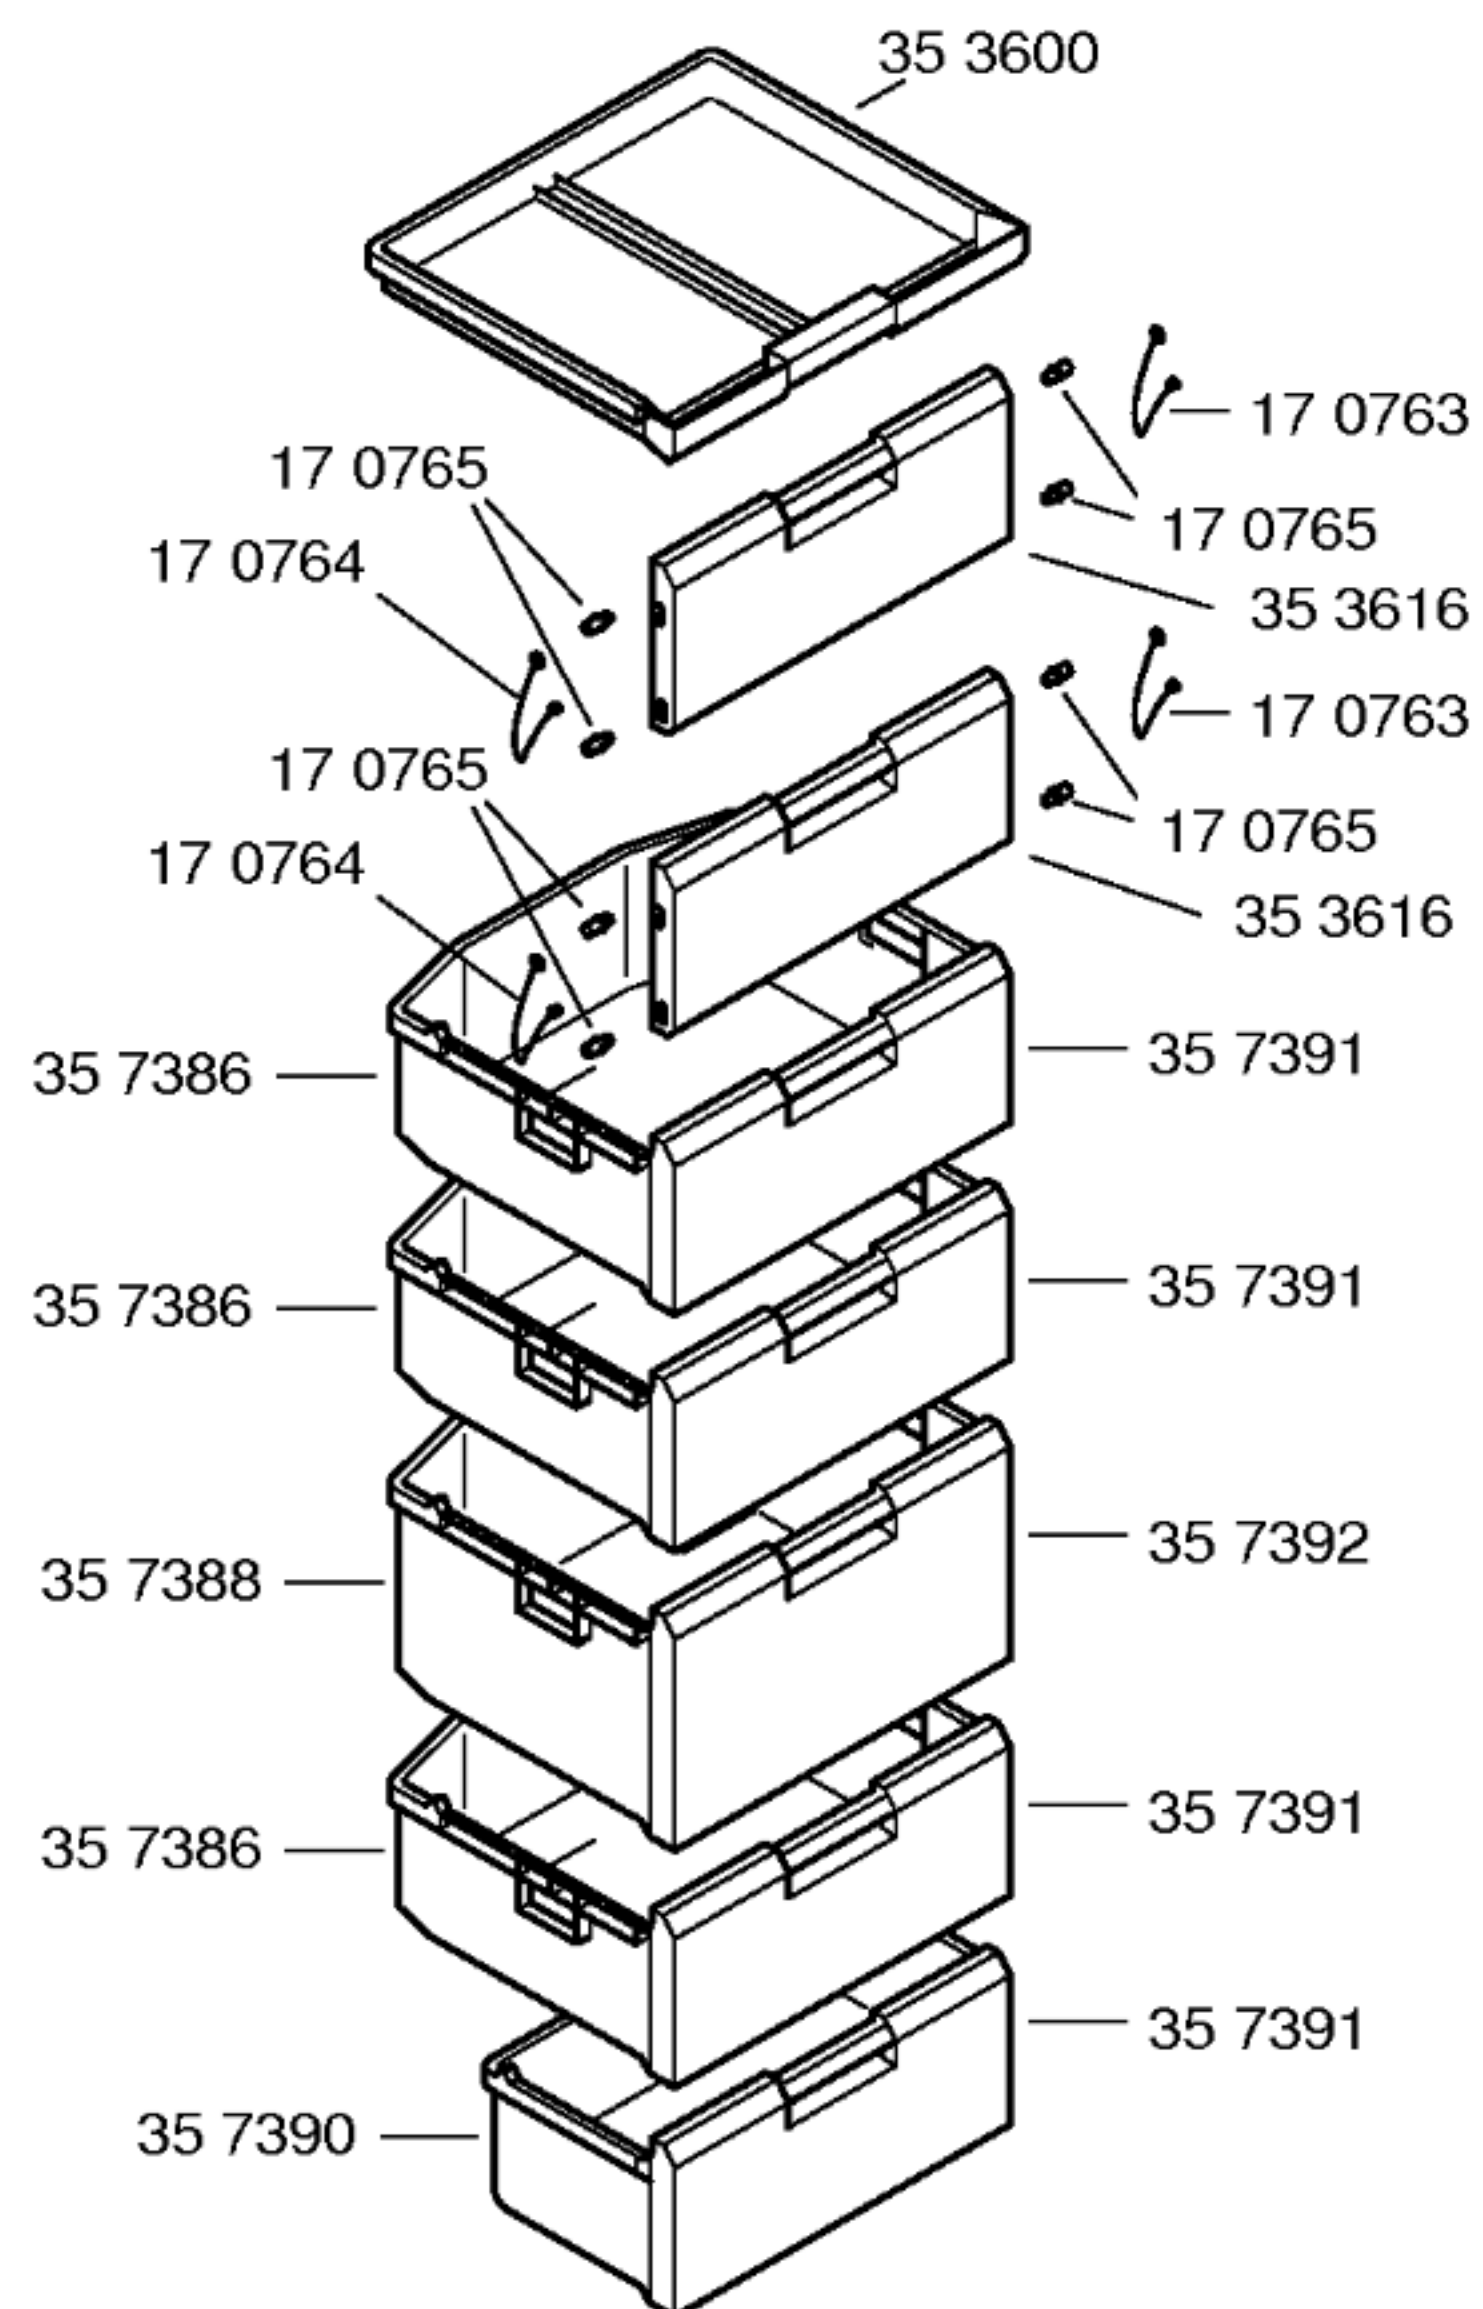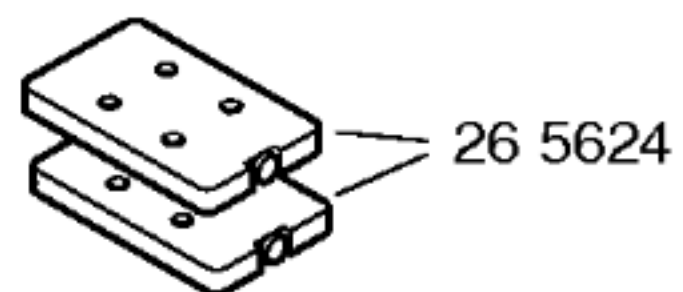

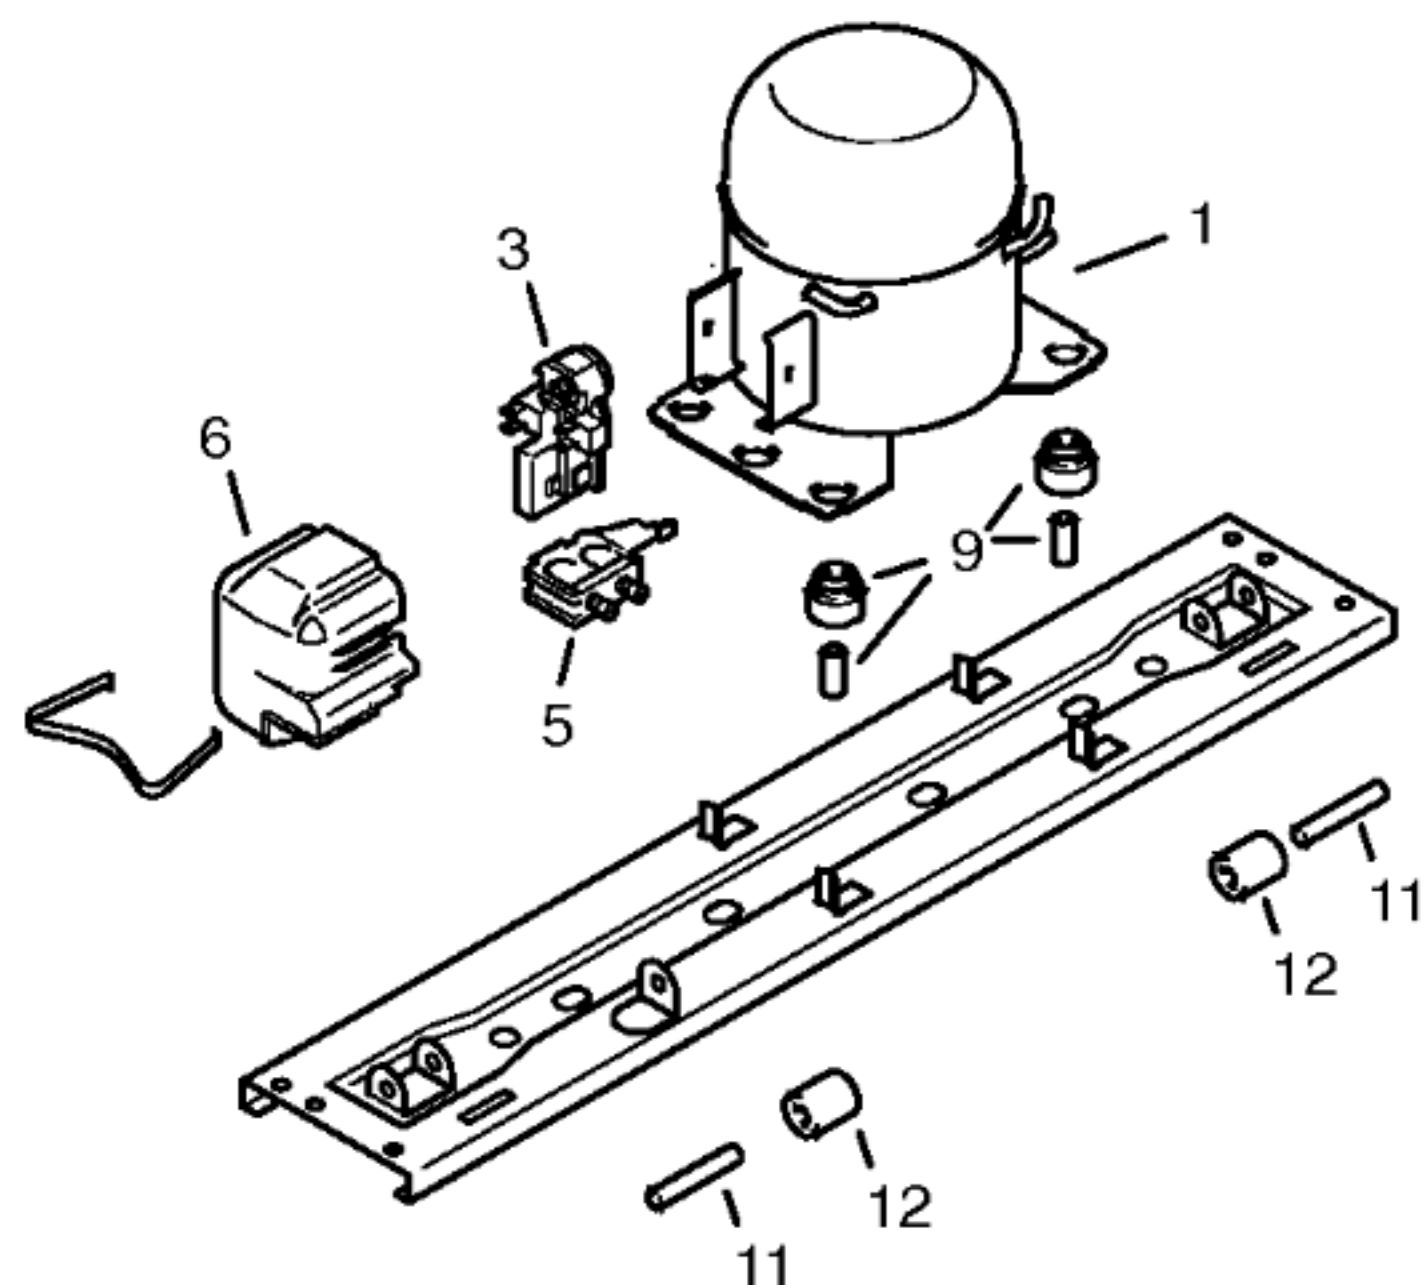

Pos.	V01,V02V05,V06	V03,V04,V07,V08	
	Matsushita	Matsushita	
	DC 125 E	DG 110E	
1	14 2131	14 2190	
2			
3	17 2967	18 4235	
4			
5	16 2549	16 2549	
6	16 6782	16 6782	
7			
8	21 4604	21 4604	
9	05 0166	05 0166	
10			
11	01 9017	01 9017	
12	01 1916	01 1916	

TECHNISCHE DATEN / TECHNICAL DATA / DONNEES TECHNIQUES				
Verdichter/Compressor/Compresseur		Matsushita	Matsushita	
Typ/Type		DC 125 E	DG 110E	
Förderleistung/Delivery/Débit		l/h	2246	1955
Anlaufstrom/Starting current/Cour de démarrage		A	9,2	8,6
Widerstand/Resistance/Résistance Ha/main/prin		Ω	12,1	11,78
Hi/aux		Ω	13,8	14,58
Temp.-Regler/Thermostat				
Typ/Type				
Regelstellung/Position				
Schaltwerte/Switching values		"warm"		
Valeurs de commutation		"kalt"		
		"alarm"		
Füllmenge/Fill.quantity/Charge		R600a	*	
Anschlußwert/Conn.load/Puiss. connectée		W	120	119
Heizung/Heater/Chauffage				
Widerstand/Resistance/Résistance		Ω		
Leistung/Power/Puissance		W		
Ventilator/Blower/Ventilateur				
Widerstand/Resistance/Résistance		Ω		
NTC-Fühler / Sensor				
		°C	kΩ	°C
		+10	9,95 ±0,18	-18 43,31 ±1,10
		+5	12,70 ±0,18	-22 54,66 ±1,59
		0	16,33 ±0,16	-26 69,42 ±2,29
Magnetventil/Magnetic valve/Electrovanne				
Widerstand/Resistance/Résistance		Ω		
Spannung/Voltage/Tension		V		