


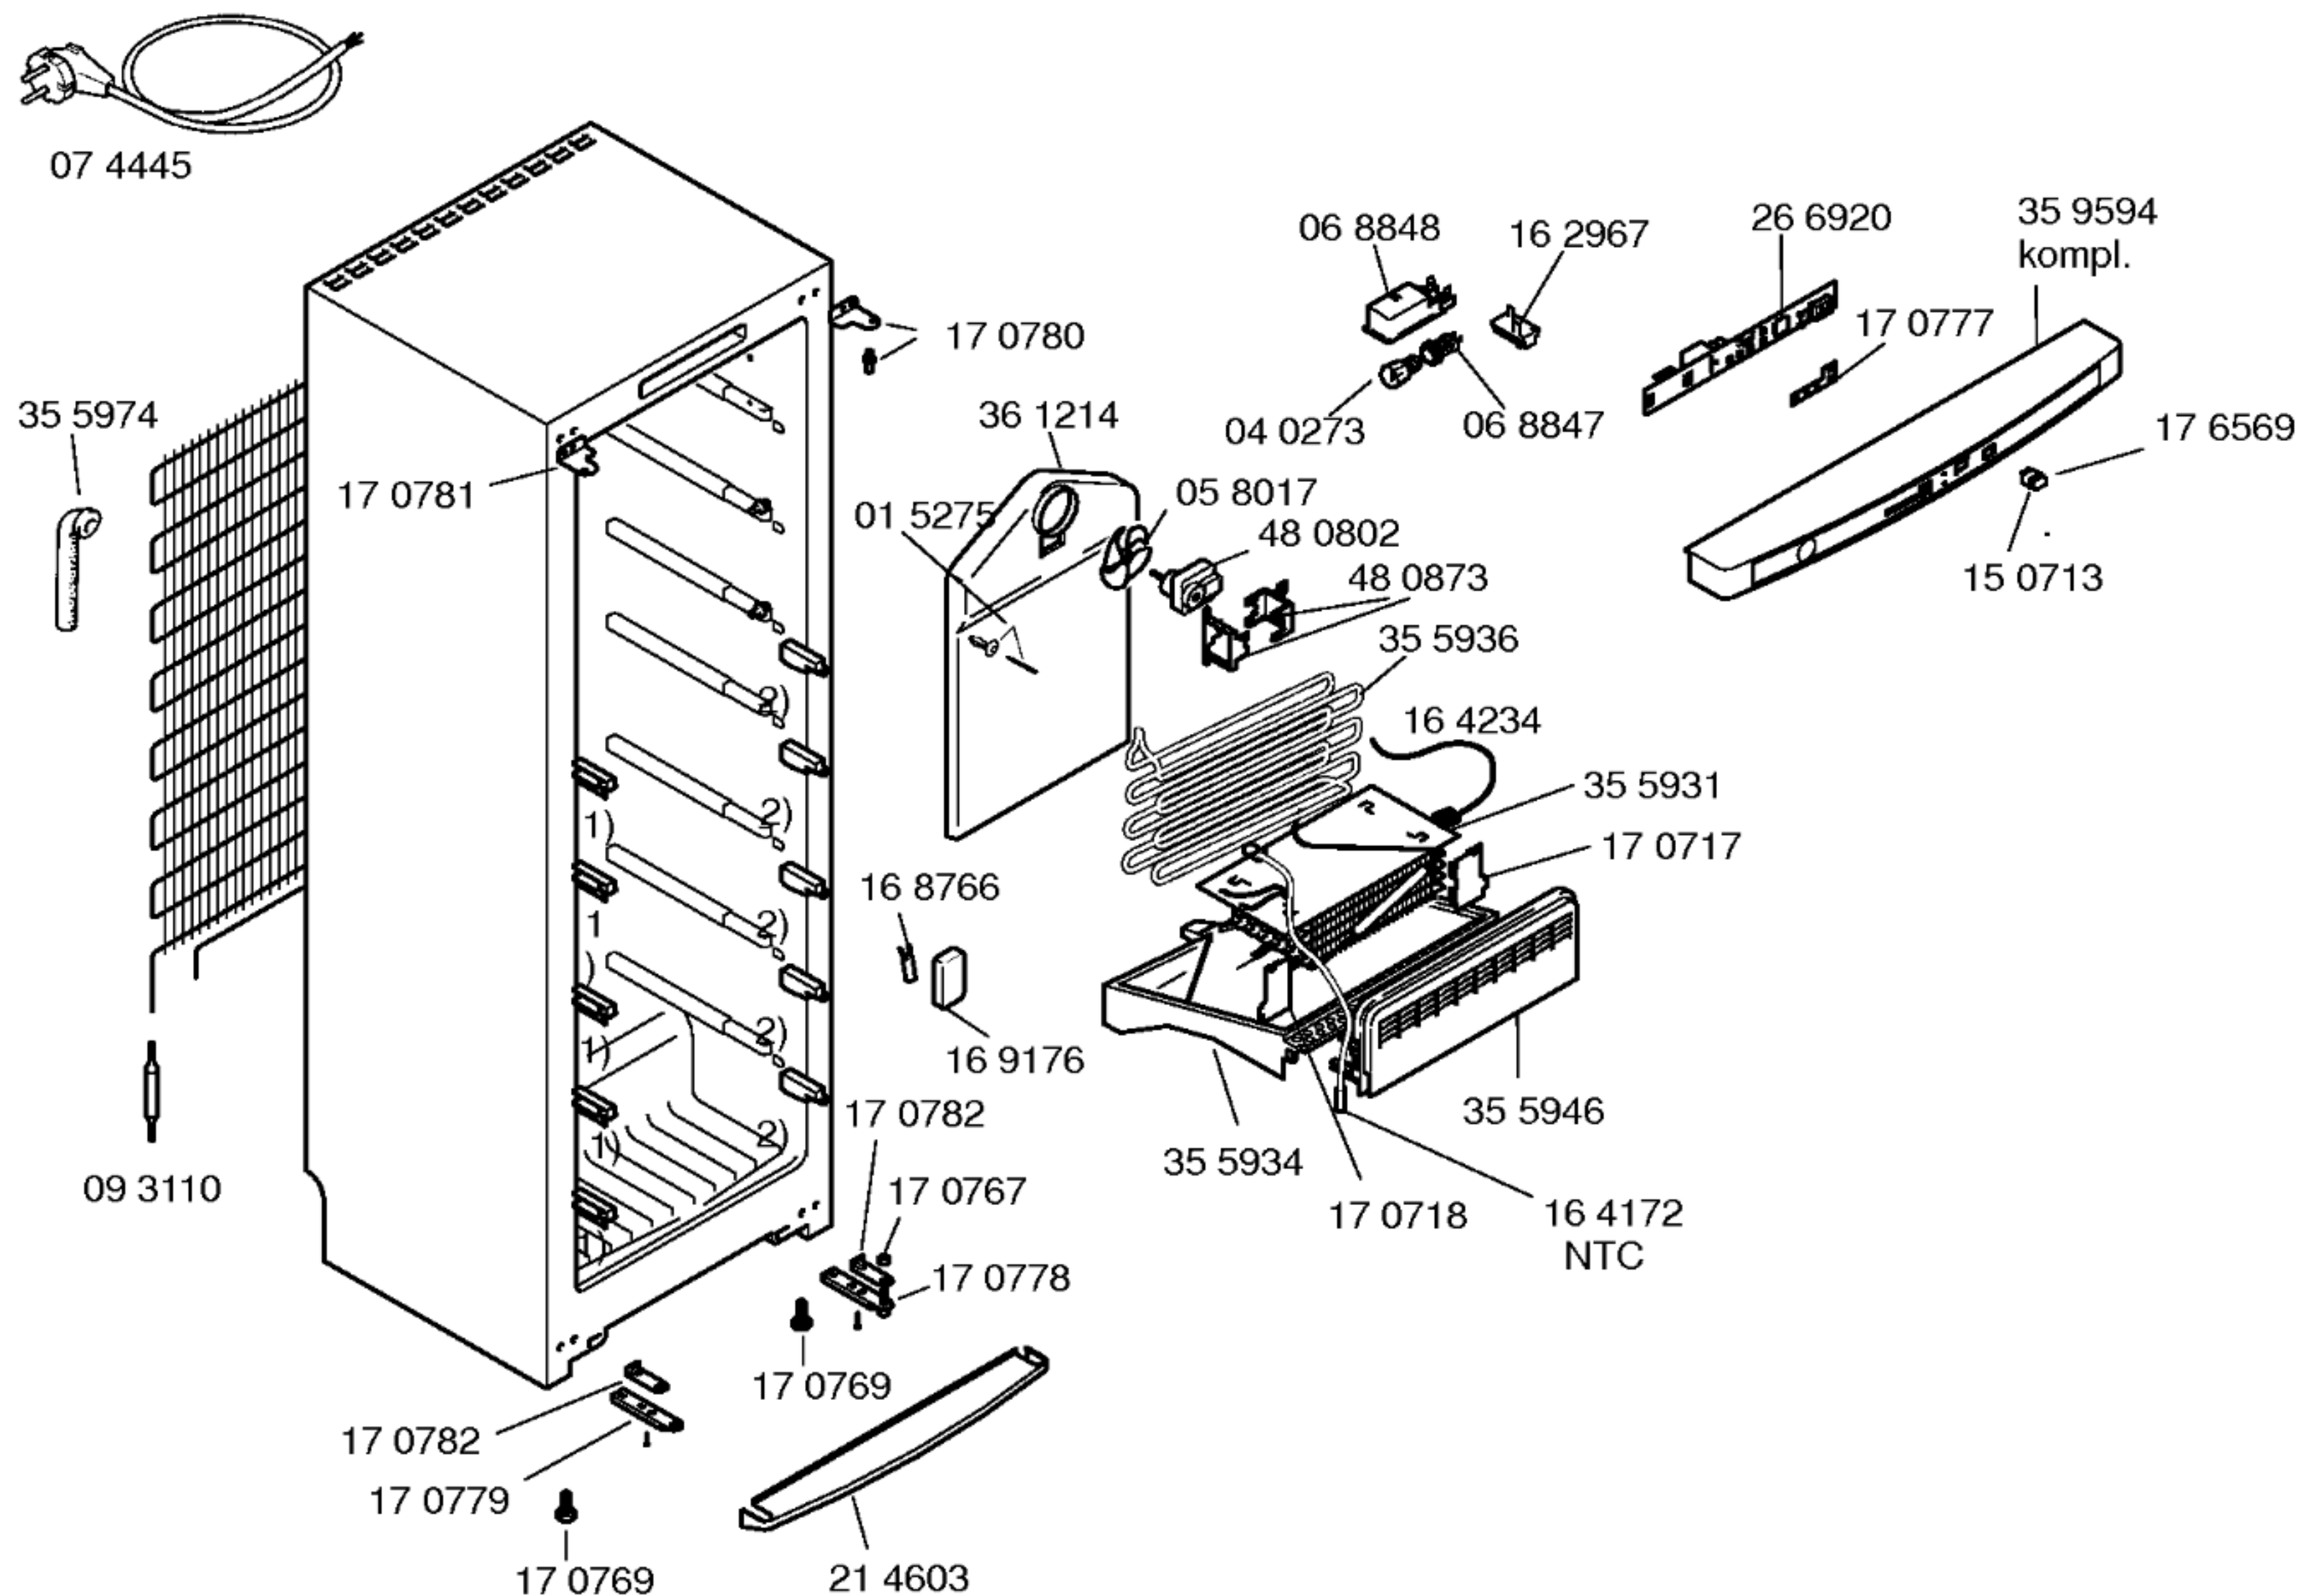

Mat. – Nr. – Konstante	
3740	

Gebrauchsanweisung

52 3813

(D,GB,F,I,NL,E,P)

Montageanleitung

52 2772

(D,GB,F,I,NL,DK,N

SF,S,E,P,TR,GR)

Beistellsatz

26 5629

V01,V02

26 9607

V03,V04

Side by Side

Beistellsatz zu KSR/KSK



48 1044


Gefrierraumteiler

35 3678

1) 17 1455

2) 17 1454

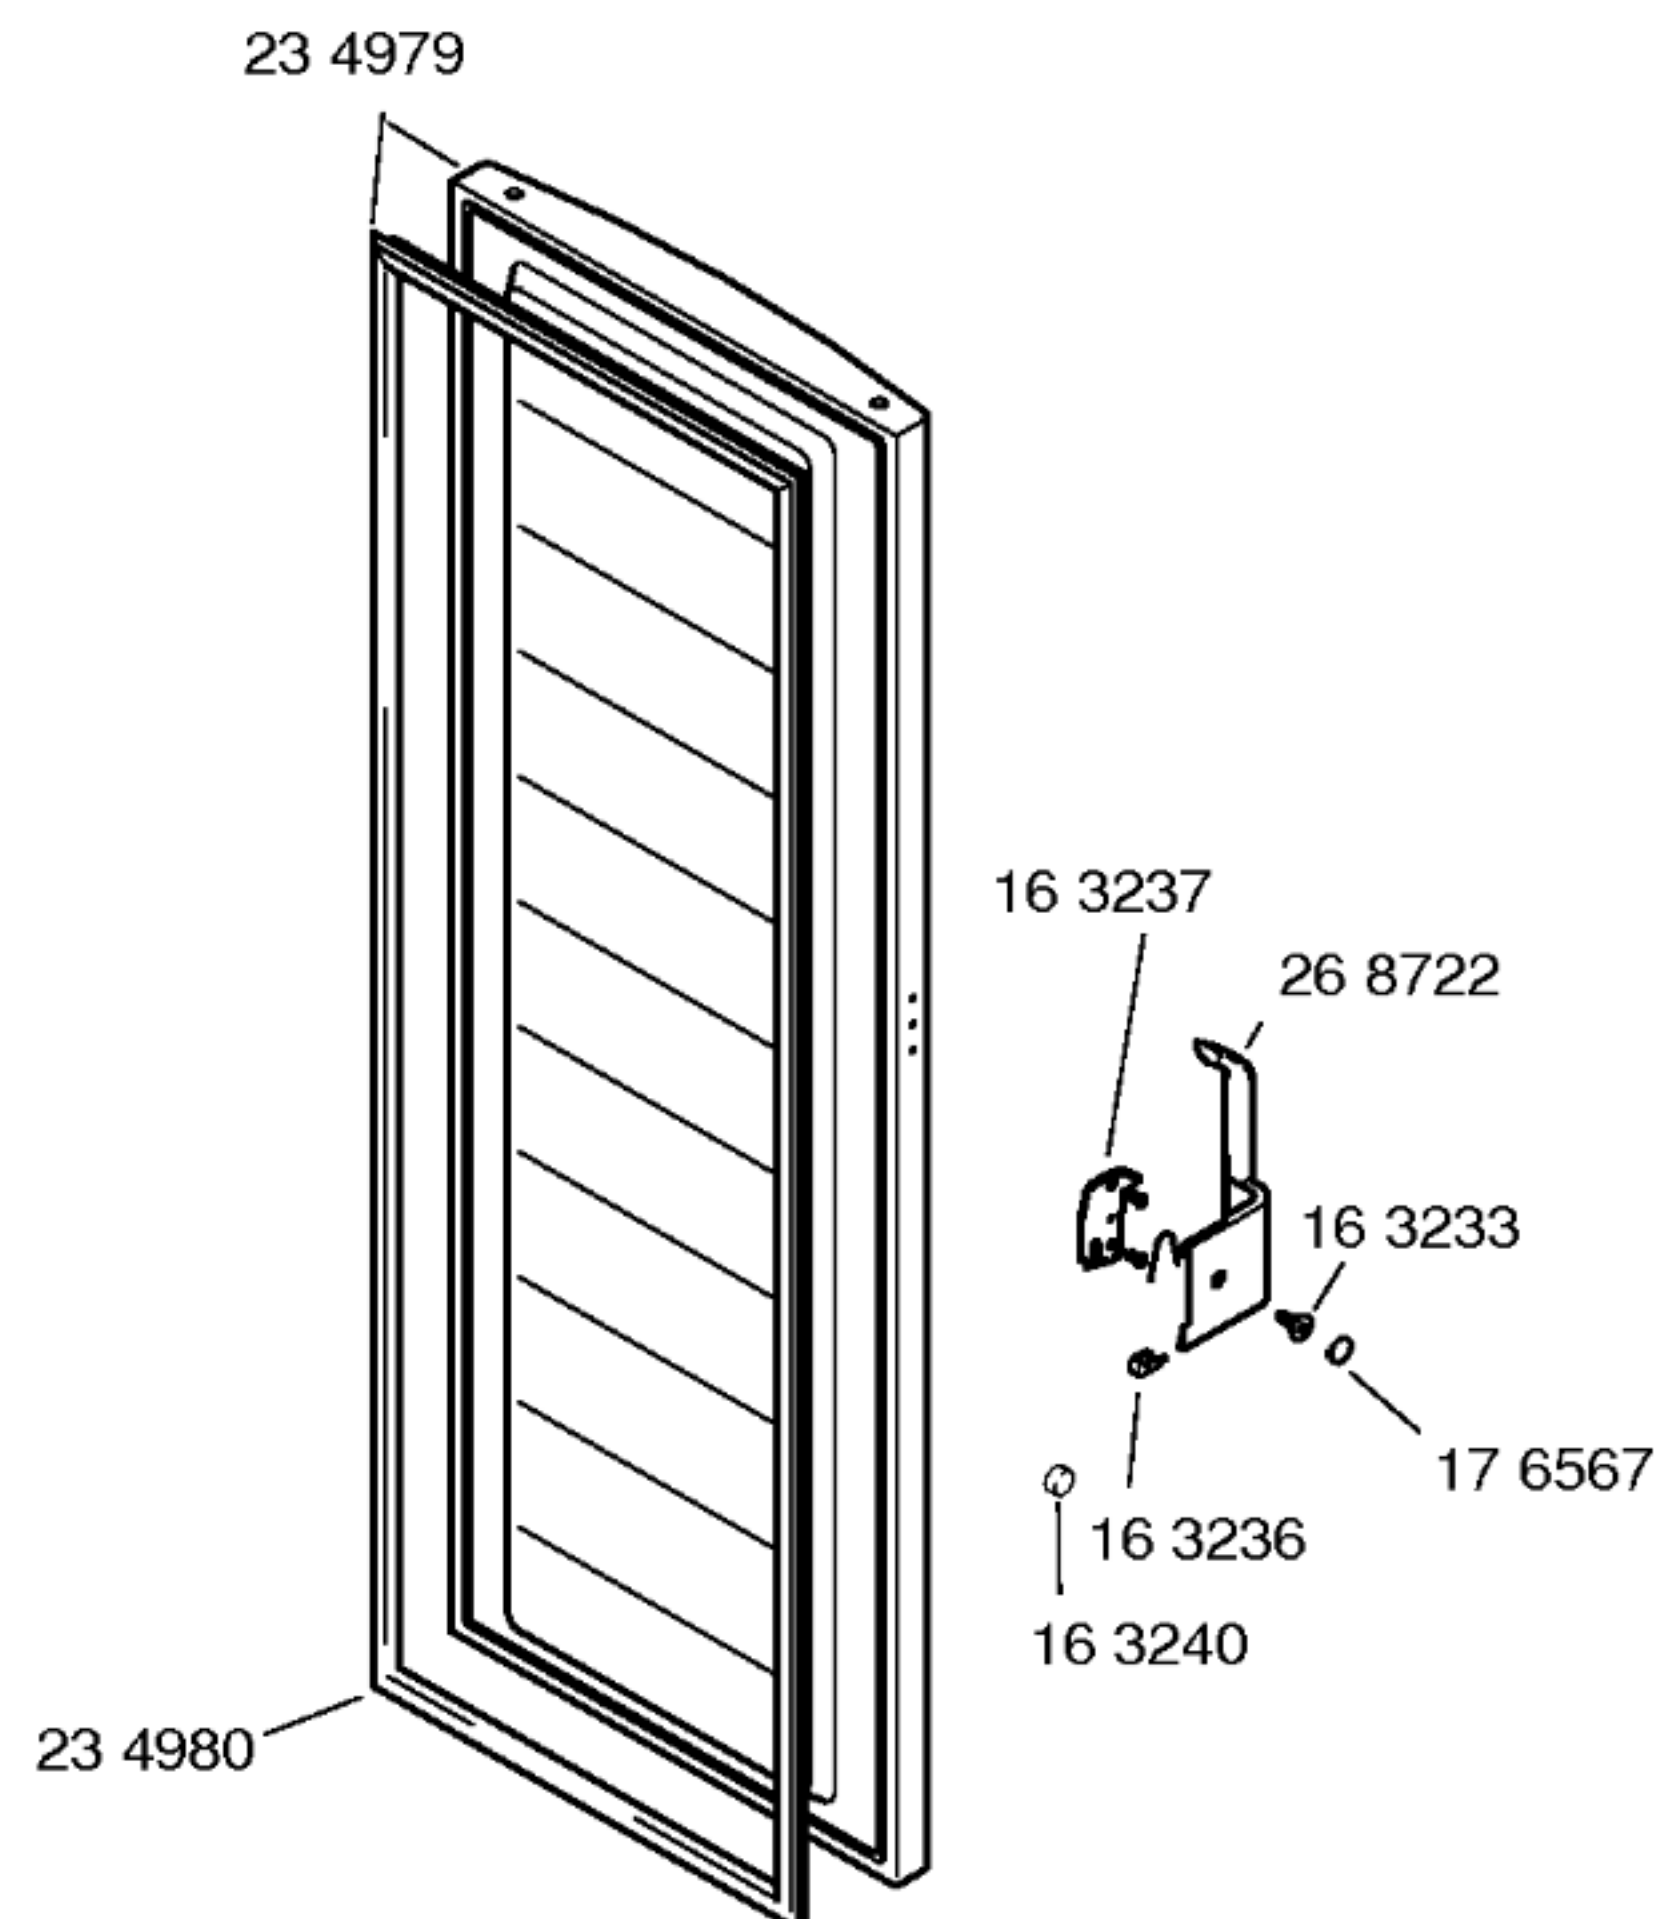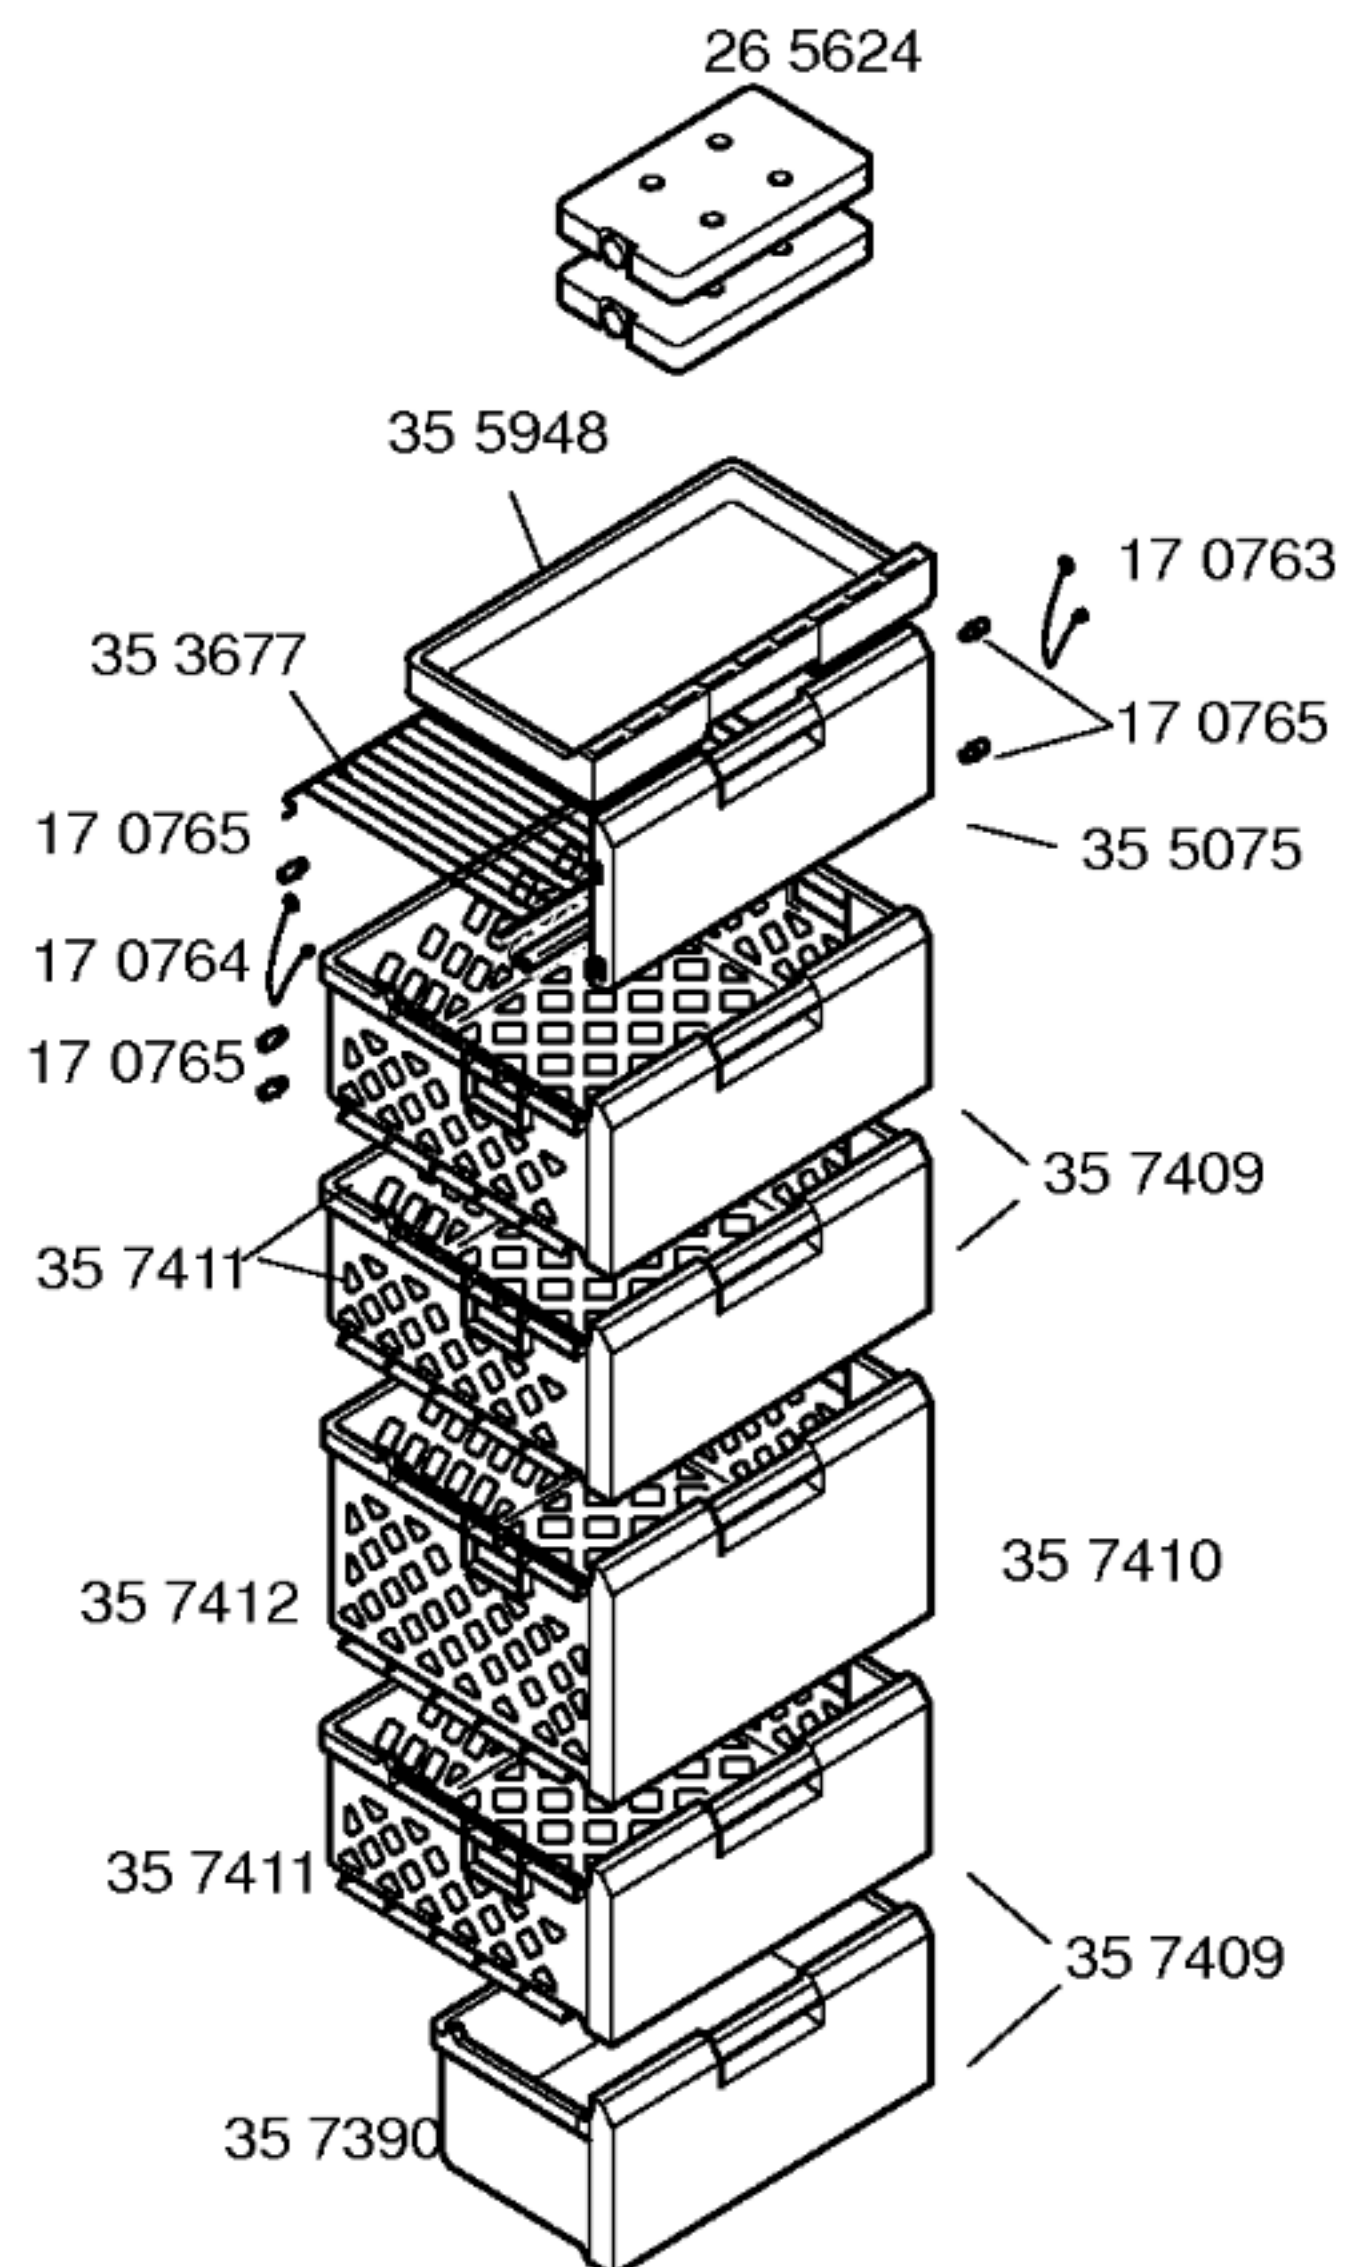

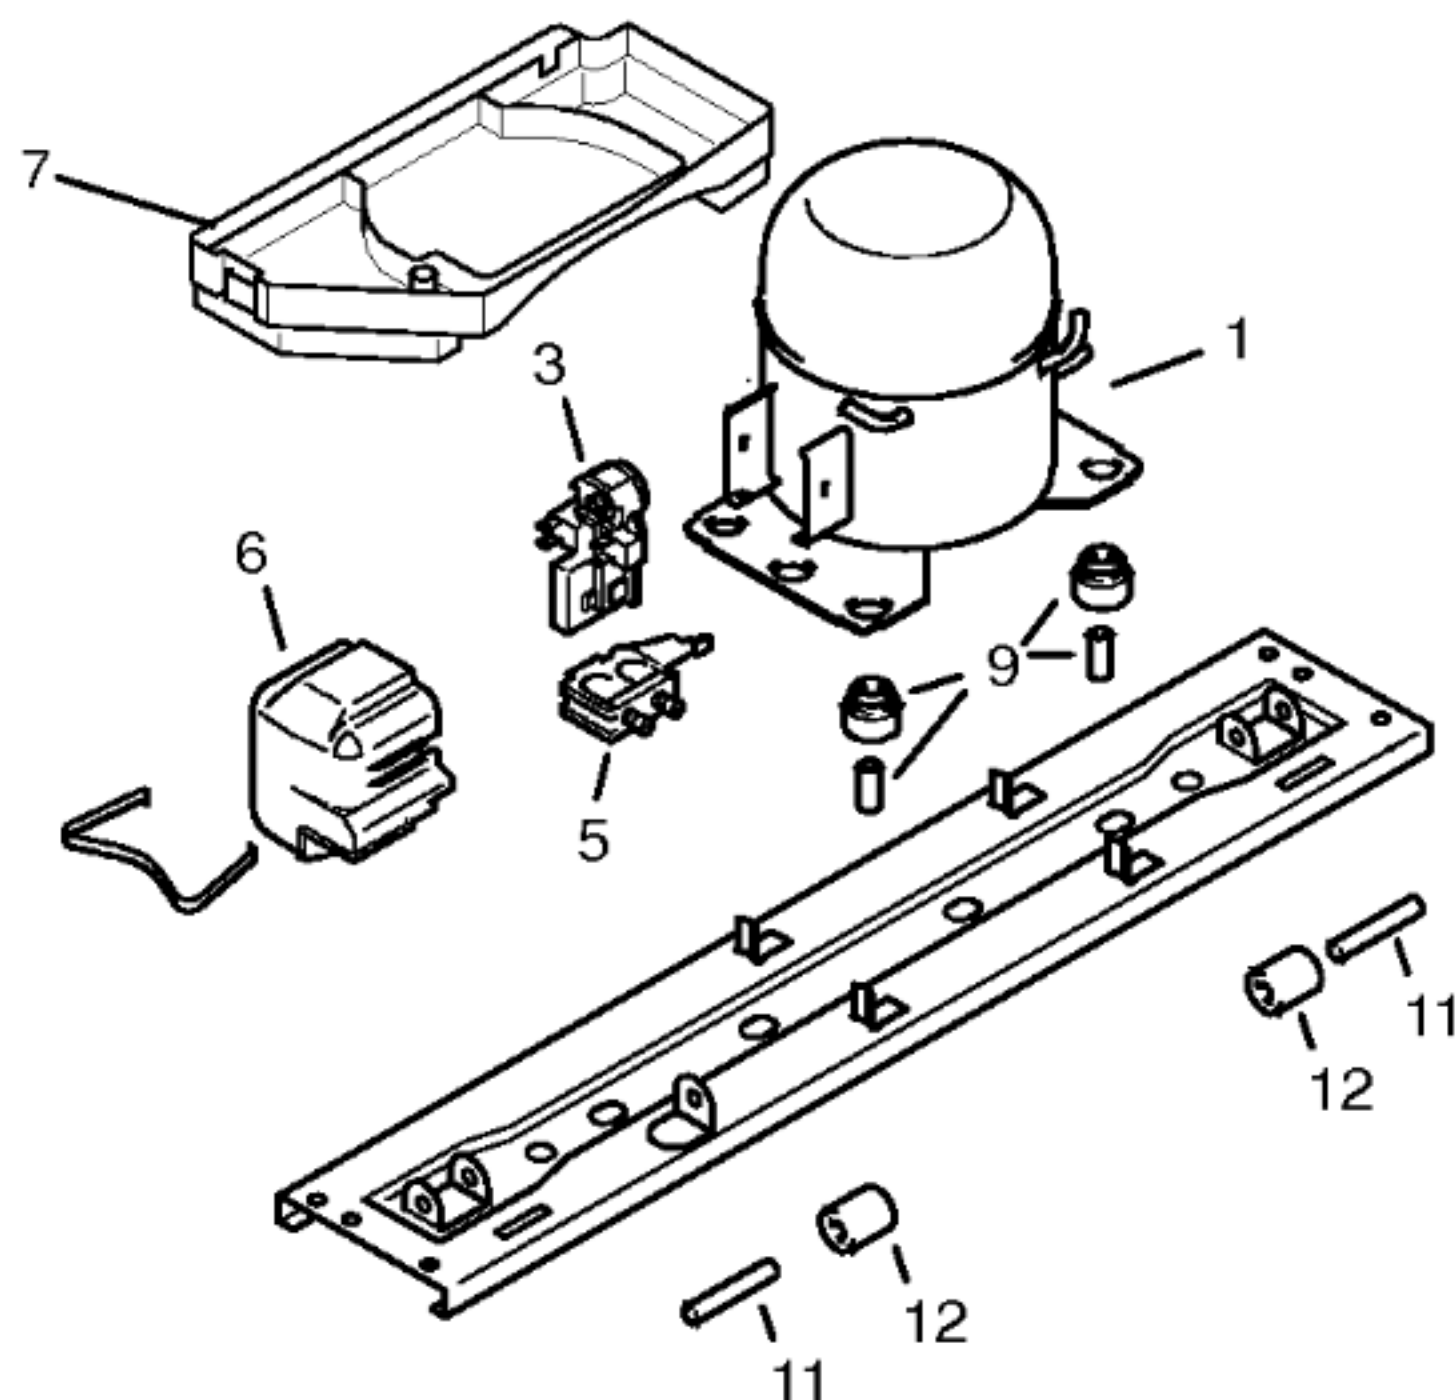

	V01		
	Matsushita		
Pos.	DC125E		
1	141965		
2			
3	17 2967		
4			
5	16 2549		
6	16 6782		
7	26 9945		
8			
9	05 0166		
10			
11	01 9017		
12	01 9016		

TECHNISCHE DATEN / TECHNICAL DATA / DONNEES TECHNIQUES					
Verdichter/Compressor/Compresseur		Matsushita			
Typ/Type		DC125E			
Förderleistung/Delivery/Débit		l/h	2246		
Anlaufstrom/Starting current/Cour de démarrage		A	9,2		
Widerstand/Resistance/Résistance		Ha/main/prin	Ω	12,1	
		Hi/aux	Ω	13,8	
Temp.-Regler/Thermostat		Elektronisch			
Typ/Type		EIN	AUS		
Regelstellung/Position		-15	-16		
Schaltwerte/Switching values		"warm"	-19	-20	
Valeurs de commutation		"kalt"	-23	-24	
		"alarm"	-9	-14	
Füllmenge/Fill.quantity/Charge		R600a	*	*	
Anschlußwert/Conn.load/Puiss. connectée		W	120		
Heizung/Heater/Chauffage		Abtauheizung		Rinnenheizung	
Widerstand/Resistance/Résistance		Ω	288	240	
Leistung/Power/Puissance		W	200	24	
Ventilator/Blower/Ventilateur					
Widerstand/Resistance/Résistance		Ω	560		
Raumtemperaturfühler		C	K	C	k
		+10	9,9	-18	43,3
		+5	12,7	-22	54,6
		+0	16,3	-26	69,4
Widerstand NTC-Fühler		°C	kΩ	°C	kΩ
		-1	17,3	-15	36,5
		-9	26,2	-16	38,8
		-14	34,5	-19	45,9
Magnetventil/Magnetic valve/Electrovanne					
		Widerstand/Resistance/Résistance	Ω		
Spannung/Voltage/Tension		V			

* siehe Typenschild