
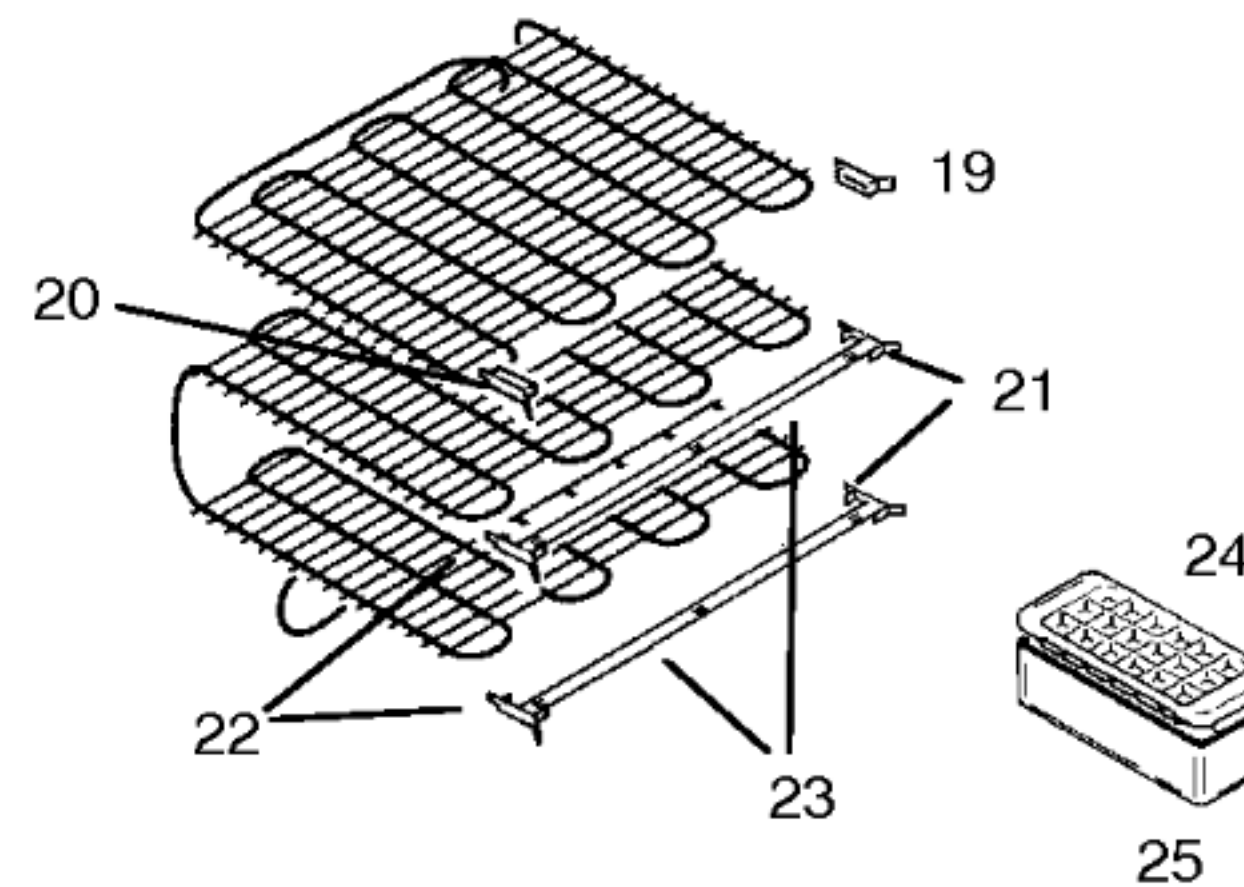
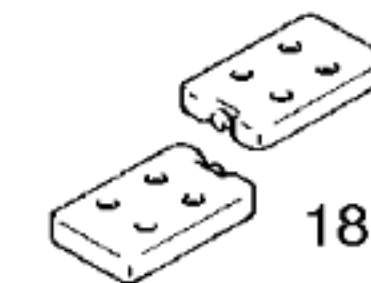
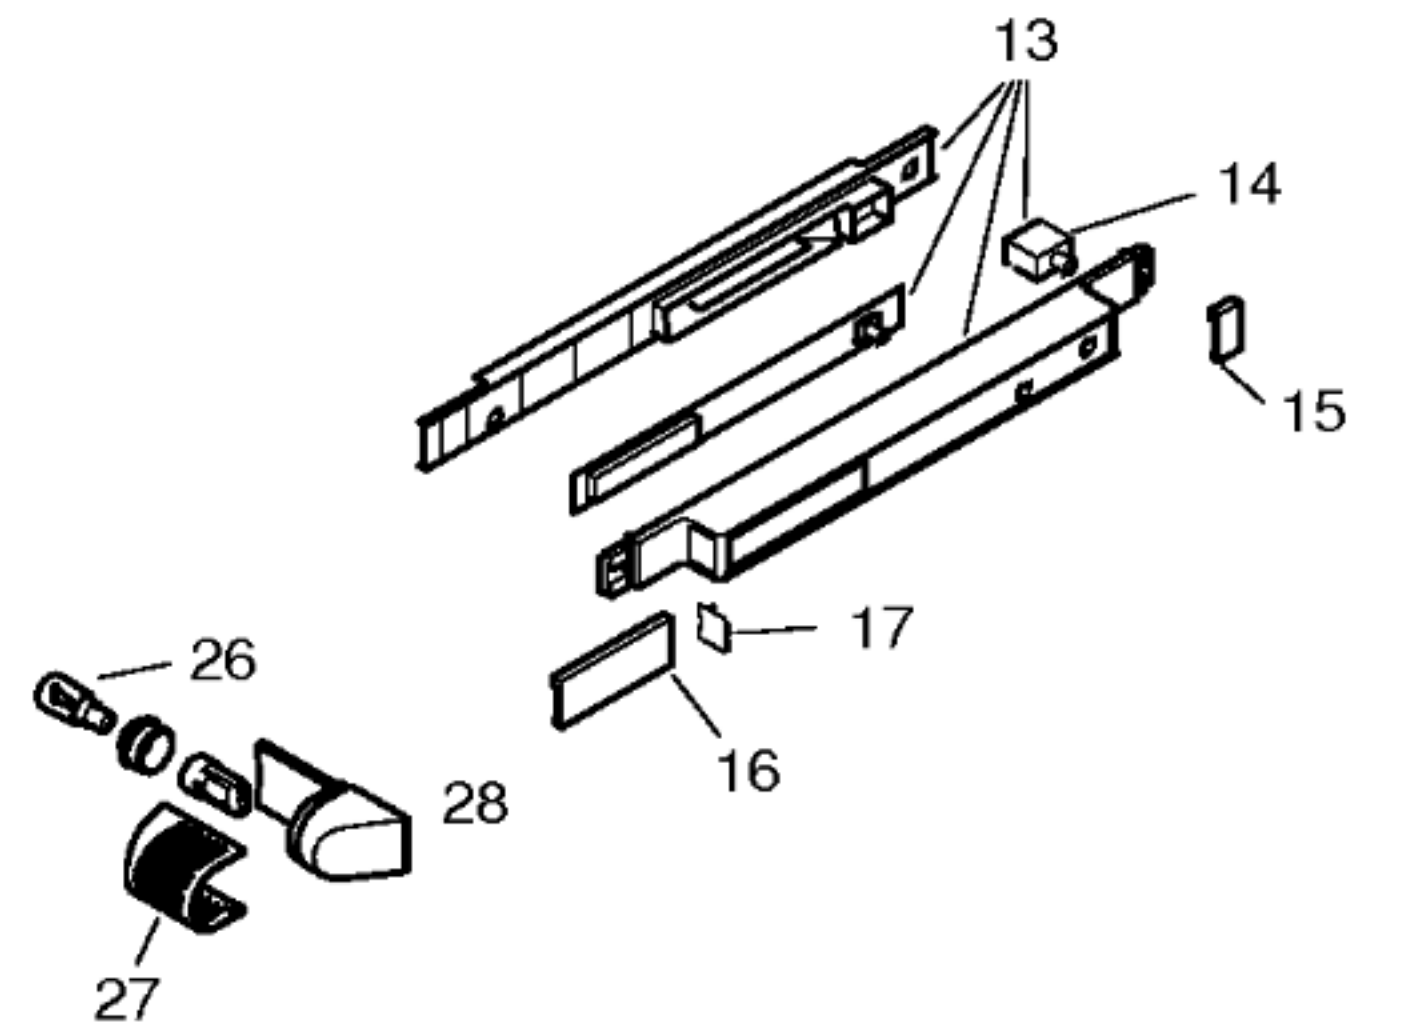


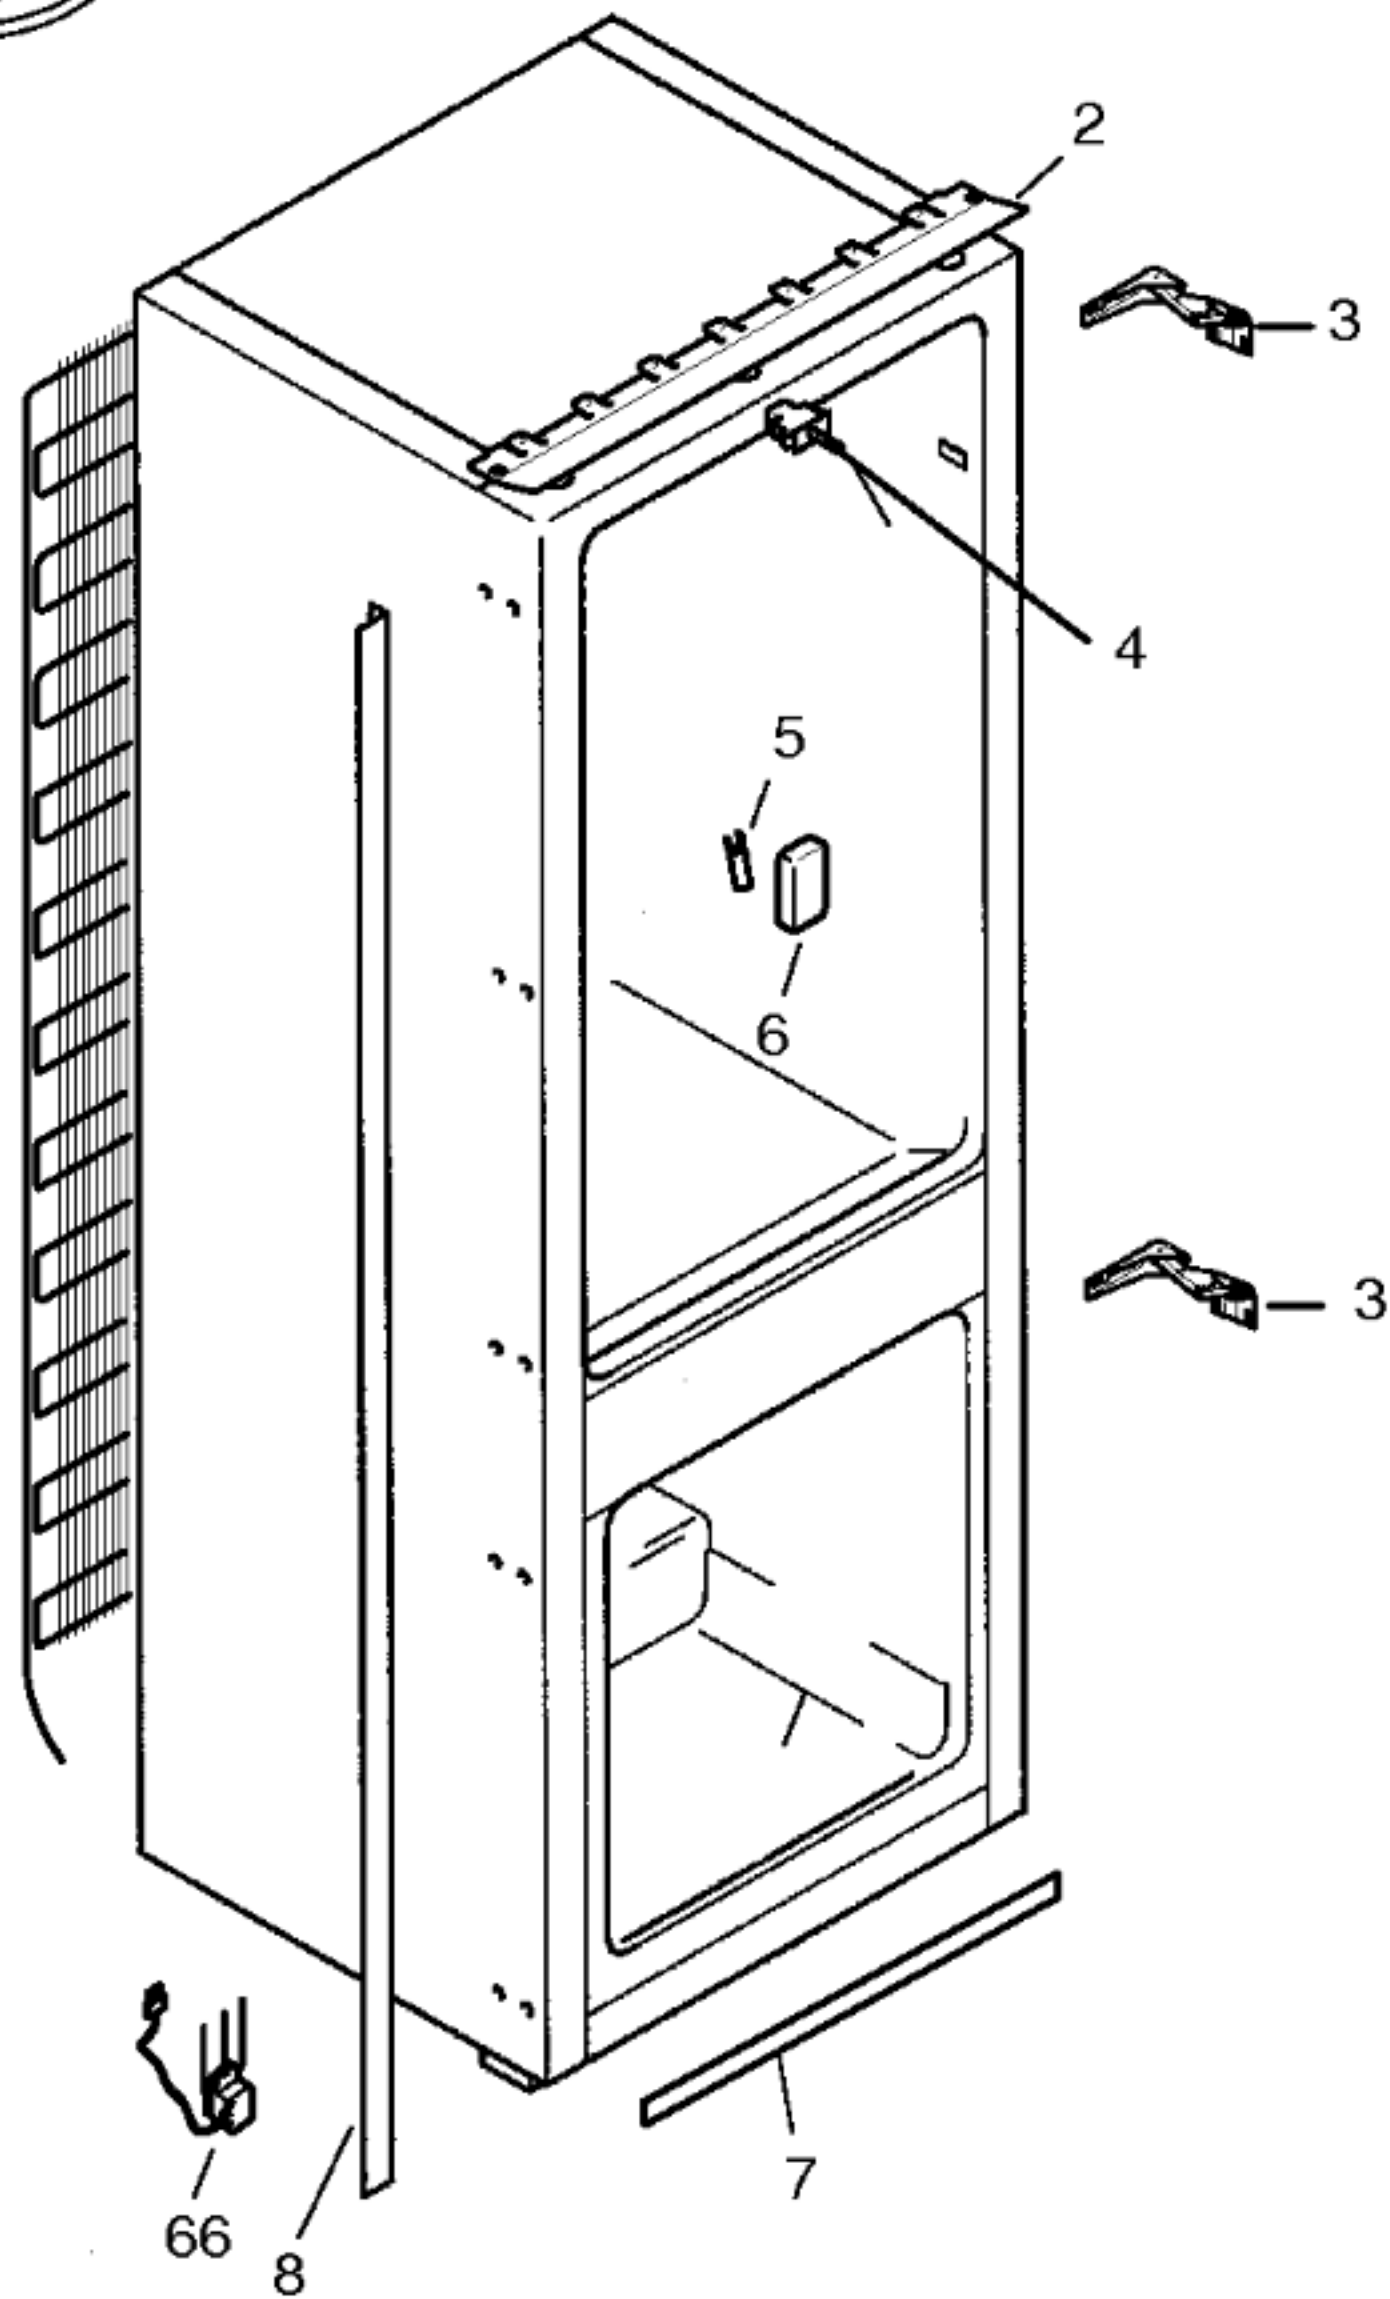

1

Mat. - Nr. - Konstante
3740

Gebrauchsanweisung

29

(D,GB,F,I,NL,S,E,DK,N,,SF)



Montageanleitung


30

(D,GB,F,I,NL,S,E,DK,N,,SF)

Befestigungssatz

31

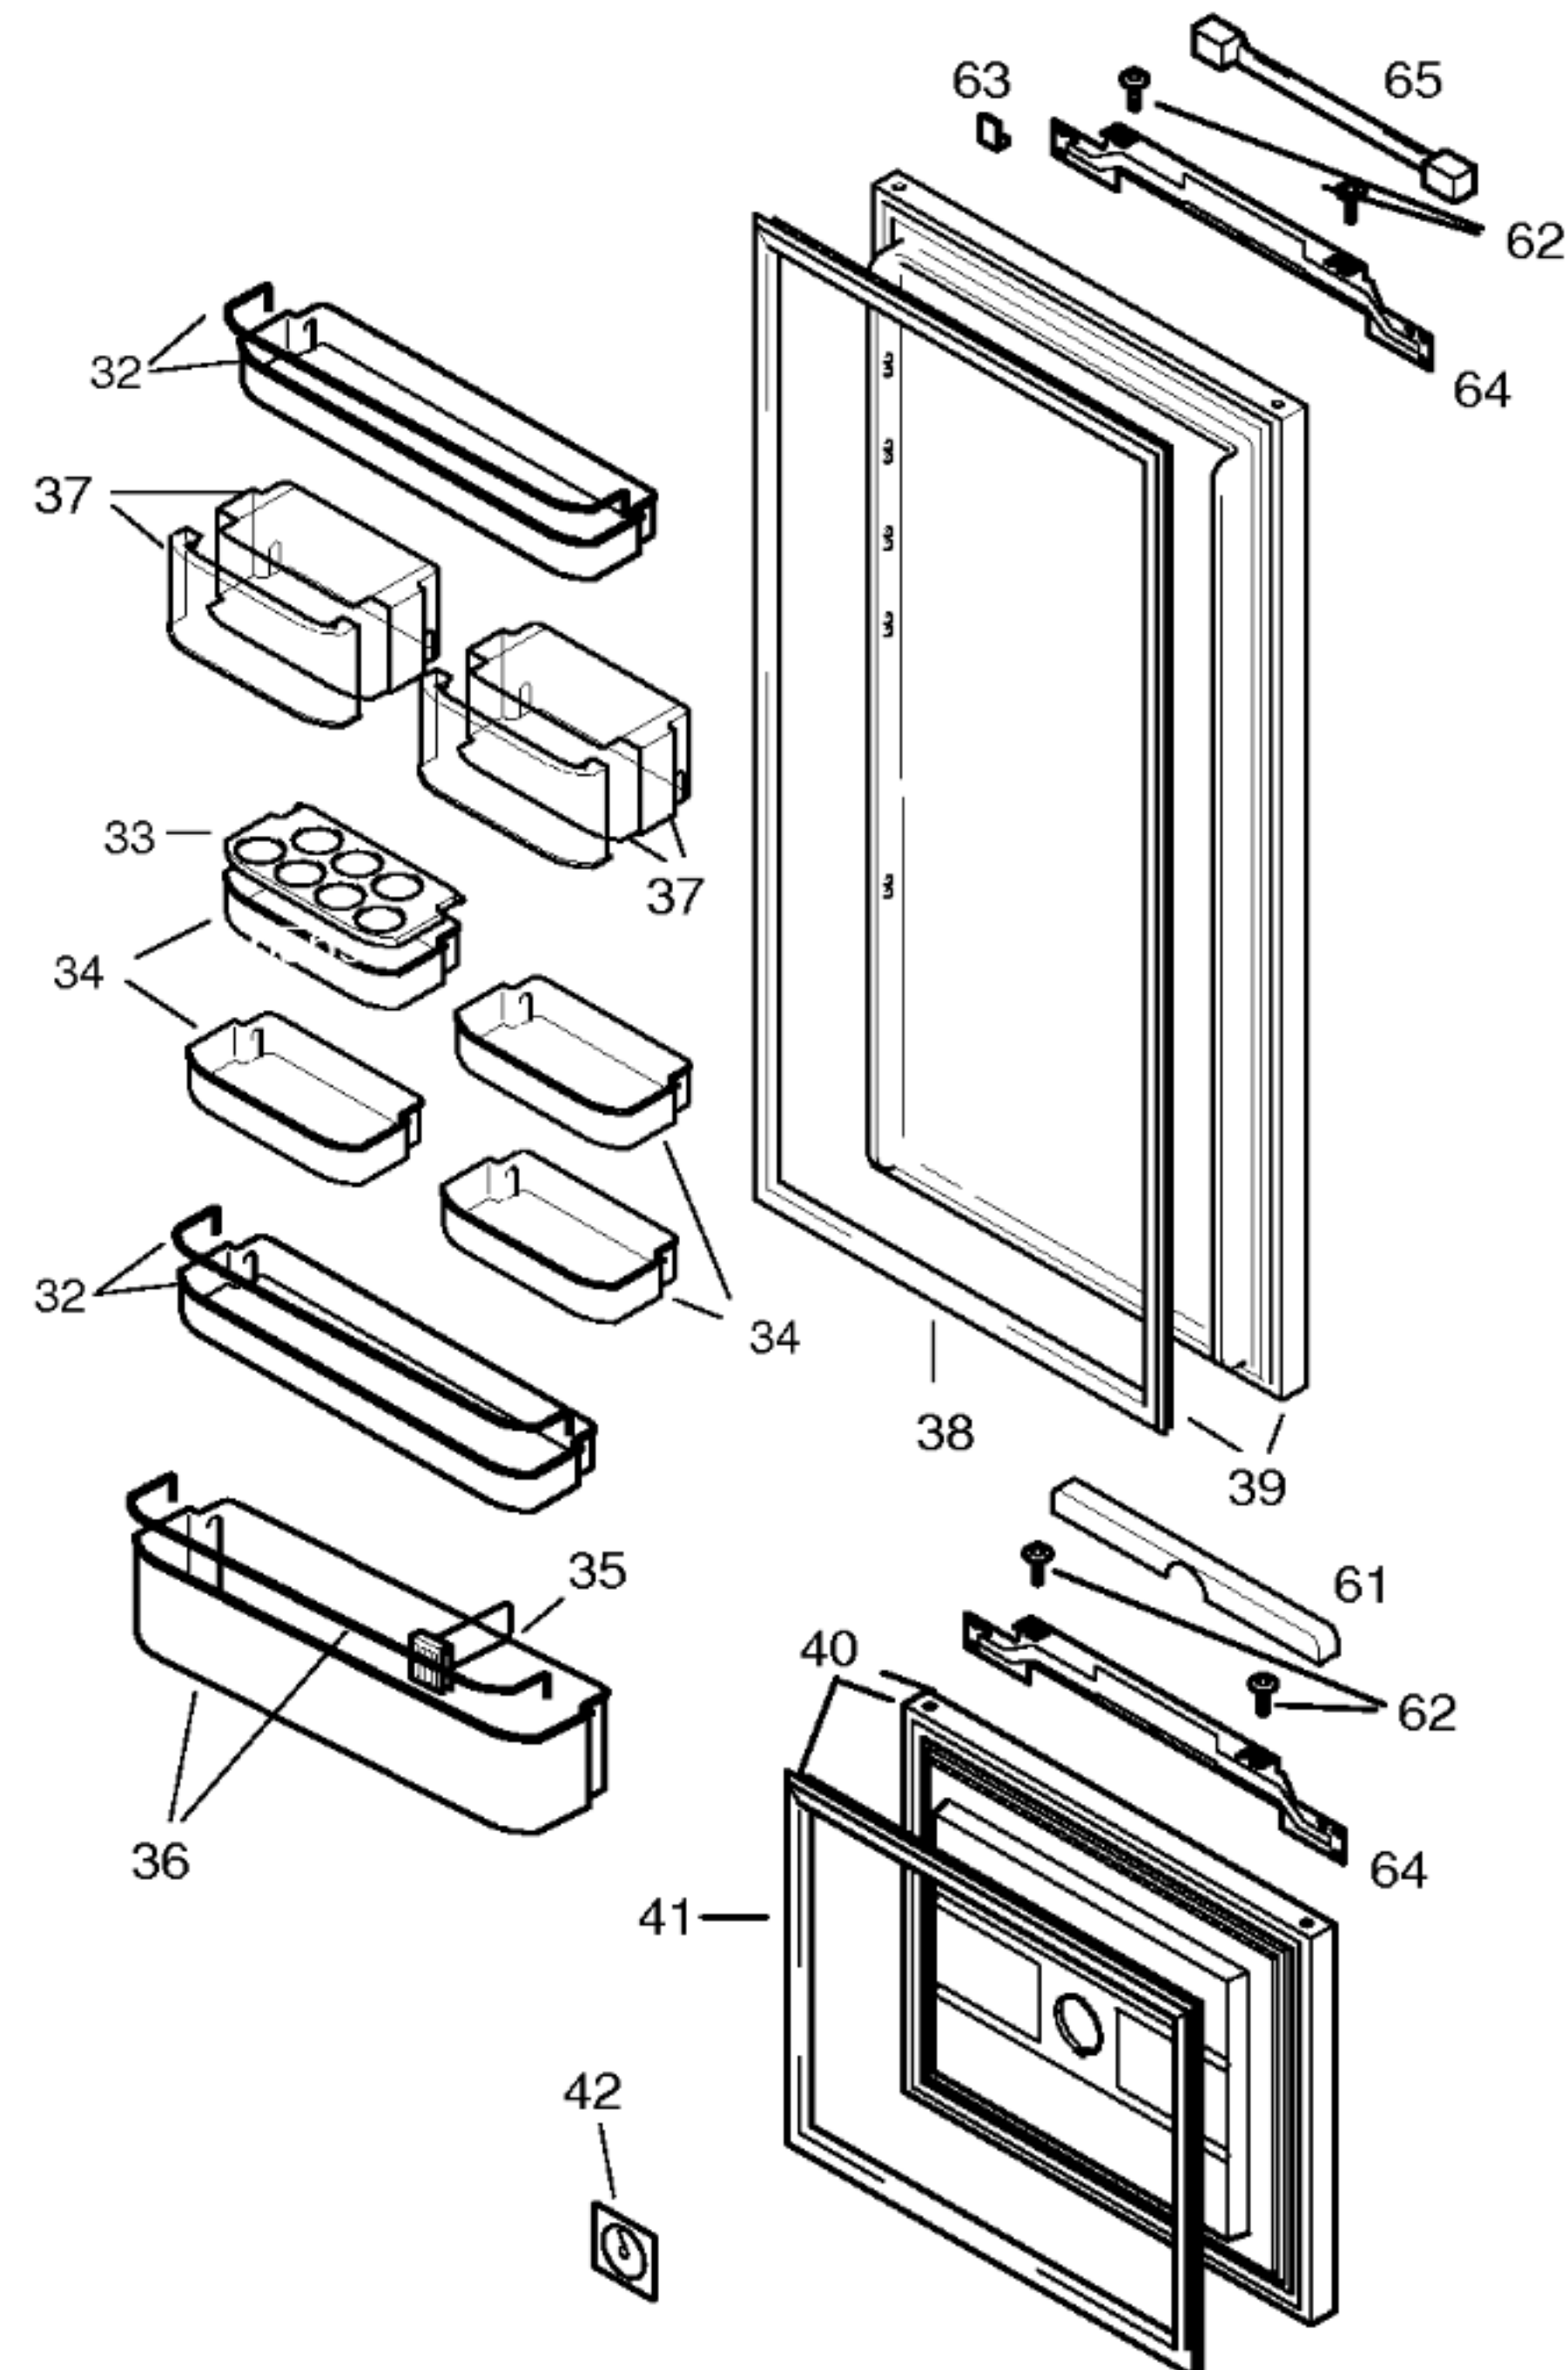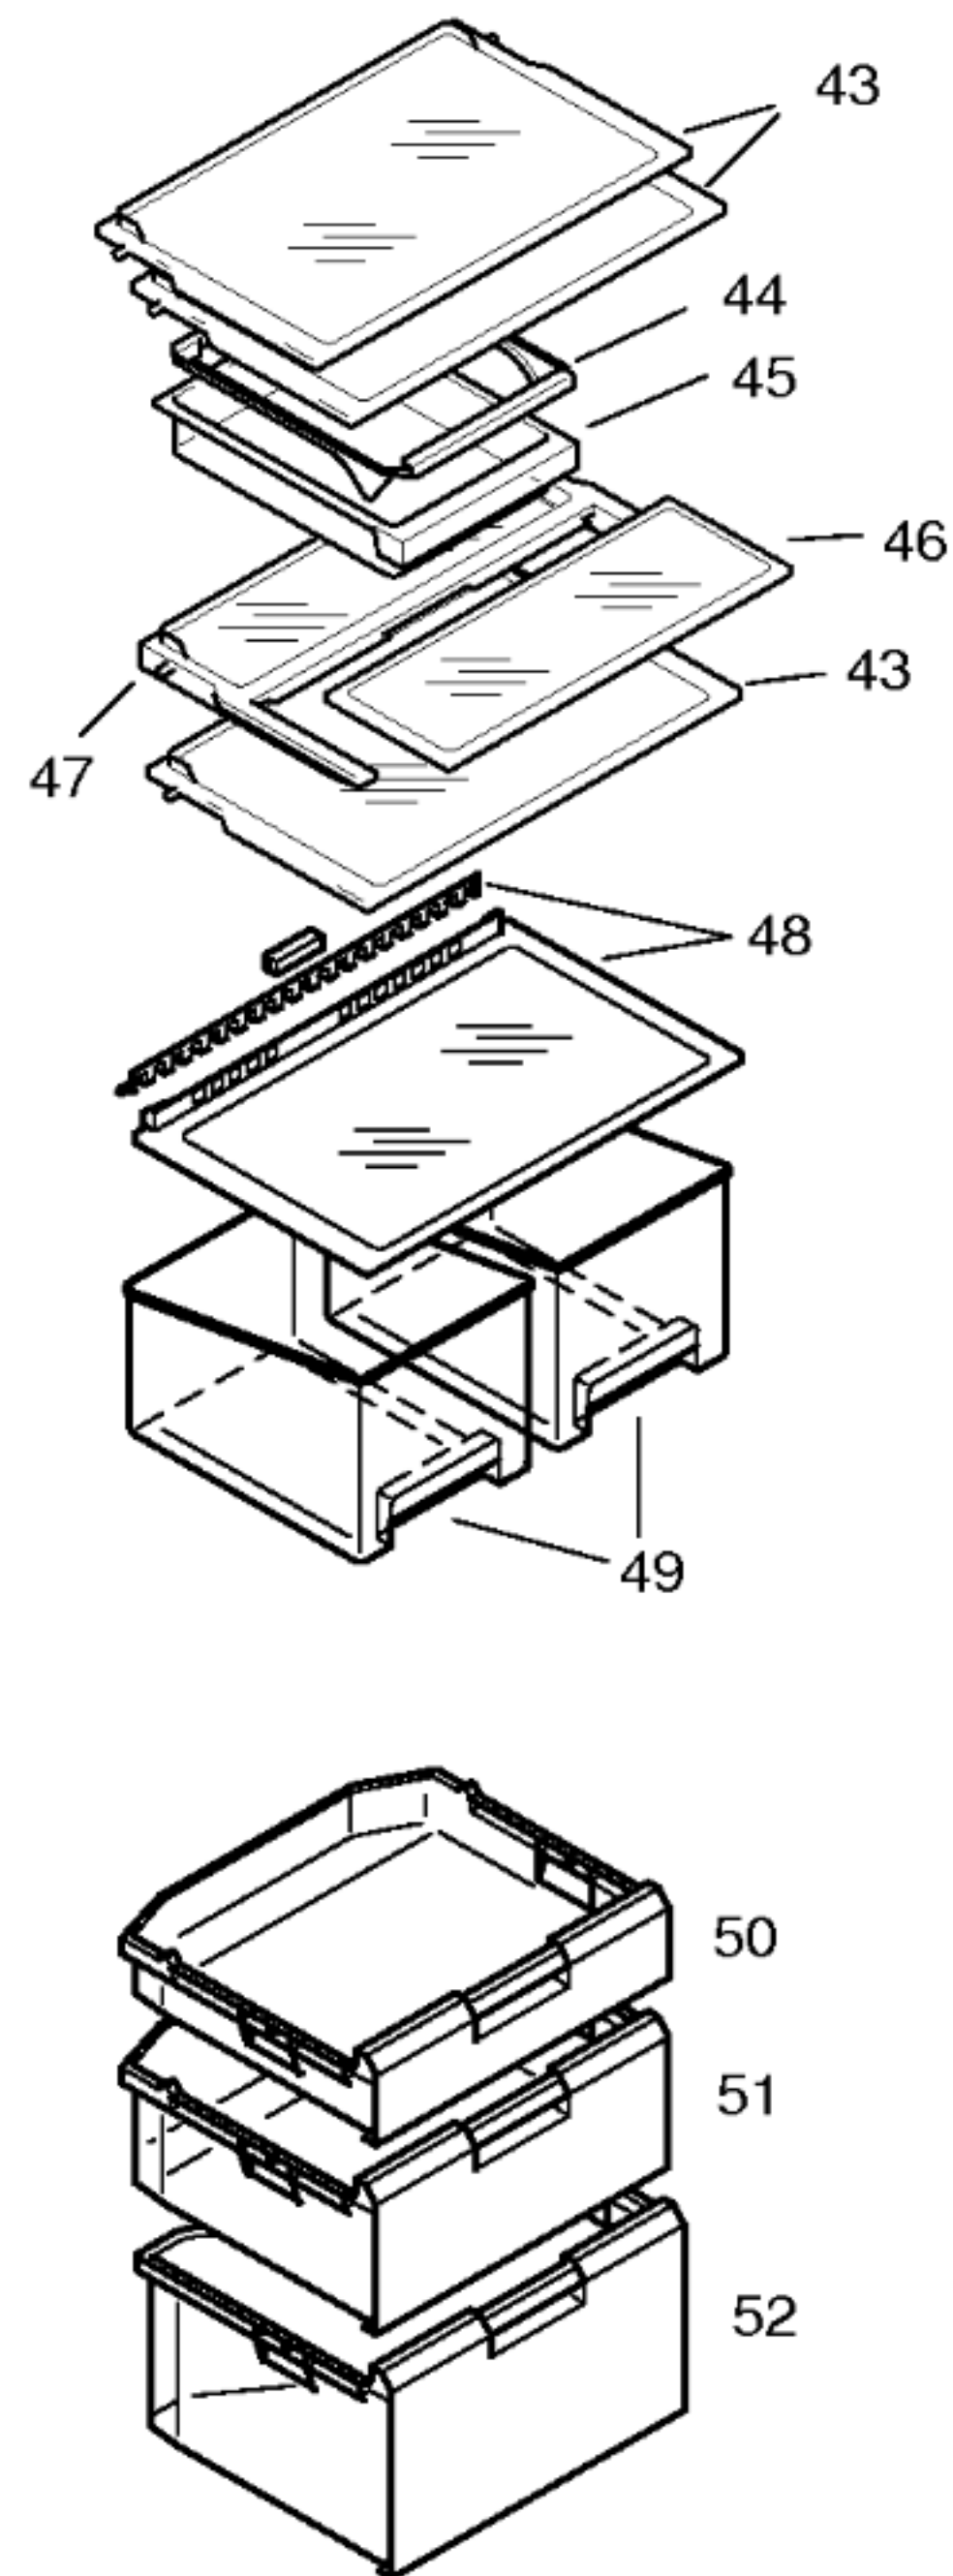Mat. - Nr. - Konstante
3740

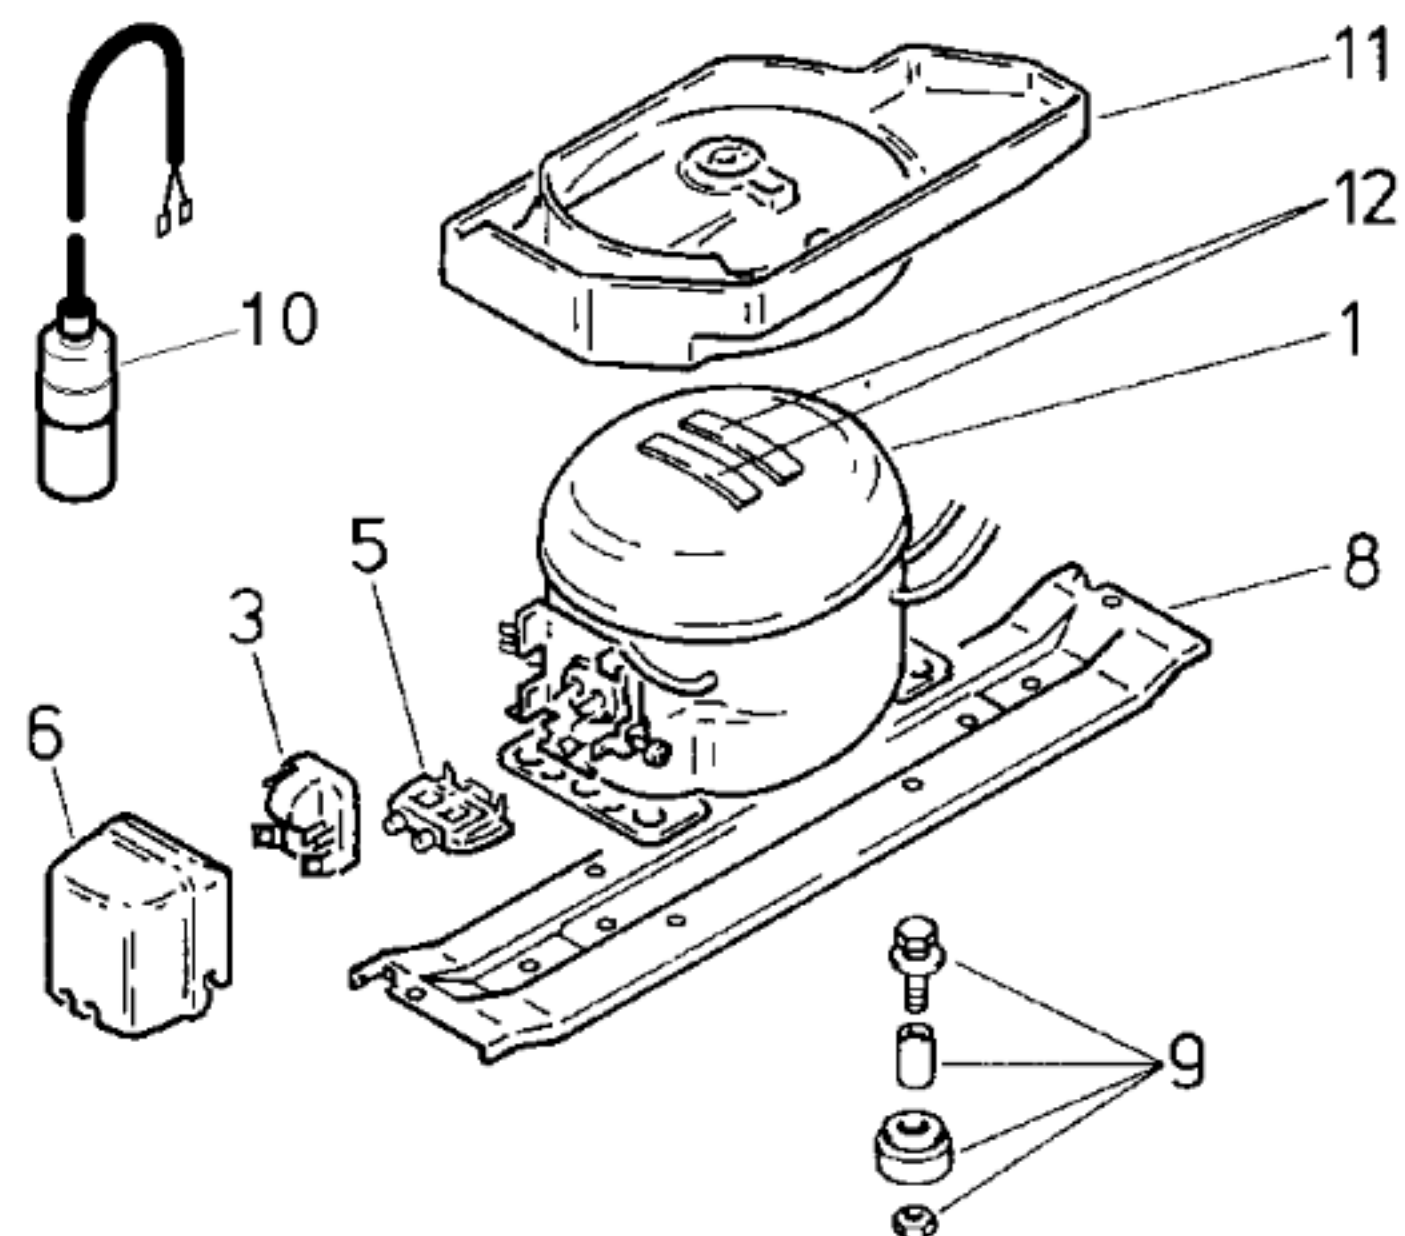Mat. – Nr. – Konstante
3740

TECHNISCHE DATEN / TECHNICAL DATA / DONNEES TECHNIQUES

Verdichter/Compressor/Compresseur			Matsushita	Matsushita	
Typ/Type			DC110E	DGX 110 E	
Förderleistung/Delivery/Débit				1955	
Anlaufstrom/Starting current/Cour. de démarrage				0,5	
Widerstand/Resistance/Résistance			Ha/main/prin.	14,7	
			Hi/aux	27,3	
Temp.-Regler/Thermostat					
Typ/Type					
Reglerstellung/Position					
Schaltwerte/Switching values/			„ein“	°C	
Valeurs de commutation			„aus“		
(„abtauen“ od.)			„alarm“		
Füllmenge/Fill.quantity/Charge			R600a	g	*
Anschlußwert/Conn.load/Puiss. connectée			W	104	
Heizung/Heater/Chauffage					
Widerstand/Resistance/Resistance			Ω		
Leistung/Power/Puissance			W		
Ventilator/Blower/Ventilateur					
Widerstand/Resistance/Résistance			Ω		
Magnetventil/Magnetic valve/Electrovanne					
Widerstand/Resistance/Résistance			Ω		
Spannung/Voltage/Tension			V		
NTC-Fühler / Sensor			°C	kW	°C kW
			+10	9,95 □ 0,18	-18 43,31 □ 1,10
			+5	12,70 □ 0,18	-22 54,66 □ 1,59
			0	16,33 □ 0,16	-26 69,42 □ 2,29

* siehe Typenschild

Pos.	V01 Matsushita DC110 E	V02 Matsushita DGX 110 E	
1	53	53	
2			
3	54	54	
4			
5	55	55	
6	56	56	
7			
8	57		
9	58		
10			
11	59		
12	60		