
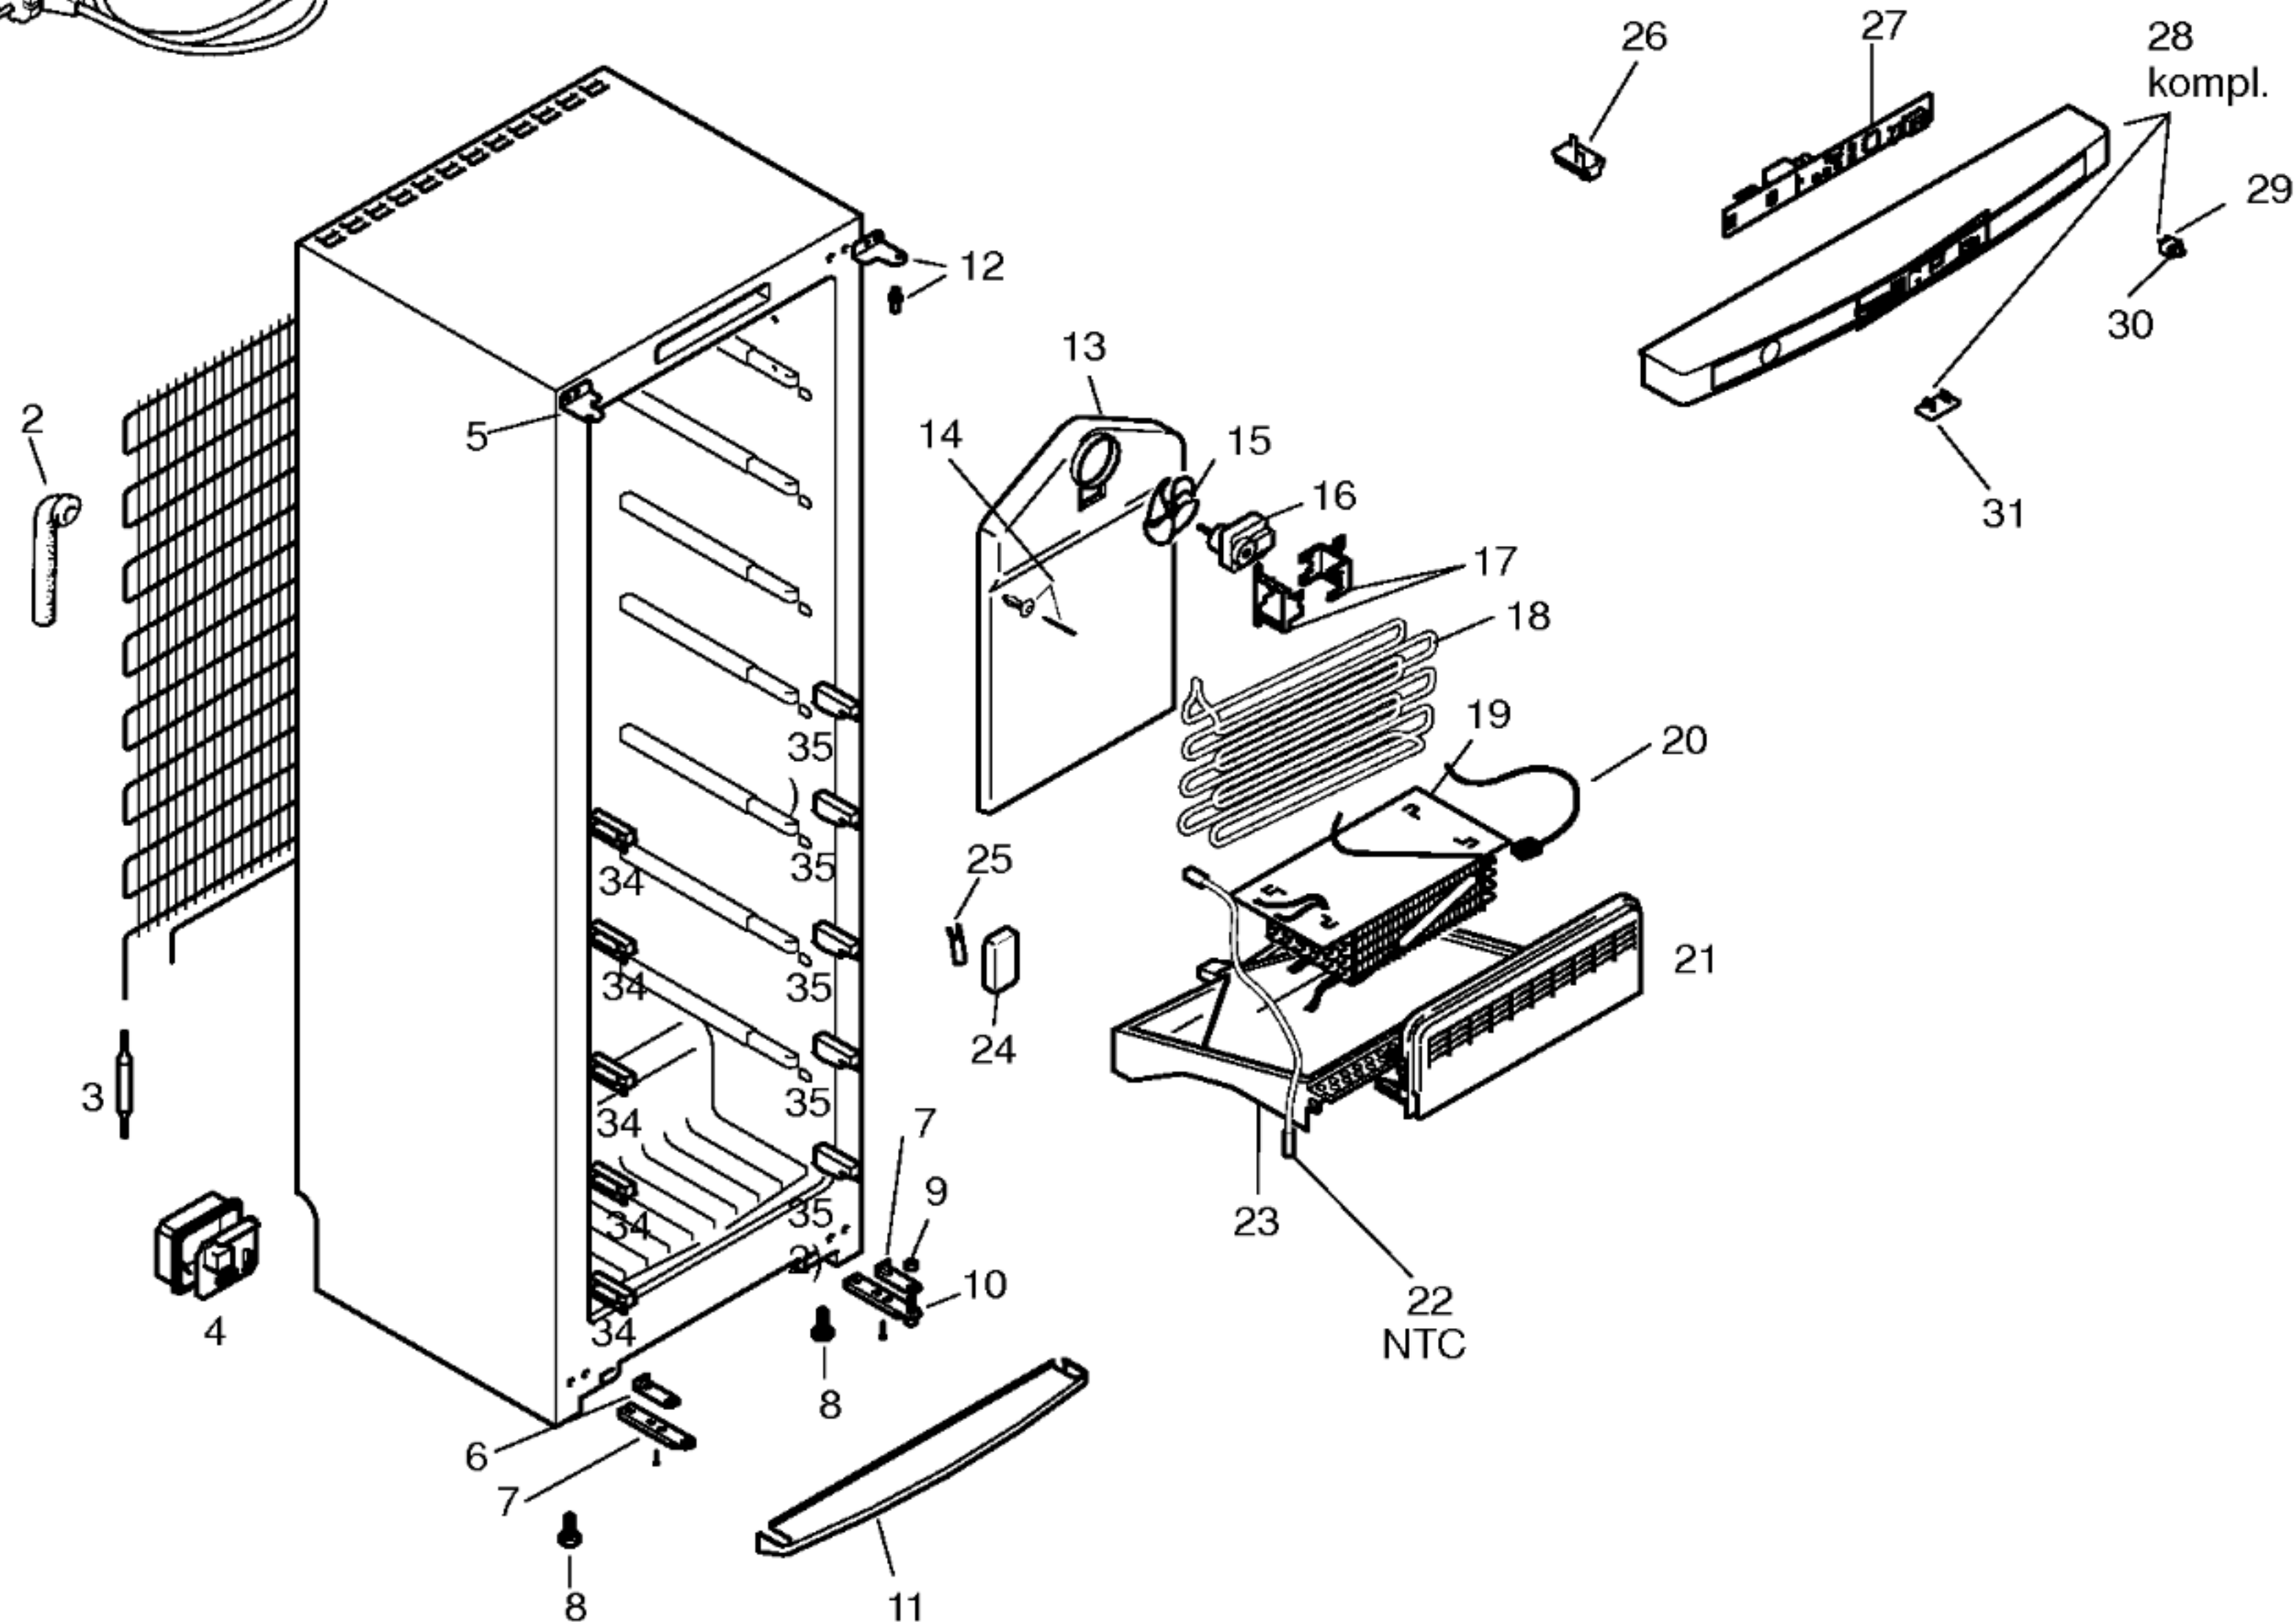
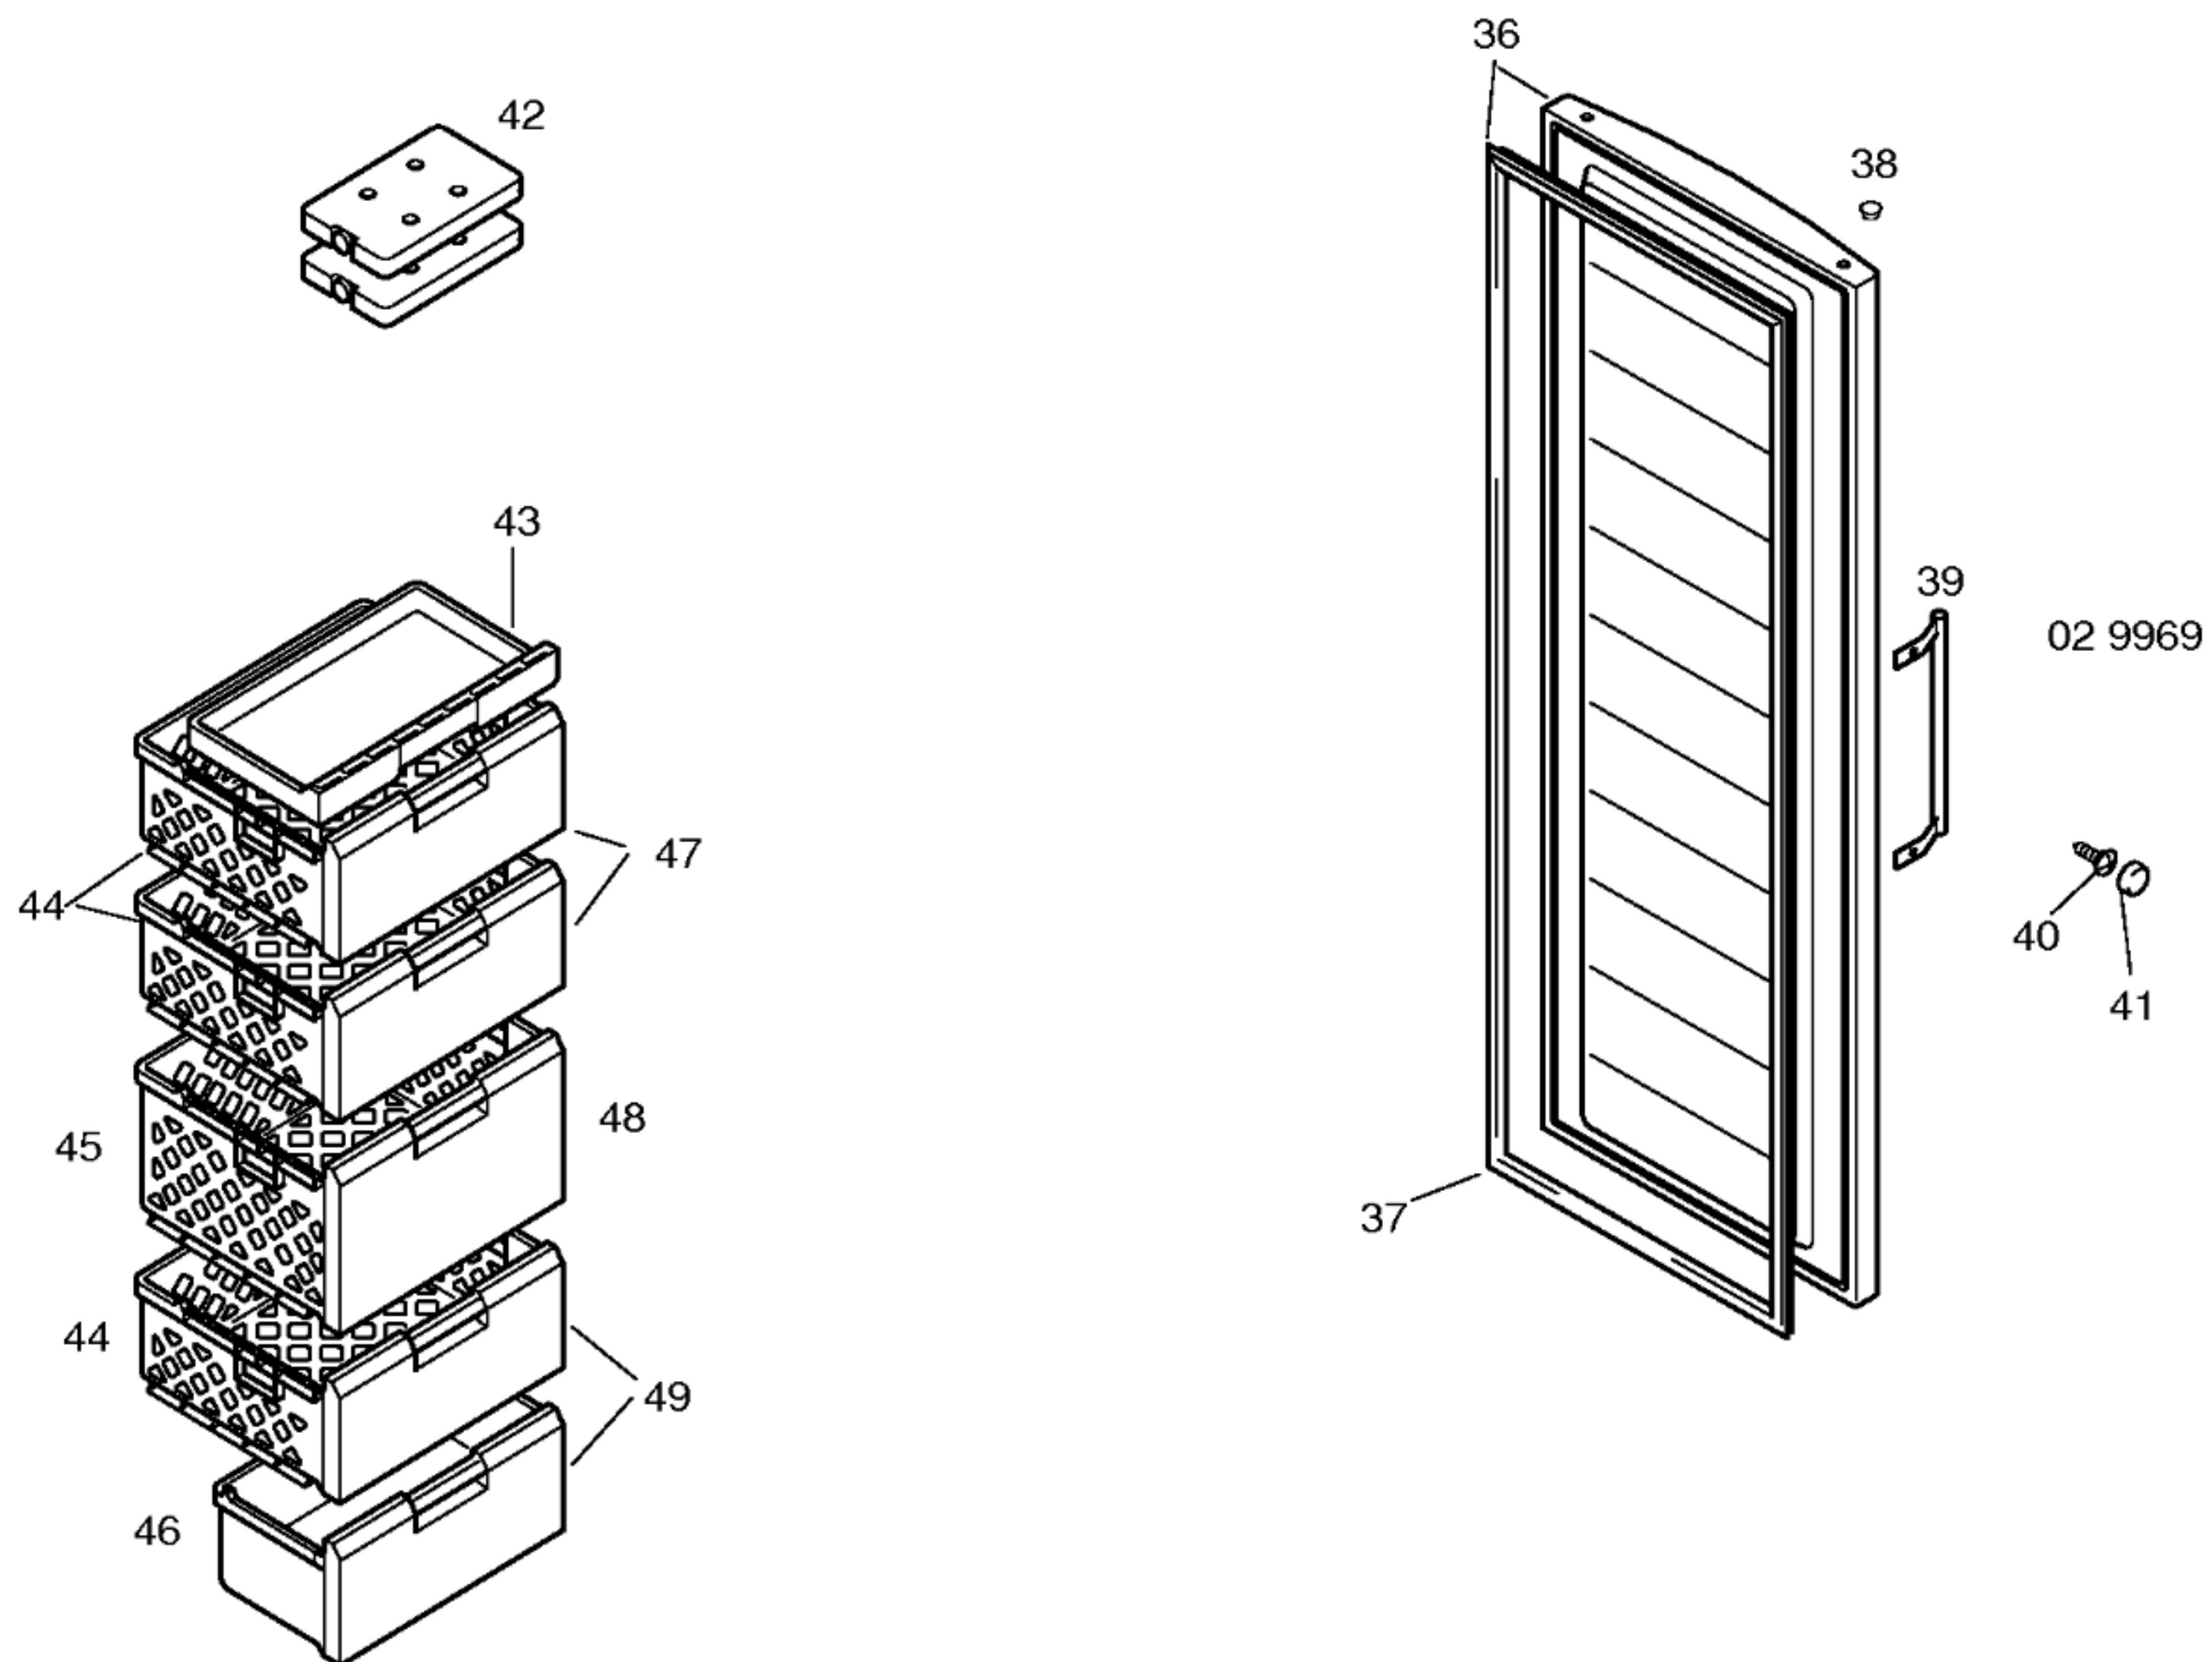


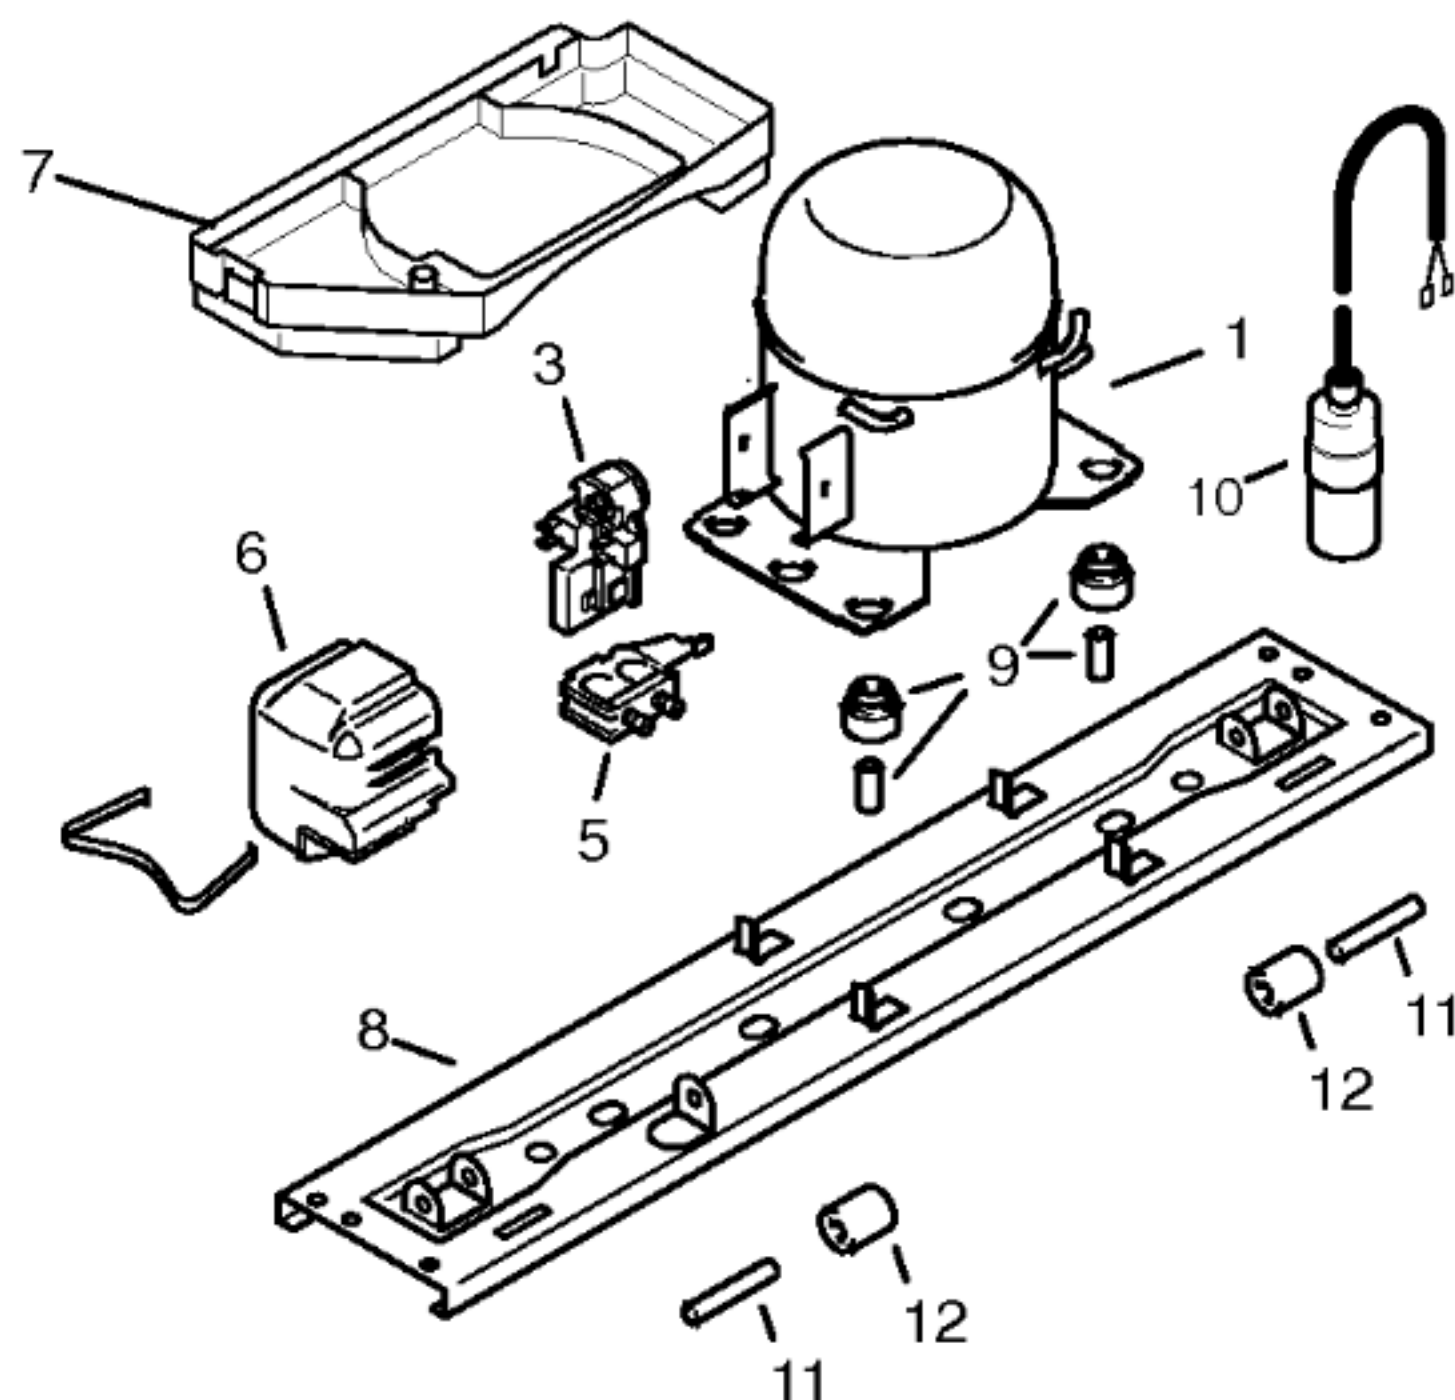

Mat. – Nr. –Konstante
3740

Gebrauchsanweisung
32
(D,GB)
Beistellsatz
33

Mat. – Nr. – Konstante
3740

Mat. – Nr. – Konstante
3740

	V01		
	Matsushita		
Pos.	DC125E		
1	50		
2			
3	51		
4			
5	52		
6	53		
7	54		
8	59		
9	55		
10	58		
11	56		
12	57		

TECHNISCHE DATEN / TECHNICAL DATA / DONNEES TECHNIQUES					
Verdichter/Compressor/Compresseur		Matsushita			
Typ/Type		DC125E			
Förderleistung/Delivery/Débit		l/h	2246		
Anlaufstrom/Starting current/Cour de démarrage		A	9,2		
Widerstand/Resistance/Résistance		Ha/main/prin	W	12,1	
		Hi/aux	W	13,8	
Temp.-Regler/Thermostat					
Typ/Type					
Regelstellung/Position					
Schaltwerte/Switching values		"warm"			
Valeurs de commutation		"kalt"			
		"alarm"			
Füllmenge/Fill.quantity/Charge		R600a	*	*	
Anschlußwert/Conn.load/Puiss. connectée		W	120		
Heizung/Heater/Chauffage			Abtauheizung	Rinnenheizung	
Widerstand/Resistance/Résistance		W	288	240	
Leistung/Power/Puissance		W	200	24	
Ventilator/Blower/Ventilateur					
Widerstand/Resistance/Résistance		W	560		
Raumtemperaturfühler 2%		C	K	C	k
		+10	9,9	-18	43,3
		+5	12,7	-22	54,6
		+0	16,3	-26	69,4
Widerstand NTC-Fühler 1%		°C	kW	°C	kW
		-1	17,3	-15	36,5
		-9	26,2	-16	38,8
		-14	34,5	-19	45,9
				-20	48,6
				-23	58,1
				-24	61,6
Magnetventil/Magnetic valve/Electrovanne					
Widerstand/Resistance/Résistance		W			
Spannung/Voltage/Tension		V			

* siehe Typenschild